
AMENDMENT NO 01. Dated 17.09.2026.
Tender No. GEM/2026/B/7989186

The following amendment to the Technical Specification of the Tender is incorporated.

1. The earthing pipe shall have a wall thickness of 3.5 mm.
2. Details of Clamp: Each electrode shall have 4 numbers of clamps positioned at 90 degrees to each other. Each clamp shall be L-shaped and directly welded to the electrode. The top section of the each clamp should have dimensions of approximately 100 mm x 7 mm x 50 mm, with two holes (12 mm diameter) for the earthing bolt connection.
3. The Electrode should be fabricated from MS Pipe and galvanized after fabrication. This is to ensure all cut and drilled surfaces are fully protected against corrosion.
4. Dimensional details/drawings of the electrode shall be submitted along with the offer for scrutiny.
5. An indicative drawing of the earth electrode is attached for bidder's reference.

Also, the Bid Closing Date of the Tender has been extended till **01.10.2026 (13.00 Hrs)**

NOTE: All Other Terms and Conditions of the Tender remain same.

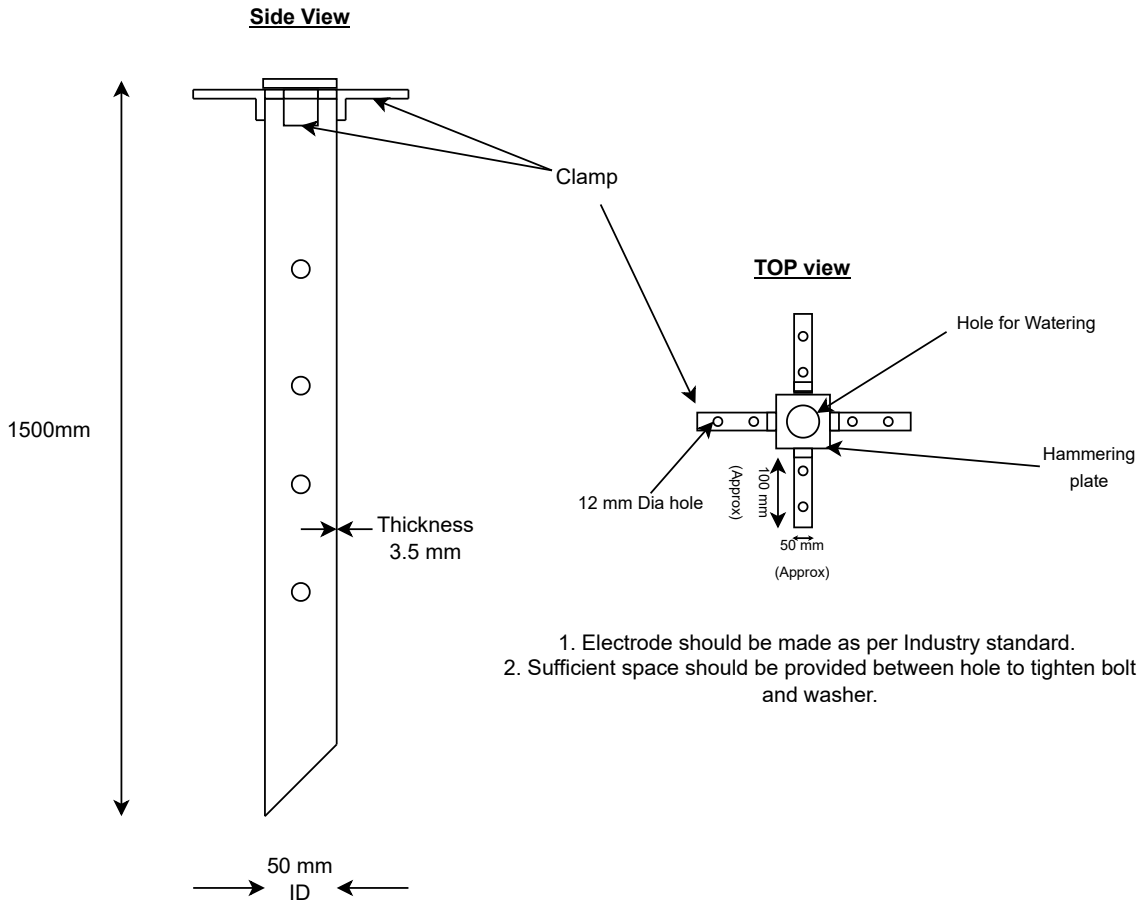

1. Electrode should be made as per Industry standard.
2. Sufficient space should be provided between hole to tighten bolt and washer.