

OIL INDIA LIMITED
(A GOVT. OF INDIA ENTERPRISE)
P.O.DULIAJAN-786602, ASSAM
E-TENDER NOTICE

WORKS CONTRACT

OIL INDIA LIMITED (OIL) invites Bids under Composite bid System from established Civil Engineering firms / contractors through its E-Procurement portal “<https://etender.srm.oilindia.in/irj/portal>” for the following works.

IFB No.	DESCRIPTION OF SERVICE	BID SECURITY	COST OF BID DOCUMENT
CDC9159P22	Construction of Double Storied Sangini Building with electrifications including supply of all materials except cement at Duliajan.	Nil	NIL
Bid Closing / Opening Date & Time for the above work : 18.01.2022 at 11.00/14.00 Hrs.			
Bidder shall require User ID and Password for online submission of Bid.			
Bidders without having E-tender Login ID and Password should complete their online registration <u>at least seven (7) days prior to the scheduled bid closing date and time of the tender</u> . For online registration, Bidder may visit the OIL's E-tender site https://etender.srm.oilindia.in/irj/portal .			
Necessary Login ID & Password will be issued by OIL only after submitting the complete online registration by the Bidder. In the event of late registration/incomplete registration by Bidder, OIL INDIA LIMITED shall not be responsible for late allotment of User ID & Password and request for bid closing date extension on that plea shall not be entertained by Company.			
No physical Bid documents will be issued. The details of IFB can be viewed using “Guest Login” provided in the E-Procurement portal and also in OIL's web site www.oil-india.com . The link to OIL's E-Procurement portal has also been provided through OIL's web site www.oil-india.com .			
All corrigenda, addenda, amendments, time extension, clarifications etc. to the tender will be hosted on the OIL's website and in the e-tender portal only and no separate notification shall be issued in the press. Prospective bidders are requested to regularly visit the website and e-portal to keep them updated.			

Date: 18.12.2021

DGM Contracts (Civil)
For GM-Contracts (HOD)
For RESIDENT CHIEF EXECUTIVE

OIL INDIA LIMITED
(A Govt. of India Enterprise)
Contracts Department, Duliajan

WORKS CONTRACT

OIL INDIA LIMITED, a premier Public Sector Enterprise of Govt. of India engaged in drilling and exploration activities for hydrocarbon invites ON-LINE BIDS from experienced and established firms/ contractors meeting the requisite criteria for the following mentioned work under **COMPOSITE BID SYSTEM** through its e-Procurement site:

DESCRIPTION OF WORK/ SERVICE: Construction of Double Storied Sangini Building with electrifications including supply of all materials except cement at Duliajan.

INTERNAL ESTIMATED COST: ₹ 2,15,83,137.45

LOCATION OF WORK: Existing Sangini Building area, Oil India Limited, Duliajan.

CONTRACT PERIOD: 60 Weeks

BID CLOSING/ OPENING DATE & TIME: 18.01.2022 (11:00 HRS/14:00 HRS)

BID SECURITY DEPOSIT: NIL

PERFORMANCE SECURITY DEPOSIT: 3 % of Total Contract Cost (shall be kept as retention money from running bill)

2.0 Bidders must submit the Bid Security Declaration against the tender as per format prescribed in **Annexure-III**.

Any bidder having MSE Registration Certificate may upload a scanned copy of their registration certificate along with the technical bid while participating in the tender. This is for Company's information and record only.

3.0 If the above mentioned closing / opening day of the tender happens to be non-working day due to Bandh / Strike or any other reason, the bids will be received and opened on the following working day at the same time except on Saturdays.

4.0 While submitting responses against the tender in OIL's e-tender portal, bidders must fill up the "Total Bid Value" (under RFx Information > Basic Data > Total Bid Value), taking account of all liabilities including statutory liabilities in their quoted price (excluding PF and GST). A screen shot in this regard is shown below. The price quoted under the "Total Bid Value" should be within the range of "At Par" to "+10%" of Company's Internal Estimate. Bids with overall quoted price as indicated in the "Total Bid Value" (under RFx Information > Basic Data > Total Bid Value) below "at par" and above "10%" of Company's Internal Estimate will be rejected straightway.

Company shall evaluate the inter-se-ranking of the bidders and conduct Draw of Lots amongst the eligible bidders in case of identical bidding, strictly as per the overall quoted price under the "Total Bid Value" (under RFx Information > Basic Data > Total Bid Value) and awarding of contract shall be done accordingly.

It is the responsibility of the bidder to fill up the "Total Bid Value" (under RFx Information > Basic Data > Total Bid Value) correctly as per the instructions given herein. OIL INDIA LTD accepts no liability of any nature resulting from any calculation error or omissions while filling up the "Total Bid Value" (under RFx Information > Basic Data > Total Bid Value) by the bidders and no claim whatsoever shall be entertained thereof.

In case of identical bidding, Draw of Lots shall be conducted amongst the bidders who have quoted the lowest price (within the permissible percentage) under the “Total Bid Value” tab, to select 7 (seven) numbers of bidders priority-wise. The Technical and Commercial Scrutiny of bids will be carried out for these 7(seven) bidders only for further processing of the tender.

For convenience of the bidders and to improve transparency, the overall rate quoted by the bidders (within the range of “At par” to +10% of the internal estimate) against the tender shall be available for online viewing by all such bidders whose price bids shall be opened. Online view of prices as above shall be available to the bidders only upto 7 (seven) days from the date of price bid opening of the tender.

5.0 All techno-commercial documents are to be submitted as per tender requirement under **“Technical Attachments Tab”** in E-TENDER PORTAL.

6.0 To participate in OIL’s E-procurement tender, bidders must have a legally Valid Digital Signature of Class 3 [**Organizational Type**] with Organizations Name along with **Encryption Certificate** as per Indian IT Act from the licensed Certifying Authorities operating under the Root Certifying Authority of India (RCAI), Controller of Certifying Authorities (CCA) of India (<http://www.cca.gov.in>). Digital Signature Certificates having **“Organization Name”** field other than **Bidder’s Name (i.e. Firm’s Name)** are not acceptable.

6.1 The authenticity of above Digital Signature shall be verified through authorized CA after bid opening. If the **Digital Signature Certificate (DSC)** used for signing is not of **“Class -3”** & Organizational type with Organization’s name in the name of the bidder i.e. firm, the bid will be rejected.

Note: Only in case of sole proprietorship firms, Digital Signature Certificates issued in the name of the proprietor is also acceptable provided the bid is submitted in the capacity of a proprietorship firm.

6.2 Bidder is responsible for ensuring the validity of Digital Signature Certificate (DSC) and its proper usage by their employee.

6.3 The bid including all uploaded documents shall be **digitally signed** by duly authorized representative of the bidding company. The DSC used must be of the type as mentioned above.

7.0 Bidders without having E-tender Login ID and Password should complete their online registration at least seven (7) days prior to the scheduled bid closing date and time of the tender. For online registration, Bidder may visit the OIL’s E-tender site <https://etender.srm.oilindia.in/irj/portal>.

7.1 Necessary Login ID & Password will be issued by OIL only after submitting the complete online registration by the Bidder. In the event of late registration/incomplete registration by Bidder, OIL INDIA LIMITED shall not be responsible for late allotment of User ID & Password and request for bid closing date extension on that plea shall not be entertained by Company.

8.0 The Company reserves the right to reject any or all the bids or accept any bid without assigning any reason.

Note: Bidders must note that in case of any discrepancy or non-compliance to the tender criteria is found in their bids at any stage of tendering prior to the award of contract, such bids shall be rejected straightway. No claims or requests from such bidders shall be entertained thereafter.

9.0 (a) Bidders will be permitted by System to withdraw their bid or make any changes in their bid after the bid has been uploaded by the bidder prior to the Bid Closing date and time as mentioned in the bid. But no changes or withdrawal would be allowed by the system once the due date and time for submission of bids has been reached and bids are opened. Bidders are requested to take note of the above and arrange to submit their bids within the submission deadline to avoid last minute rush/network problems.

(b) No bid can be modified / withdrawn subsequent to the deadline for submission of bids. No Bidder can withdraw his bid within the validity or extended validity of the bid. Withdrawal of any bid within bid validity period will lead to forfeiture of his/her/their Bid Security in full and debarment from

participation in future tenders, at the sole discretion of the Company and the period of debarment will be decided as per OIL's banning policy dated 6th Jan 2017 available at OIL's website.

(c) Once a withdrawal letter is received from any bidder, the offer will be treated as withdrawn and no further claim / correspondence will be entertained in this regard.

10.0

- a) The Bid must be valid for 90 (Ninety) days from the actual date of closing of the tender.
- b) The bidders must upload the Integrity Pact, digitally signed by the authorized signatory (who is authorized to sign the bid) along with the Technical Bid.

11.0 Conditional bids are liable to be rejected at the discretion of the Company.

12.0 The work may be split up amongst more than one contractor at the sole discretion of the Company.

13.0 Before submission of bids, the bidder is advised to inspect the work site with permission from HOD - Civil or his representative, to assess the nature and extent of work and the conditions under which it will be carried out.

14.0 The bidder may also seek such clarification from this office as are deemed necessary.

15.0 The bidders are required to furnish the composition and status of ownership of the firm in whose name bid documents have been purchased/issued along with one or more of the following documentary evidences (which are applicable to the bidder) in support of the same and scanned copies of the same should be uploaded along with the Un priced bid documents.

15.1 In case of Sole Proprietorship Firm, Copies of Telephone/Electricity/Mobile Bill, PAN card, latest Income Tax Return form indicating therein the name, business and residential address, E-mail and phone numbers of the owner and copies of GST Registration Certificate.

15.2 In case of HUF, Copies of Telephone/Electricity/Mobile Bill, PAN card, latest Income Tax Return form, Family Arrangement indicating therein the name, residential address, E-mail and phone numbers of the owners in general and Karta in particular and copies of GST Registration Certificate.

15.3 In case of Partnership Firm, Copies of Telephone/Electricity/Mobile Bill, PAN card, latest Income Tax Return form indicating therein the name, residential address, E-mails and phone numbers of all the partners (including the Managing Partner), registered partnership agreement/deed and copies of GST Registration Certificate.

15.4 In case of Co-Operative Societies, Copies of Telephone/Electricity/Mobile Bill, PAN card, latest Income Tax Return form indicating therein the name, residential address, E-mails and phone numbers of all the Directors or persons who are at the helm of affairs, registration certificate from Registrar of Co-Operative Societies and copies of GST Registration Certificate.

15.5 In case of Societies registered under the Societies Registration Act, Copies of Telephone/Electricity/Mobile Bill, PAN card, latest Income Tax Return form indicating therein the name, residential address, E-mail and telephone numbers of all the Directors or persons who are at the helm of affairs, registration certificate from the Registrar of the state and copies of GST Registration Certificate.

15.6 In case of Joint Stock Companies registered under the Indian Companies Act, Copies of Telephone/Electricity/Mobile Bill, PAN card, latest Income Tax Return form indicating therein the name, residential address, E-mail and telephone numbers of all the Directors or persons who are at the helm of affairs, Certificate of Incorporation from the Registrar of Companies, Memorandum and Articles and copies of GST Registration Certificate.

15.7 In case of Trusts registered under the Indian Trust Act, Copies of Telephone/Electricity/Mobile Bill, PAN card, latest Income Tax Return form indicating therein the name, residential address, E-mail and

telephone numbers of all the Trustee or persons who are at the helm of affairs, registration certificate from the Registrar of the state, Trust Deed and copies GST Registration Certificate.

NOTE: Point no. 15.1 to 15.7 is not applicable for contractors who are already registered with OIL INDIA LIMITED.

16.0 Wherever applicable, the bidder shall have itself registered under Employees' Provident Fund and Miscellaneous Provisions Act, 1952 and follow the relevant statutory provisions including Rules made there-under concerning contractual workers to be engaged by such bidder. If the bidder does not have P.F. Code number at the time of applying for this tender, then the bidder must apply for the same if the contract is awarded to the bidder. Such bidder shall furnish the Provident Fund code number issued by the appropriate Govt. Authority, within 45 days of signing of contract, to Company (or when advised by Company, after 45 days of signing the contract); and all PF related statutory guidelines shall be adhered to by the bidder.

Bidders who are currently not covered under the Employees' Provident Fund and Miscellaneous Provisions Act, 1952 should submit an Undertaking for the same as prescribed in **Annexure-I** of the Tender Document.

17.0 Before Bidding :

- Bidder(s) are advised to inspect the work site with permission from HOD-Civil or his representative, to assess the nature and extent of work and the conditions under which it will be carried out.
- Bidder(s) should clearly understand all the terms & conditions, criteria, specification etc. of this tender.

18.0 The selected bidder will be required to enter into a formal contract within two weeks from the date of issuance of LOI, which will be based on their bid, i.e. OIL's Standard Form of Contract.

19.0 OIL INDIA LIMITED reserves the right to curtail / enhance the scope of the work stated above or cancel, if required.

20.0 The amount of retention money shall be released after 6 (six) months from the date of completion certified by the concerned department.

21.0 The work shall have to be started within seven days from the date of work order.

22.0 Time Schedule: The time allowed for completing the work will be reckoned from the date of issue of work order. Time is the essence of the Contract and failure on part of the contractor to complete the work within the stipulated time, shall entitle the Company to impose liquidated damages and / or penalty from the contractor as per terms of the Contract.

23.0 The contractor will be required to allow OIL officials to inspect the work site and documents in respect of the workers payment.

24.0 BACKING OUT BY BIDDER: In case any bidder withdraws their bid within the bid validity period, the Bid Security will be forfeited and be debarred from further tendering as per OIL's banning policy dated 6th Jan 2017 available at OIL's website: www.oil-india.com.

25.0 BACKING OUT BY L-1 BIDDER AFTER ISSUE OF LOI: In case LOI issued is not accepted by the L1 bidder or the Performance Security is not submitted as per the terms of the contract within the time specified in the Bid Document, the Bid Security shall be forfeited and the bidder shall be dealt as per OIL's banning policy dated 6th Jan 2017 available at OIL's website: www.oil-india.com.

26.0 FURNISHING FRAUDULENT INFORMATION/DOCUMENT: If it is found that a Bidder/Contractor has furnished fraudulent document/information, the Bid Security/ Performance Security shall be forfeited and the party shall be debarred as per the OIL's Banning Policy dated 6th Jan 2017 available at OIL's website. **Annexure VI must be duly filled in bidder's letter head and upload the scanned copy of the same along with techno-commercial bid.**

27.0 ERRING / DEFAULTING AGENCIES: Erring and defaulting agencies like bidder, contractor, supplier, vendor, service provider will be dealt as per OIL's Banning Policy dated 6th January, 2017 available in OIL's website: www.oil-india.com.

28.0 Bidder(s) must also furnish the followings:

- a) NAME OF FIRM :
- b) DETAIL POSTAL ADDRESS :
- c) MOBILE / TELEPHONE NO :
- d) E-MAIL ADDRESS :
- e) FAX NO (If available) :
- f) CONTACT PERSON :
- g) VENDOR CODE :
- h) GST Registration Number (If available):

29.0 The tender will be governed by :

- a) Covering Letter
- b) Bid Evaluation Criteria/ Bid Rejection Criteria (BRC/BEC)
- c) Part-I - General Conditions of Contract (GCC)
- d) Part-II - Schedule of Work, Unit and Quantity (SOQ)
- e) Part-III - Special Conditions of Contract (SCC)
- f) Part-IV - Schedule of Company's Plants, Materials and Equipment (SCPME)
- g) Part-V - Safety Measures (SM)
- h) Part-VI - Integrity Pact (IP)
- i) Pro forma
- j) Annexures

30.0 Bidders are requested to examine all instructions, forms, terms and specifications in the bid. Failure to furnish all information required as per the bid or submission of offers not substantially responsive to the bid in every respect will be at the bidders risk and may result in the rejection of its offer without seeking any clarifications. Offers sent without the requisite value of prescribed Bid Security (if called for in the bid) in original will be rejected straightway.

31.0 Both "TECHNICAL" and "PRICED" Bids should be submitted on-line through OIL's e-Tender Portal up to scheduled bid closing date and time and will be opened on the scheduled bid opening date and time as mentioned in e-tender portal at Office of the GM-Contracts (HOD) in presence of authorized representatives of the bidders present, if any.

The Technical Bid should be submitted as per Scope of Work & Technical Specifications along with all technical documents related to the tender and should be uploaded under "Technical Attachment" Tab only. Bidders must note that no price details should be uploaded in "Technical Attachment" Tab Page. Bidders must quote their overall price under the "Total Bid Value" within the range of "at par" to "+10%" of Company's Internal Estimate, taking into account all liabilities including statutory liabilities in their quoted price (excluding PF and GST). Bidder must also upload the Undertaking in respect of quoted price digitally signed under the "Notes and Attachment" Tab in e-tender portal. A screen shot in this regard is shown below. Offer not complying with above submission procedure will be rejected as per Bid Rejection Criteria. In Bid opening, both Technical & Priced Bids will be opened.

Please go through the "**GENERAL GUIDELINES TO BIDDERS**" and "**VENDOR USER MANUAL (Effective 15.09.19)**" provided in OIL's e-Portal, in detail before uploading the document.

NB: In order to bid for OIL e-tenders all the vendors are required to obtain a legally valid Digital Certificate Class III [Organization] along with Encryption Certificate as per Indian IT Act from the licensed Certifying Authorities (CA) operating under the Root Certifying Authority of India (RCAI), Controller of Certifying Authorities (CCA) of India. Digital Signature Certificate comes in a pair of Signing/verification and Encryption/decryption certificate. Bidder should have both the Signing/verification and Encryption/Decryption certificate for Signing and encryption, decryption purpose respectively. The driver needs to be installed once, without which the DSC will not be recognized. While participating on e-Tendering the DSC token should be connected to your system.

Encryption certificate is mandatorily required for submission of bid. In case bidder created response with one certificate (using encryption key) and bidder change his Digital Signature Certificate then old certificate (used for encryption) is required in order to decrypt his encrypted response for getting the edit mode of the response. Once decryption is done, bidder may use new DSC certificate for uploading and submission of their offer. It is the sole responsibility of the bidder to keep their DSC certificate properly. In case of loss of the certificate, OIL INDIA LTD is not responsible.

32.0 The Integrity Pact is applicable against this tender: OIL shall be entering into an Integrity Pact with the bidders as per format enclosed vide “Part-VI Integrity Pact” of the tender document. This Integrity Pact proforma has been duly signed digitally by OIL’s competent signatory. The proforma has to be returned by the bidder (along with the technical bid) duly signed (digitally) by the same signatory who sign the bid, i.e., who is duly authorized to sign the bid. Any bid not accompanied by Integrity Pact Proforma duly signed (digitally) by the bidder shall be rejected straightway. Uploading the Integrity Pact with digital signature will be construed that all pages of the Integrity Pact has been signed by the bidder’s authorized signatory who sign the Bid.

32.1 In case of a joint venture, all the partners of the joint venture should sign the Integrity Pact.

32.2 In the event of any dispute between the management and the contractor relating to those contracts where Integrity Pact is applicable, in case, both the parties are agreeable, they may try to settle dispute through mediation before the panel of IEMs in a time bound manner. If required, the organizations may adopt any mediation rules for this purpose. In case, the dispute remains unresolved even after mediation by the panel of IEMs, the organization may take further action as per the terms and conditions of the contract.

Note: Bidders may contact the Independent External Monitors for any matter relating to the IP at the following addresses:

Shri Sutanu Behuria, IAS (Retd.), e-Mail ID: sutanu2911@gmail.com, Shri Om Prakash Singh, IPS (Retd.), Former DGP, Uttar Pradesh, e-mail: Ops2020@rediffmail.com and Shri Rudhra Gangadharan, IAS (Retd.), Ex-Secretary, Ministry of Agriculture, e-mail ID: rudhra.gangadharan@gmail.com have been appointed as Independent External Monitors.

33.0 SCREEN SHOT :

Bidders must fill up the **“Total Bid Value”** (under **RFx Information > Basic Data > Total Bid Value**), taking account of all liabilities including statutory liabilities in their quoted price (excluding PF and GST).

- A.** Filling of **“Total Bid Value”** with overall quoted price where Detailed Price Information is “No Price”: Under “RFx Information”> “Basic Data”> “Total Bid Value”

The screenshot shows the 'Create RFx Response' form. At the top, there are tabs: **Submit**, **Read Only**, **Print Preview**, **Check**, **Technical RFx Response**, and **Close**. Below these, the form displays: **RFx Response Number** 60038748, **RFx Number** 1396, **Status** In Process, **RFx Owner** BHARALI, **Total Value** 0.00 INR, and **RFx Response Version Number**. The form has several tabs: **RFx Information** (selected), **Items**, **Notes and Attachments**, and **Conditions**. Under **RFx Information**, there are sub-tabs: **Basic Data** (selected), **Questions**, and **Technical Attachments**. The **Event Parameters** section includes: **Currency:** Indian Rupee (dropdown), **Detailed Price Information:** No Price (dropdown), **Terms of Payment:** (text field with a file icon), and **Total Bid Value:** (text field highlighted with a red box). A blue callout bubble points to the **Total Bid Value** field with the text: **“Total Bid Value” considering all liabilities, taxes & duties except PF & GST**.

Note: Total Bid Value” is mandatory in “No Price” RFx only

On **“EDIT”** Mode, bidders are advised to upload **“Technical Bid”** and **“Priced Bid”** in the respective places as indicated below:

Note:

* The “Technical Bid” shall contain all techno-commercial details **except the prices**.

** The “Priced bid” must contain the price schedule as available in the tender. For uploading Priced Bid, first click on Add Attachment, a browser window will open, select the file from the PC and name the file under Description, Assigned to General Data and click on OK to digitally sign and upload the File. Please click on Save Button of the Response to Save the uploaded files.

B. Uploading of Technical Bid: Technical files to be added under RFX Information >“Technical Attachments”

RFX Response Number: 60037504 RFX Number: TESTARUP Status: In Process Submission Deadline: 15.04.2017 11:00:00 INDIA Opening Date: 15.04.2099 00:00:00 INDIA

RFX Response Version Number: Active Version RFX Version Number: 1

Basic Data Questions **Technical Attachments**

Notes

Clear

Category	Description
Conditions of Participation	-Empty-
Bid Invitation/Auction Text	-Empty-
Bidder's Remarks	-Empty-
Purchaser's Remarks	-Empty-

Attachments

cFolder Attachments

Add Attachment Delete Verify Signature

cFolder Name	Category	Description	File Name	Version	Processor	Ch
The table does not contain any data						

C. Uploading of UNDERTAKING IN RESPECT OF QUOTED PRICE :

RFX Response - Internet Explorer

RFX and Auctions

Edit RFX Response:

Submit Read Only Print Preview Check Technical RFX Response Close Save Delete Verify Signature Sign Response Refresh Smartform System Information Create Memory Snapshot

RFX Response Number: 60032949 RFX Number: SDIO696P17 Status: Saved Submission Deadline: 29.02.2017 11:00:00 INDIA Opening Date: 29.02.2019 11:00:00 INDIA Remaining Time: 4 Days 01:50:00

RFX Owner: BHARALI Total Value: 0.00 INR RFX Response Version Number: Active Version RFX Version Number: 2

RFX Information Items **Notes and Attachments** Conditions Summary Tracking

Notes

Add Clear

Assigned To	Category	Text Preview
The table does not contain any data		

Attachments

Sign Attachment Add Attachment Edit Description Delete Create Qualification Profile

Assigned To	Category	Description	File Name	Version	Processor	Checked Out	Type	Size (KB)	Changed by	Changed on
The table does not contain any data										

D. After Uploading of Proforma-I Click 'Save'

RFX Response - Internet Explorer

RFX and Auctions

Edit RFX Response:

Submit Read Only Print Preview Check Technical RFX Response Close **Save** Delete Verify Signature Sign Response Refresh Smartform System Information Create Memory Snapshot

RFX Response Number: 60032949 RFX Number: SDIO696P17 Status: Saved Submission Deadline: 29.02.2017 11:00:00 INDIA Opening Date: 29.02.2019 11:00:00 INDIA Remaining Time: 4 Days 01:19:48

RFX Owner: BHARALI Total Value: 0.00 INR RFX Response Version Number: Active Version RFX Version Number: 2

RFX Information Items Notes and Attachments Conditions Summary Tracking

Notes

Add Clear

Assigned To	Category	Text Preview
The table does not contain any data		


Attachments

Sign Attachment Add Attachment Edit Description Delete Create Qualification Profile

Assigned To	Category	Description	File Name	Version	Processor	Checked Out	Type	Size (KB)	Changed by	Changed on
Document Header	Standard Attachment	PRICE BID	PRICE BID.xls.sig	1		<input type="checkbox"/>	sig	10	V210445	24.02.2017


Once Saved ,the Data will be Encrypted & the Encryption Certificate will be in use.

E. Click to select the desired Encryption certificate & Encrypt Bid:

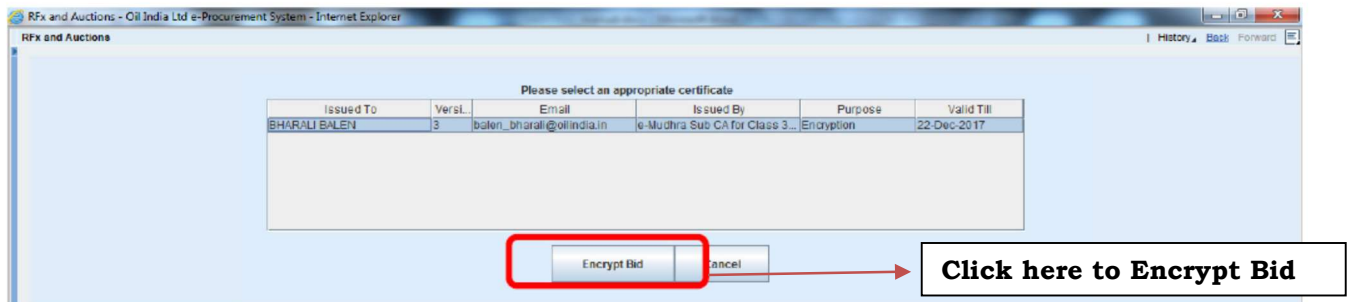


The Encrypted Data will be displayed only when click 'Decrypt data'


F. The Encrypted Data will be displayed only when click 'Decrypt data'

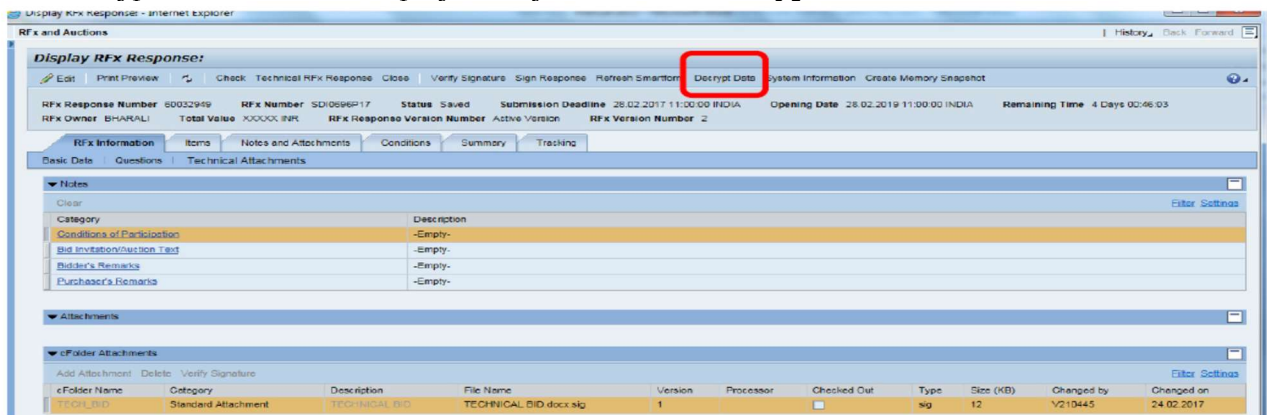

G. Click on 'Close'

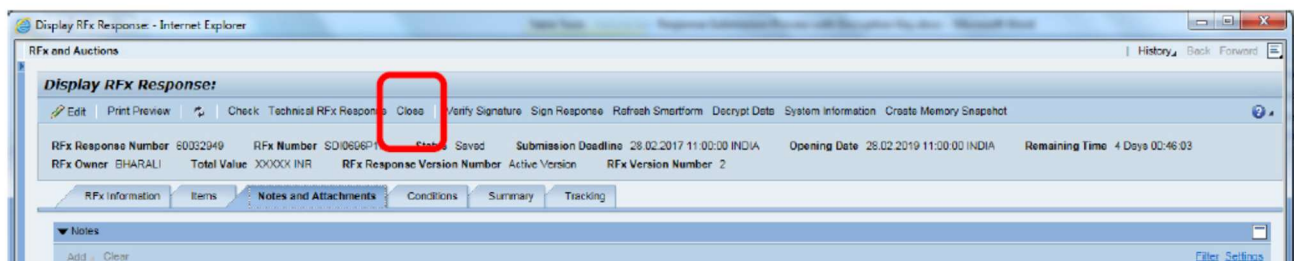


H. Click on 'Refresh'. Then Click on 'Response No.'

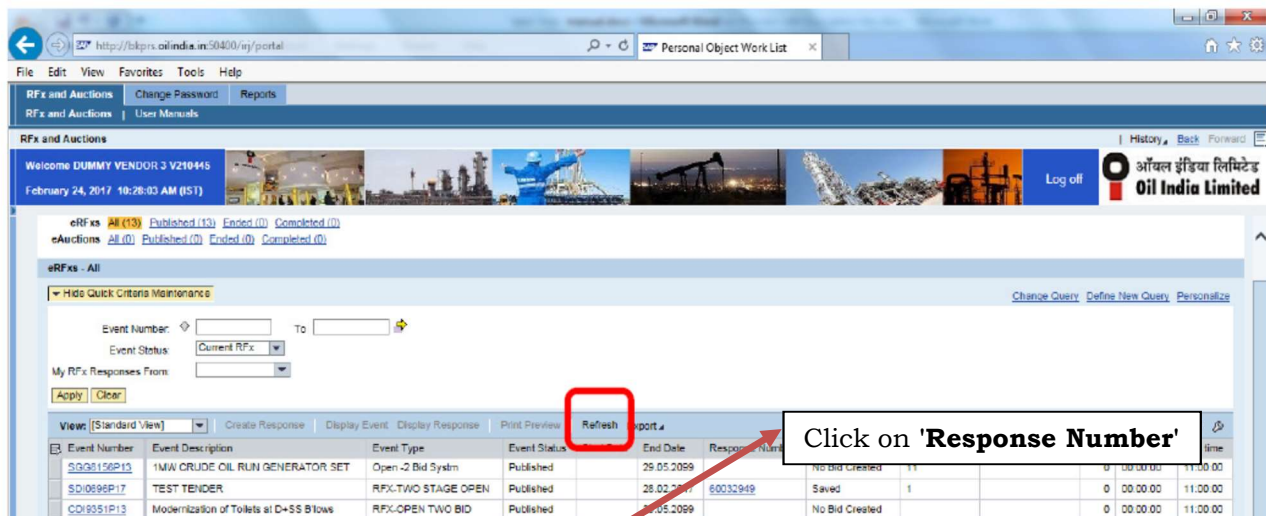


Now Uploading part is complete. Bidders are requested to go to the Initial screen. It is always better to come to the first screen and refresh the page and then going in into the response for the submission process.


- I. On 'Edit' mode Click to select the same Encryption certificate used for De-cryption else data will not Decrypt.

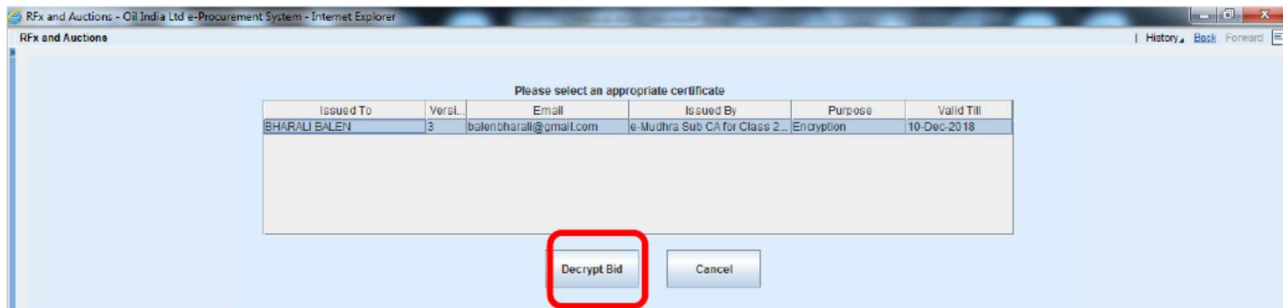

- J. After Entering User pin , Click '**Check**'. Bidder may submit the response in case there is no error.

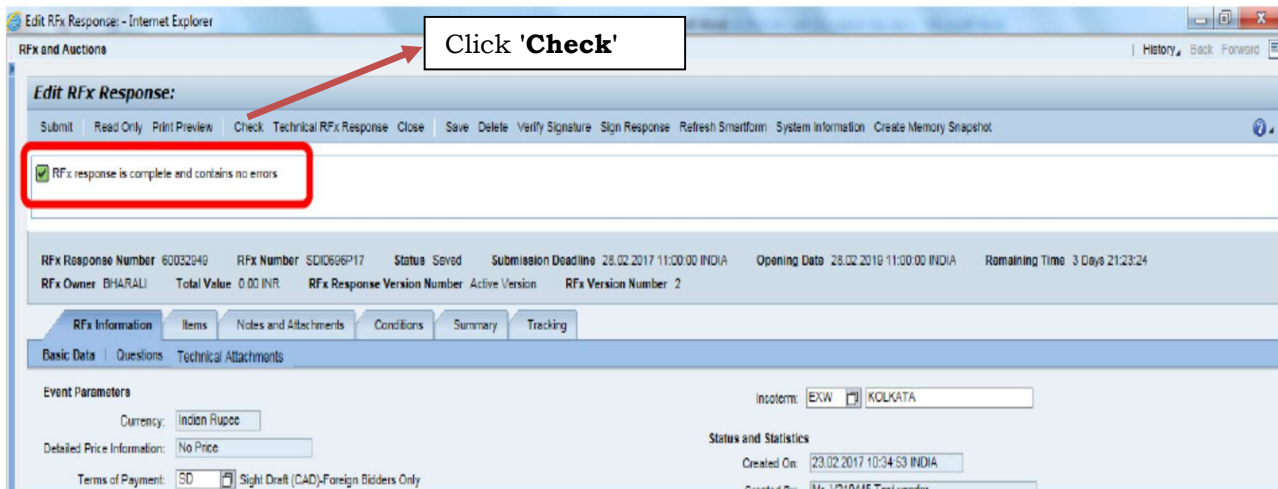


- K. Click on '**Submit**' button

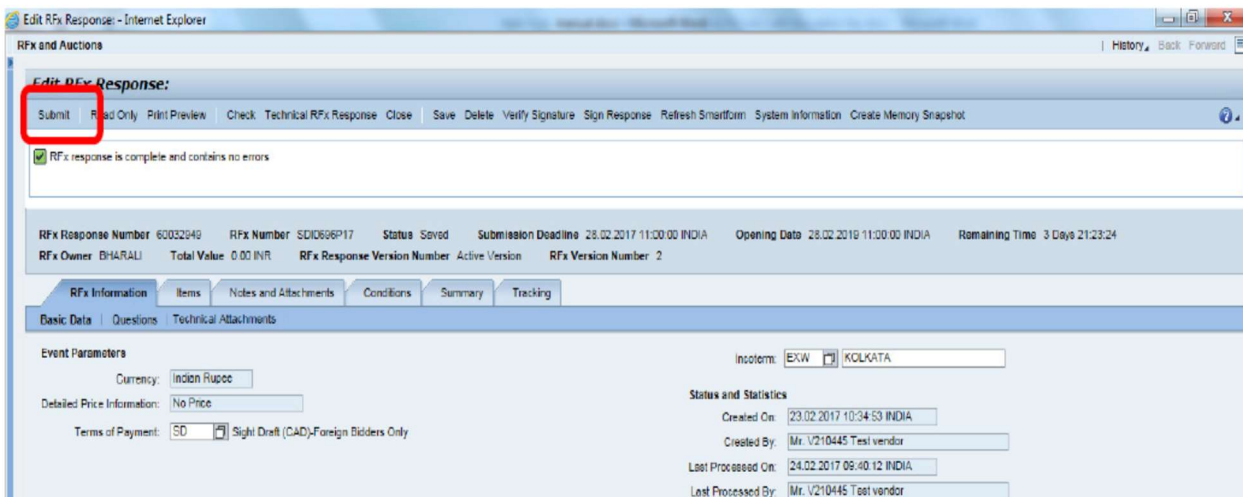


Before submit, Please do check all the documents uploaded and on-line data maintained are correct.


L. After Clicking '**Submit**' below pop up will open. Select Digital Signature & **Sign**.

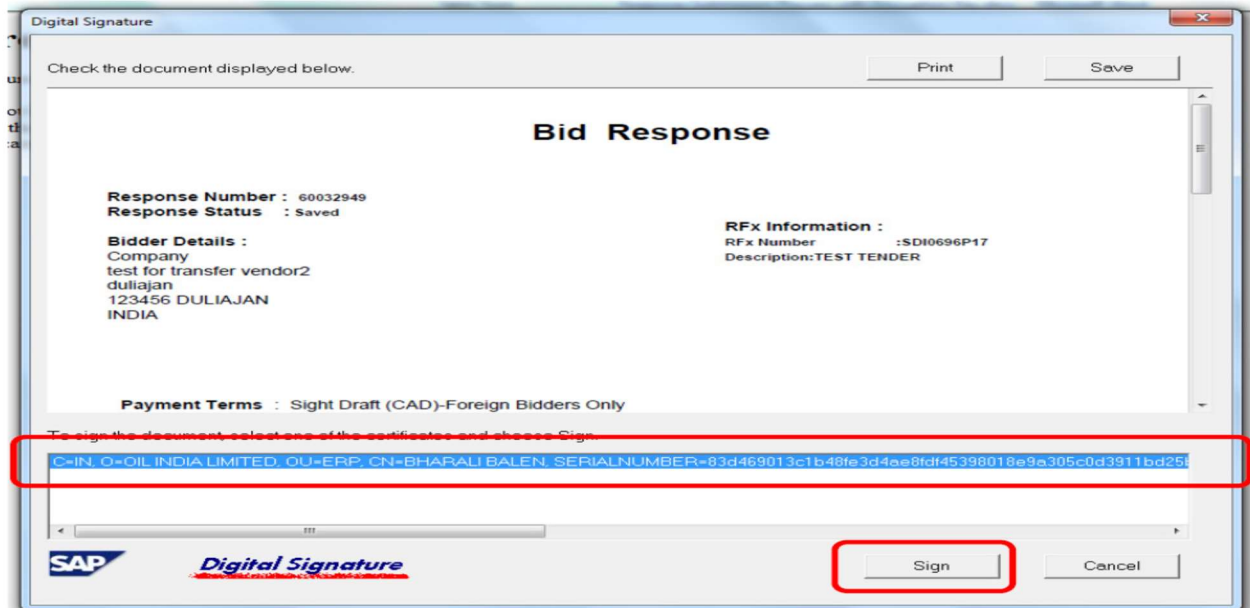

M. After Signing the response has to be encrypted again. Select the encryption certificate and **Encrypt Bid**.

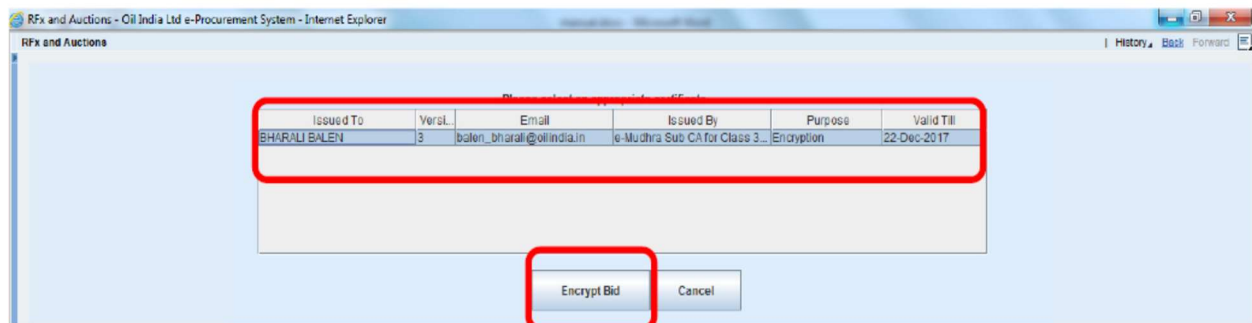

N. Click '**Close**'

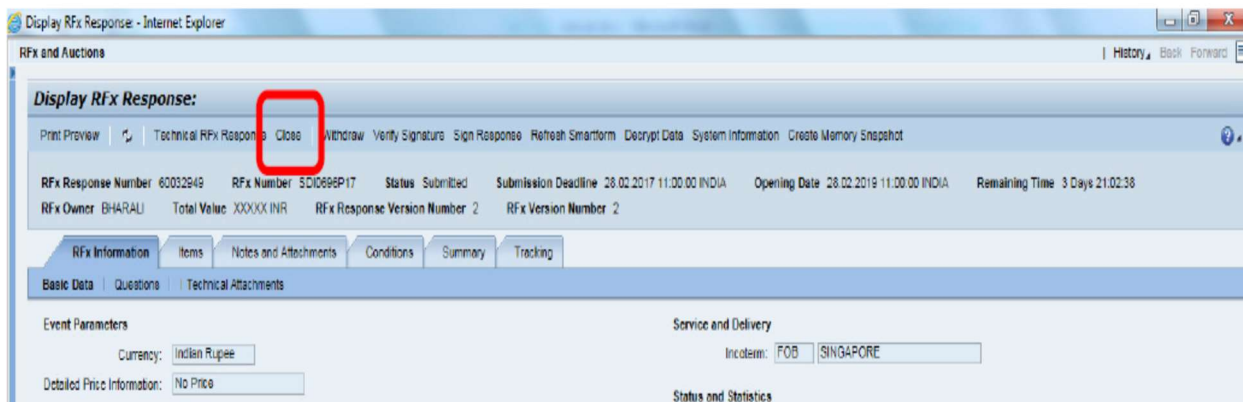

O. Click on **'Refresh'**. The status of Response must be **'Submitted'**

The screenshot shows the Oil India Limited e-tender portal. The 'Refresh' button is highlighted with a red box and an arrow pointing to it with the text 'Click 'Refresh''. Below the filters, there is a table of tender events. The 'Submitted' status in the 'Response Status' column is highlighted with a red box.

Event Number	Event Description	Event Type	Event Status	Start Date	End Date	Response Number	Response Status	Event Version	Response Version	Q&A	Start Time	End time
SGG5156P13	1MW CRUDE OIL RUN GENERATOR SET	Open-2 Bid System	Published	29.05.2017			No Bid Created	11		0	00:00:00	11:00:00
SD0096P17	TEST TENDER	RFX-TWO STAGE OPEN	Published	28.02.2017	28.02.2017	60032549	Submitted	1	2	0	00:00:00	11:00:00
QD00351P13	Modernization of Toilets at D+SS Blows	RFX-OPEN TWO BID	Published	23.05.2017	23.05.2017		No Bid Created			0	00:00:00	11:00:00
QD00352P13	Modernization of Toilet TD + Blows	RFX-OPEN TWO BID	Published	23.05.2017	23.05.2017		No Bid Created			0	00:00:00	11:00:00
QD00377P13	Construction of drilling / OCMMS at Jaisal area	Open-2 Bid System	Published	25.06.2017	25.06.2017		No Bid Created			0	00:00:00	11:00:00

This is the end of **Response submission with Encryption key** process.

34.0 OIL now looks forward for your active participation in the tender.

DGM-Contracts (Civil)
For GM-CONTRACTS (HOD)
For RESIDENT CHIEF EXECUTIVE

BID EVALUATION CRITERIA (BEC)/BID REJECTION CRITERIA (BRC)**(A). BID EVALUATION CRITERIA (BEC):**

1.0 The bid shall conform generally to the specifications and terms and conditions given in the Tender Documents. Bids will be rejected in case services offered do not conform to the required parameters stipulated in the technical specifications. Notwithstanding the general conformity of the bid to the stipulated specifications, the following mandatory requirements will have to be particularly met by the bidders without which the same will be considered as non-responsive and rejected. All the documents related to **BEC** must be submitted along with the Techno-Commercial Bid.

2.0 Interested bidders shall have to submit the following documents to qualify for the tender:

2.1 Work Experience Criteria**I. Civil Works:**

- a) One successfully completed **similar work*** of minimum value of ₹ **1,07,92,000.00** under tender with CPWD, Railways, APWD, MES, NRL, ONGCL, OIL or any other Government Organization / Public Sector Undertaking during the last seven (07) years **reckoned from the original bid closing date**.
- b) For proof of requisite experience of **similar work***, Job Completion Certificate clearly mentioning Gross value of job done, Nature of works, Contracts period/ Contract Start and Completion date issued by CPWD, Railways, APWD, MES, NRL, ONGCL, OIL or any other Government Organization / Public Sector Undertaking must be submitted along with the bid.
- c) **Similar work*** executed by a bidder for its own organization / subsidiary will not be considered as experience for the purpose of meeting BEC.

Notes to Clause no. 2.1 above:

***Definition of similar work: Construction of Multi-storeyed RCC Building**

II. Electrical Works:

- a) The bidder shall have a valid Electrical Contractor's License issued by Electrical Licensing board, Govt. of Assam or shall form a consortium / tie-up / collaboration with an Electrical contractor, having required technical credentials as described in Para b) below and holding valid Electrical Contractor's License issued by Electrical Licensing board, Govt. of Assam for executing the jobs. In support of the above the bidder shall submit a copy of either of the above Electrical Contractor's License.

OR

The bidder or their collaborators / consortium partner having valid Electrical Contractors' License issued by any State Government Electrical Licensing Board of India other than that of Assam must submit a copy of valid Electrical Contractors' License in support of above along with an undertaking stating that on award of contract to them they will submit either a valid Electrical Contractors' License issued by Electrical Licensing Board, Government of Assam in their name or get their Electrical Contractors' License recognized / endorsed by Electrical Licensing Board, Government of Assam for executing the job at Assam within 30 days from date of award of the contract and the same will be subsequently renewed till the completion of the contract.

- b) The bidder or their collaborators / consortium partner must have experience in internal electrification works in Office/ Residential Building of PSU/Central Govt./State Govt./Public Limited Company during the last 7(seven) years reckoned from the original bid closing date in any of the above organizations as listed. The bidder or their collaborators / consortium partner must submit documentary evidences such as Purchase Order copies with invoice/ performance certificate

/completion certificate or any other documents which substantiate successful execution of internal electrification works in Office/ Residential Building along with their bid.

- c) In case of collaboration / consortium / tie-up with any Electrical firm as mentioned above, the bidder must furnish a copy of MoU entered into with the collaborator / consortium partner towards providing the requisite service as per the terms of the contract.

2.2 Financial Criteria

- a) Annual Financial Turnover of the bidder during **any of preceding three financial / accounting years from the original bid closing date** should be at least **₹ 56,12,000.00**.
- b) **Net worth** of bidder must be positive for preceding financial/ accounting year.

Note: The Net worth to be considered against the clause above, should be read in conjunction with the definition of Net worth as mentioned in Section 2 (57) of The Companies Act, 2013.

- c) i) Considering the time required for preparation of Financial Statements, if the last date of preceding financial/accounting year falls within the preceding six months reckoned from the original bid closing date/ within the due date for furnishing of audit report as per Section 139(1) of IT Act, 1961 (read along with latest circulars/notifications issued by CBDT from time to time) and the Financial Statements of the preceding financial/accounting year are not available with the bidder, then the financial turnover of the previous three financial /accounting years excluding the preceding financial/accounting year will be considered. In such cases, the Net worth of the previous financial/accounting year excluding the preceding financial/accounting year will be considered. However, the bidder has to submit an undertaking in support of the same along with their technical bid as per **Annexure-VII**.

ii) In case of non-submission of the Undertaking within the bid closing date and time, bid shall be rejected straightway and no further claim shall be entertained after the bid closing date.

- d) For proof of Annual Turnover & Net worth any one of the following document must be submitted along with the bid:-

- i) A certificate issued by a practicing Chartered/ Cost Accountant (with Membership Number and Firm Registration Number), certifying the Annual turnover & Net worth as per format prescribed in **Annexure-II**.

OR

- ii) Audited Balance Sheet along with Profit & Loss account.

- e) Mention of UDIN (Unique Document Identification Number) is mandatory for all certificates, tax audit reports etc. issued by Chartered Accountant as per the notifications issued by the Institutes of Chartered Accountant of India (ICAI). Certificates, tax audit reports etc. without mentioning of UDIN shall not be considered for evaluation and shall be summarily rejected. No further clarification or request from bidders shall be entertained thereafter in this regard.

- f) In case the bidder is Central Govt. organization/ PSU/ State Govt. organization/ Semi-State Govt. Organization or any other Central/ State Govt. Undertaking, where the auditor is appointed only after the approval of Comptroller and Auditor General of India and the Central Government, their certificates may be accepted even though FRN is not available. However, bidder has to provide documentary evidence for the same.

3.0 Commercial Evaluation Criteria

- a) Bids must be valid for minimum **90 (Ninety) days** from the actual date of Bid closing. If bidder does not submit / declare bid validity period, it will be presumed that the bid validity is **90 (Ninety) days**.
- b) OIL shall be entering into an Integrity Pact with the bidders as per format enclosed vide Part-VI of the tender document. This Integrity Pact proforma has been duly signed digitally by OIL's competent

signatory. The proforma has to be uploaded by the bidder (along with the Un-priced Techno-Commercial Bid).-Uploading the Integrity Pact with digital signature will be construed that all pages of the Integrity Pact have been signed by the bidder's authorized signatory who sign the Bid. Any bid not accompanied by Integrity Pact Proforma duly signed (digitally) by the bidder shall be rejected straightway.

- c) The bidders **must have Encryption Certificate along with Digital Signature Certificate (DSC) of Class 3 [Organization Type]** to upload all the documents. If the **Digital Signature Certificate (DSC)** used for signing is not of "**Class -3**" & Organizational type with Organization's name in the name of the bidder i.e. firm's name, the bid will be rejected.

Note: Only in case of sole proprietorship firms, Digital Signature Certificates issued in the name of the proprietor is also acceptable provided the bid is submitted in the capacity of a proprietorship firm.

d) **Purchase Preference Policy- Linked with Local Content (PP-LC)**

Purchase Preference Policy- Linked with Local Content (PP-LC) as notified vide Letter No. FP-20013/2/2017-FP-PNG dated 17th November, 2020 of MoPNG shall be applicable in this tender.

Only 'Class-I local supplier' shall be eligible to bid against this tender. 'Class-I local supplier' means a supplier or service provider, whose goods, services or works offered for procurement, has local content equal to or more than 50% as defined under this policy. To establish their status as class-I local supplier, it is mandatory for the bidders to give adequate documentation along with the technical bid as follows:

- The bidder shall provide the percentage of local content through an undertaking in their letterhead as per format prescribed in **Annexure-IV** from the authorised signatory of bidder having the power of Attorney along with the bid stating the bidder meets the mandatory minimum LC requirement and such undertaking shall become a part of the contract.

4.0 The bidders must submit documentary evidence for BEC Clauses 2.1 (I. & II.) & 2.2 above. All the documents should be legible.

5.0 Non-submission of the documents as specified in all the paragraphs above will result in rejection of bids.

6.0 Price Evaluation Criteria

- a) While submitting responses against the tender in e-tender portal, bidders must fill up the "Total Bid Value" (under RFx Information > Basic Data > Total Bid Value), taking account of all liabilities including statutory liabilities in their quoted price (excluding PF and GST). The price quoted under the "Total Bid Value" should be within the range of "At Par" to "+10%" of Company's Internal Estimate. Bids with overall quoted price as indicated in the "Total Bid Value" (under RFx Information > Basic Data > Total Bid Value) below "at par" and above "10%" of Company's Internal Estimate will be rejected straightway.
- b) Company shall evaluate the inter-se-ranking of the bidders and conduct Draw of Lots amongst the eligible bidders in case of identical bidding, strictly as per the overall quoted price under the "Total Bid Value" (under RFx Information > Basic Data > Total Bid Value) and awarding of contract shall be done accordingly.
- c) It is the responsibility of the bidder to fill up the "Total Bid Value" (under RFx Information > Basic Data > Total Bid Value) correctly as per the instructions given herein. OIL INDIA LTD accepts no liability of any nature resulting from any calculation error or omissions while filling up the "Total Bid Value" (under RFx Information > Basic Data > Total Bid Value) by the bidders and no claim whatsoever shall be entertained thereof.

Note: The Company's Internal Estimated Rates, as indicated in Part-II, are inclusive of all overheads, taxes, duties, levies etc. except P.F. & GST.

7.0 The bids conforming to the specifications, terms and conditions stipulated in the tender documents and considered to be responsive will be evaluated as per the procedure mentioned below:

- a) Bid will be opened on schedule date & time as specified in the NIT and all the bids where the bidders have quoted the lowest price (within the permissible percentage as per NIT) under the **“Total Bid Value” tab** in e-tender portal will be selected for conducting Draw of Lots (DoL). DoL will be conducted within a short period after Bid Closing Date. In the DoL, 7 (seven) numbers of bidders will be selected first, in the order of B-1 (Bidder-1), B-2 B-3, B-4, B-5, B-6 and B-7. The technical and commercial scrutiny will be carried out for these seven bidders only. If the bid of bidder B-1 is found to be technically and commercially qualified, B-1 will be the successful bidder (Priority-1 bidder) and the contract will be awarded to B-1. If B-1 is not found to be technically & commercially qualified but B-2 is technically and commercially qualified, B-2 will be awarded the contract, ---- and so on; i.e. whoever becomes the first technically qualified bidder in the order of B-1 →B-2→B-3→ B-4→ B-5→ B-6→ B-7, will be the successful bidder (P-1). In this way, P-1 (Priority-1) and P-2 bidders will be selected. The contract will be awarded to the P-1 bidder only. However, in case the bidder P-1 is not able to carry out the job due to any reason, P-2 may be awarded the job, if the same is approved by Company's competent authority. In case, none of these seven bidders are found to be techno-commercially acceptable, the draw of Lot will be again conducted to select 7 more bidders as B-8 to B-14 and similar steps will be followed thereon as explained above. The system of conducting further draw of lots will be followed till a technically acceptable bidder is selected.
- b) Bidder should note that deficit documents will not be sought from the bidders. The bids will be evaluated as per the documents received from the bidders at the time of bid opening. Any bid, which is not supported with the requisite documents as per the NIT, will be rejected straightway without seeking any further clarification and deficit document.

(B). BID REJECTION CRITERIA (BRC):

1. The bids are to be submitted in single stage under composite bid system i.e. Un-priced Techno-Commercial Bid and Price Bid together. The overall price should be quoted under the “Total Bid Value” tab in the e-tender portal taking into account all liabilities including statutory liabilities in their quoted price (excluding PF and GST). The bidder must also upload the PROFORMA-I digitally signed without any input/ alteration from their end in the PROFORMA-I under the “Notes and Attachments” tab.
2. Bid Documents / User Id & Password for OIL's E-Tender portal are not transferable.
3. Any bid received in the form of Physical document/ Telex/Cable/Fax/E-mail will not be accepted.
4. Bidders must quote their total price under the “Total Bid Value” (under RFx Information > Basic Data > Total Bid Value) tab within the permissible limit ('at par' to above 10% of Company's Internal Estimate); otherwise the bid will be rejected straightway. If a bidder wants to quote at 'at par' with the Company's Internal Estimate, he must declare the “Total Bid Value” equal to the Internal Estimate mentioned in the Covering Letter. If a bidder wants to quote above the Internal Estimate by certain percentage, he must declare the “Total Bid Value” equal to the sum of Internal Estimate and the desired percentage of Internal Estimate. If any bidder has quoted the total price above “at par” with Company's Internal Estimate within the permissible range, the percentage quoted above the internal estimate will be calculated and will be loaded accordingly in the rates of each and every items as specified in SOQ.
5. All other techno-commercial documents other than price details to be submitted with Un-priced Techno-Commercial Bid as per tender requirement in the c-Folder link (collaboration link) under “Technical RFx Response” Tab Page only.
6. Bidders must accept and comply with the following provisions as given in the tender document. Deviations to such provisions shall make the bid liable for rejection.
 - a. Firm price
 - b. Scope of work
 - c. Specifications

- d. Price schedule
- e. Delivery / completion schedule
- f. Period of validity of bid
- g. Liquidated Damages
- h. Guarantee of material / work
- i. Arbitration / Resolution of Dispute
- j. Force Majeure
- k. Applicable Laws
- l. Integrity Pact

(C). GENERAL:

- a) Submission of Forged Documents: Bidders should note that Company may verify authenticity of all the documents /certificates / information submitted by the bidder(s) against the tender. In case at any stage of tendering process or Contract execution etc., if it is established that bidder has submitted forged documents / certificates / information towards fulfilment of any of the tender / contract conditions, Company shall immediately reject the bid of such bidder(s) or cancel / terminate the contract and forfeit EMD / SD submitted by the bidder(s), besides taking action as per OIL's Banning Policy dated 6th January 2017, available in the OIL's website.
- b) In case bidder takes exception to any clause of bidding document not covered under BEC/BRC, then the Company has the discretion to load or reject the offer on account of such exception if the bidder does not withdraw / modify the deviation when / as advised by company. The loading so done by the Company will be final and binding on the bidders. No deviation will however be accepted in the clauses covered under BRC.
- c) To ascertain the substantial responsiveness of the bid the Company reserves the right to ask the bidder for clarification in respect of clauses covered under BEC/BRC also and such clarifications fulfilling the BEC/BRC clauses in toto must be received on or before the deadline given by the company, failing which the offer will be evaluated based on the submission. However, mere submission of such clarification shall not make the offer responsive, unless Company is satisfied with the substantial responsiveness of the offer.
- d) Bidder(s) must note that requisite information/financial values etc. as required in the BEC/BRC & Tender are clearly understandable from the supporting documents submitted by the Bidder(s); otherwise Bids shall be rejected.
- e) OIL will not be responsible for delay, loss or non-receipt of applications for participating in the bid sent by mail and will not entertain any correspondence in this regard.
- f) If any of the clauses in the BEC/BRC contradicts with any of the clauses of the tender document/disclaimer/guideline/user manual/report or any other field displayed in the e-tender portal, the clauses in the BEC/BRC shall prevail.

WORKS CONTRACT

DESCRIPTION OF WORK/SERVICES: Construction of Double Storied Sangini Building with electrifications including supply of all materials except cement at Duliajan.

GENERAL CONDITIONS OF CONTRACT (GCC)

MEMORANDUM OF AGREEMENT made this _____ day of _____ between OIL INDIA LIMITED a Company incorporated under the Companies Act 1956 and having its Registered Office at Duliajan in the District of Dibrugarh, Assam (hereinafter called Company) of the one part and Shri/Smti _____ and Shri/Smti _____ carrying on business as partners /proprietor under the firm name and style of M/s. _____ with the main Office at _____ in the District of _____ aforesaid (hereinafter called 'Contractor') on the other part.

WITNESSETH:

1. a) The contractor hereby agrees to carry out the work set down in the Schedule of work which forms Part-II of this Contract in accordance with the 1968 General Conditions of Contract of Oil India Limited and General Specifications read in conjunction with any drawings and Particular Specifications & instructions which forms Part-III of the contract utilizing any materials/services as offered by the Company as per Part-IV of the contract at location _____ .

b) In this Contract all words and expressions shall have the same meaning as are respectively assigned to them in the 1968 General Conditions of Contract of Oil India Limited which the Contractor has perused and is fully conversant with before entering into this Contract.

c) The clauses of this contract and of the specifications set out hereunder shall be paramount and in the event of anything herein contained being inconsistent with any term or terms of the 1968 General Conditions of Contract of Oil India Limited, the said term or terms of the 1968 General conditions of Contract to the extent of such inconsistency, and no further, shall not be binding on the parties hereto.
2. i) The contractor shall provide all labour, supervision and transport and such specified materials described in Part-II of the Contract including tools and plants as necessary for the work and shall be responsible for all royalties and other levies and his rates shall include for these. The work executed and materials supplied shall be to the satisfaction of the Company's Engineer and Contractor's rates shall include for all incidental and contingent work which although not specifically mentioned in this contract are necessary for its completion in a sound and workman like manner.
ii) Contractor shall have to produce necessary cash memos towards forest produce used against the contract to HOD (Civil) used against this contract from the authorities prior to processing of final payment. In absence of cash memos, the final bill shall not be processed.
3. The Company's Engineer shall have power to:
 - a) Reduce the rates at which payments shall be made if the quality of work although acceptable is not up to the required standard set forth in the OIL Standard Specifications which have been perused and fully understood by the Contractor.
 - b) Order the Contractor to remove any inferior material from the site and to demolish or rectify any work of inferior workmanship, failing which the Company's Engineer may arrange for any such work to be demolished or rectified by any other means at the Contractor's expenses.
 - c) Order the Contractor to remove or replace any workman/ supervisor/ engineer/ project-in-charge or any other contractor's personnel who he (The Engineer) considers incompetent or unsuitable; the Engineer's opinion as to the competence and suitability of any personnel engaged by the Contractor shall be final and binding on the Contractor.
 - d) Issue to the Contractor from time to time during the progress of the work such further drawings and instructions as shall be necessary for the purpose of proper and adequate execution and maintenance of the works and the Contractor shall carry out and be bound by the same.

e) Order deviations in Part II and III of this Contract. All such deviation orders shall be in writing and shall show the financial effect, if any, of such deviation and whether any extra time is to be allowed. The rates to be applied for such Deviation Order shall be the same for those appearing in Company's Schedule of Rate in force on the date of issue of such Deviation Order, to which the contractor has no objection.

4. The Contractor shall have no claim against the Company in respect of any work which may be withdrawn but only for work actually completed under this contract. The contractor shall have no objection to carry out work in excess of the quantities and items stipulated in Part-II (SOQ). In case of positive variation in quantities of any items from the quantity mentioned in the tender / contract, the contractor will have to carry out the positive varied quantity at the contract rate, or the internally estimated rate, whichever is lower.

However, during the actual execution of the contract, if the contract is to be utilised in a different zone due to Company's operational requirement, and accordingly if the rates of the contractual items are different as in OIL's Schedule of Rates (SOR), then the rates as per the actual zone of execution will be applicable for the contractual items and shall be adopted from the same OIL's SOR which has been adopted in the tender. In that case, the rates shall be applicable for both the contractual quantities as well as for the additional quantities, if required to be executed.

If any additional items (items not covered in the tender / contract) are required to be executed during actual execution of works, the payment of such items shall be made as per the rates of OIL Schedule of Rates (SOR) prevailing in the working zone (the zone where the contract is utilized) at the time of issuance of advice by Company to execute such additional items.

5. The Company reserves the right to cancel this Contract at any time upon full payment of work done and the value of the materials collected by the contractor for permanent incorporation in the work under this contract particularly for execution of this contract up to the date of cancellation of the Contract. The valuation of the work done and the materials collected shall be estimated by the company's Engineer in presence of the contractor. The Contractor shall have no claim to any further payment whatsoever. The valuation would be carried out exparte if Contractor fails to turn up despite reasonable notice which will be binding on the Contractor.

6. The Contractor hereby undertakes to indemnify the Company against all claims which may arise under the under noted Acts:-

- I. The Mines Act.
- II. The Minimum Wages Act, 1948.
- III. The Workman's Compensation Act, 1923.
- IV. The Payment of wages Act, 1963.
- V. The Payment of Bonus Act, 1965.
- VI. The Contract Labour (Regulation & Abolition) Act, 1970 and the rules framed there under.
- VII. Employees' Pension Scheme, 1995.
- VIII. Inter-State Migrant (Regulation of Employment and Condition of Service) Act. 1979.
- IX. The Employees Provident Fund and Miscellaneous Provisions Act, 1952.
- X. Goods and Service Tax (GST) Law,

or any other Acts or Statute not here in above specifically mentioned having bearing over engagement of workers directly or indirectly for execution of work. The Contractor shall not make the Company liable to reimburse the Contractor for the statutory increase in the wage rates of the Contract Labour appointed by the Contractor. Such Statutory increase in the wage rates of Contract Labour shall be borne by the contractor.

7. The Contractor shall clear away all rubbish and surplus material from the site on completion of work and shall leave the site clean and tidy.

8. The Contractor must complete the work within 60 weeks of the written order to commence work. During the currency of the job, the work progress must be commensurate with the time elapsed. In the event of any delay on the contractor's part, he/she will be liable to pay to the company liquidated damages at the rate of 1/2% (Half percent) per week of the contract price of the item(s) delayed in completion and the maximum value of the liquidated damage will be 7.5% of the contract price of the item(s) delayed provided the item(s) delayed are not critical for commissioning and final utilization of the work. If, however, the item(s) delayed in completion are critical for commissioning and final utilisation of the work then the contractor will be liable to pay liquidated damages by way of

penalty at the rate of 1/2% (Half percent) per week of delay of the total contract cost subject to a maximum of 7.5% of total contract cost.

The HOD-Civil's certificate as to the criticality or otherwise of an item shall be final.

The payment of liquidated damages/penalty may be reduced or waived at the sole discretion of the Company whose decision in this regard will be final.

In the event of there being undue delay in execution of the Contract, the Company reserves the right to cancel the Contract and / or levy such additional damages as it deems fit based on the actual loss suffered by the company attributable to such delay. The company's decision in this regard shall be final.

9. In order to promote, safeguard and facilitate the general operational economic in the interest of the Company during the continuance of this contract the Contractor hereby agrees and undertakes not to take any direct or indirect interest and or support, assist, maintain or help any person or persons engaged in antisocial activities, demonstration, riots, or in any agitation prejudicial to the Company's interest and any such even taking shape or form at any place of the Company's works or and its neighbourhood.

10. The tendered all-inclusive Price (i.e. the Contract price) is ₹ _____ **(Not to be filled up by bidder while submitting the offer in c-Folder. This figure will be filled up by OIL at the time of award of the contract to the successful bidder.)** (₹ _____ only) but the Company shall pay the Contractor only for actual work done at the all inclusive rates set down in the Schedule of work part II of this Contract.

On account payment may be made, not oftener than monthly, up to the amount of 97% of the value of work done. Final payment will be made only after satisfactory completion of the work. Such final payment shall be based on the work actually done allowing for deviations and any deductions and the measurement shall be checked and certified correct by the Company's Engineer before any such final payment is made.

11. The contractor employing 20 (twenty) or more workmen on any day preceding 12 months shall be required to obtain requisite licence at his cost from the appropriate Licensing Officer before undertaking any Contract work. The Contractor shall also observe the rules & regulations framed under the Contract Labour (Regulation & Abolition) Act.

12. Wages shall be paid by the Contractor to the workmen directly without any intervention of any Jamadars or Thekadars and that the Contractor shall ensure that no amount by way of commission or otherwise be deducted/ recovered by the Jamadar from the wages of the workmen.

13. The Company for any reason whatsoever and of which the company shall be sole judge may terminate this Contract with a 24 hours notice in writing to the Contractor and in the event of Company's so doing the clause 5 here of shall prevail and the accounts between the parties will be in accordance therewith finalised.

14. The Contractor will not be allowed to construct any structure (for storage / housing purpose) with thatch, bamboo or any other inflammable materials within any company's fenced area.

15. The Contractor shall ensure that all men engaged by him/her are provided with appropriate protective clothing and safety wear in accordance with the Oil Mines Regulations 2017. The Company's representative shall not allow/accept those men who are not provided with the same.

16. All Statutory taxes levied by the Central and State Government or any other competent authority from time to time, except PF & GST, will be borne by Contractor and the contract cost is inclusive of all tax liabilities except PF & GST. However, any subsequent increase in such statutory taxes after bid opening day will be borne by the Company. Similarly if there is any decrease in such statutory taxes after bid opening, the Company shall recover the decreased amount of such taxes from the contractor.

17. The Contractor shall deploy local persons in all works.

18. The Contractor shall not engage minor labour below 18(eighteen) years of age under any circumstances.

19. The Contractor and his/her workmen shall strictly observe the rules and regulations as per Mines Act (Latest editions).

20. SPECIAL CONDITIONS:

a) The Contractor shall obtain and submit the Labour Clearance Advice (LCA) / Labour Clearance Certificate (LCC) within 14 days of signing the contract agreement. If the contractor fails to submit the LCA / LCC within 14 days of signing the contract agreement, the period of delay in submission of LCA / LCC shall be deducted from the contractual period while issuing the work order. In such cases, the time period mentioned in Clause No. 8 of GCC (Part-I of this contract) shall not be applicable and the contractor must complete the work within the reduced time period allotted to the contractor as per the work order issued.

However, if submission of LCA / LCC is delayed, under some exceptional circumstances, for any reason not attributable to the contractor, the same should be recorded by the contractor with documentary proof. In such cases, the decision as to whether the reason of delay is attributable to the contractor or not shall be taken by the Head of Civil Engineering Department and the work order will be issued accordingly.

b) Retention Money @ 3 % will be kept as Performance Security Deposit against the contract and will be deducted from the running bill. The amount of retention money shall be released after 6(six) months from the actual date of completion of the work. A part or whole of retention money shall be used by the Company in realisation of liquidated damage or claims, if any, or for adjustment of compensation or loss due to the Company for any reason. The retention money shall not earn any interest.

c) The contractor will be required to allow OIL Officials to inspect the work site and documents in respect of the workers' payment.

d) Contractor(s) whosoever is liable to be covered under the P.F. Act must ensure strict compliance of provisions of the Employees Provident Fund and Miscellaneous Provisions Act, 1952 in addition to the various Acts mentioned elsewhere in this contract. Any contractor found violating these provisions will render themselves disqualified from any future tendering. As per terms of the contract, if applicable, the Contractor must deposit Provident Fund Contribution (covering Employee's & employer's share) with the competent authority monthly under their direct code. 12% P.F. will be applicable on the wage component of the contract cost. Wage component of the Contract cost is 17.18 %.

Contract Cost excluding PF: The P.F deposited by the Contractor, will be reimbursed on production of documentary evidence of depositing the same to the authority concerned.

Contract Cost including PF: The Contractor shall be required to submit documentary evidence of deposit of P.F. Contribution to the Company. In case of failure to provide such documentary evidence, the Company reserves the right to withhold the amount equivalent to P.F. Contribution on wage component.

e) All safety precautions to be maintained by the Contractor at his own cost as per safety rules and regulations.

f) The Contractor shall use pump if needed for dewatering of pit while excavation for which no extra payment will be made.

g) The Contractor shall have to work during rainy seasons also.

h) Watch and ward, loss or damage to Company's property, theft and other incidental charges shall be Contractor's responsibility.

i) Efficient workmen to be engaged by the Contractor.

j) The Contractor's representative should report to Engineer-in-charge on all working days at 7.00 A.M. and 3.00 P.M. for instructions.

- k) Materials if rejected should be removed from site within 48 (forty- eight) hours of rejection, failing which the Company reserves the right to get the rejected materials removed at the risk and cost of the Contractor.
- l) The Company reserves the right to get the part or whole work complete at the risk and cost of the Contractor if he fails to complete the work within the stipulated time without any valid reason. The Company's decision shall be final and binding on the Contractor.
- m) Water that may accumulate on the site during progress of the works or in trenches and excavations from other than accepted risks shall be removed from the site to entire satisfaction of the Engineer-in-charge and at the Contractor's expense.
- n) The Contractor shall be in a position to execute 2(two) locations simultaneously.
- o) If required, the Contractor shall have to work in two shifts for which no extra payment will be admissible to him/them.
- p) If needed water and electricity will have to be arranged by the Contractor at his own cost.
- q) The Contractor and his workmen are to strictly observe the safety precautionary rules as per Mines Act (Latest edition) while executing the work.
- r) The Contractor shall have to provide temporary latrine facilities in the entire work site for use of their workmen during progress of work.
- s) The contractor himself (the signatory of the contract) must visit the site at least twice in a week as fixed for taking necessary instruction from the Engineer-in charge.
- t) The program of works to be submitted in the form of Bar Chart within 3 days of receipt of work order.

21. SPECIAL INSTRUCTION

The contractor must quote considering the prevailing minimum Labour wage rate for each day of work.

22. GOODS AND SERVICES TAX (GST) CLAUSES UNDER GCC**22.1 GENERAL REMARKS ON TAXES & DUTIES:**

In view of **GST** Implementation from 1st July 2017, all taxes and duties including Excise Duty, CST/VAT, Service tax, Entry Tax and other indirect taxes and duties have been submerged in **GST**. Accordingly reference of Excise Duty, Service Tax, VAT, Sales Tax, Entry Tax or any other form of indirect tax except of **GST** mentioned in the bidding document shall be ignored.

22.2 Bidders are required to submit copy of the GST Registration Certificate while submitting the bids wherever **GST** (CGST & SGST/UTGST or IGST) is applicable.

22.3 “**GST**” shall mean Goods and Services Tax charged on the supply of material(s) and services. The term “**GST**” shall be construed to include the Integrated Goods and Services Tax (hereinafter referred to as “IGST”) or Central Goods and Services Tax (hereinafter referred to as “CGST”) or State Goods and Services Tax (hereinafter referred to as “SGST”) or Union Territory Goods and Services Tax (hereinafter referred to as “UTGST”) depending upon the import / interstate or intrastate supplies, as the case may be. It shall also mean GST compensation Cess, if applicable.

22.4 Quoted price/rate(s) should be inclusive of all taxes and duties, except **GST (i.e. IGST or CGST and SGST/UTGST applicable in case of interstate supply or intra state supply respectively and cess on GST if applicable) on the final service**. Please note that the responsibility of payment of GST (CGST & SGST or IGST or UTGST) lies with the Supplier of Goods /Services (Service Provider) only. Supplier of Goods / Services (Service Provider) providing taxable service shall issue an Invoice/ Bill, as the case may be as per rules/ regulation of **GST**. Further, returns and details required to be filed under GST laws & rules should be timely filed by Supplier of Goods / Services (Service Provider) with requisite details.

22.5 Where OIL is entitled to avail the input tax credit of GST:

OIL will reimburse the **GST** to the Supplier of Goods / Services (Service Provider) at actuals against submission of Invoices as per format specified in rules/ regulation of GST to enable OIL to claim input tax credit of **GST** paid. In case of any variation in the executed quantities, the amount on which the **GST** is applicable shall be modified in same proportion. Returns and details required to be filed under GST laws & rules should be timely filed by supplier with requisite details.

22.6 Where OIL is not entitled to avail/take the full input tax credit of GST:

OIL will reimburse **GST** to the Supplier of Goods / Services (Service Provider) at actuals against submission of Invoices as per format specified in rules/ regulation of **GST**.

22.7 Payments to Service Provider for claiming **GST** amount will be made provided the above formalities are fulfilled. Further, OIL may seek copies of challan and certificate from Chartered Accountant for deposit of **GST** collected from OIL.

22.8 Contractor/vendor shall be required to issue tax invoice in accordance with GST Act and/or Rules so that input credit can be availed by OIL. In the event that the contractor / vendor fails to provide the invoice in the form and manner prescribed under the GST Act read with GST Invoicing Rules thereunder, OIL shall not be liable to make any payment on account of **GST** against such invoice.

22.9 **GST** shall be paid against receipt of tax invoice and proof of payment of **GST** to government. In case of non-receipt of tax invoice or non-payment of **GST** by the contractor/vendor, OIL shall withhold the payment of **GST**.

22.10 **GST** payable under reverse charge mechanism for specified services or goods under GST act or rules, if any, shall not be paid to the contractor/vendor but will be directly deposited to the government by OIL.

22.11 Where OIL has the obligation to discharge **GST** liability under reverse charge mechanism and OIL has paid or is /liable to pay **GST** to the Government on which interest or penalties becomes payable as per GST laws for any reason which is not attributable to OIL or ITC with respect to such payments is not available to OIL for any reason which is not attributable to OIL, then OIL shall be entitled to deduct/ setoff / recover such amounts against any amounts paid or payable by OIL to Contractor / Supplier.

22.12 Notwithstanding anything contained anywhere in the Agreement, in the event that the input tax credit of the **GST** charged by the Contractor / Vendor is denied by the tax authorities to OIL for reasons attributable to Contractor / Vendor, OIL shall be entitled to recover such amount from the Contractor / Vendor by way of adjustment from the next invoice. In addition to the amount of **GST**, OIL shall also be entitled to recover interest at the rate prescribed under GST Act and penalty, in case any penalty is imposed by the tax authorities on OIL.

22.13 TDS under GST, if applicable, shall be deducted from contractor's/vendor's bill at applicable rate and a certificate as per rules for tax so deducted shall be provided to the contractor/vendor.

22.14 The Contractor will be under obligation for charging correct rate of tax as prescribed under the respective tax laws. Further the Contractor shall avail and pass on benefits of all exemptions/concessions available under tax laws. Any error of interpretation of applicability of taxes/ duties by the contractor shall be to contractor's account.

22.15 Further, it is the responsibility of the bidders to make all possible efforts to make their accounting / IT system GST compliant in order to ensure availability of Input Tax Credit (ITC) to Oil India Ltd.

22.16 Beyond the contract period, in case OIL is not entitled for input tax credit of **GST**, then any increase in the rate of **GST** beyond the contractual delivery period (in case the delay is attributable to the service provider), shall be to Service provider's account whereas any decrease in the rate of **GST** shall be passed on to the OIL.

Beyond the contract period, in case OIL is entitled for input tax credit of **GST**, then statutory variation in applicable **GST** on supply and on incidental services, shall be to OIL's account.

Claim for payment of **GST**/ Statutory variation, should be raised within two [02] months from the date of issue of 'Government Notification' for payment of differential (in %) **GST**, otherwise claim in respect of above shall not be entertained for payment of arrears.

22.17 The contractor will be liable to ensure to have registered with the respective tax authorities, wherever applicable, and to submit self-attested copy of such registration certificate(s) and the Contractor will be responsible for procurement of material in its own registration (GSTIN) and also to issue its own Road Permit/ E-way Bill, if applicable etc.

22.18 Documentation requirement for GST

The vendor will be under the obligation for invoicing correct tax rate of tax/duties as prescribed under the GST law to OIL, and pass on the benefits, if any, after availing input tax credit.

Any invoice issued shall contain the following particulars

- a) Name, address and GSTIN of the supplier;
- b) Serial number of the invoice;
- c) Date of issue;
- d) Name, address and GSTIN or UIN, if registered of the recipient;
- e) Name and address of the recipient and the address of the delivery, along with the State and its code,
- f) HSN code of goods or Accounting Code of services[SAC];
- g) Description of goods or services;
- h) Quantity in case of goods and unit or Unique Quantity Code thereof;
- i) Total value of supply of goods or services or both;
- j) Taxable value of supply of goods or services or both taking into discount or abatement if any;
- k) Rate of tax (IGST,CGST, SGST/ UTGST, cess);
- l) Amount of tax charged in respect of taxable goods or services (IGST,CGST, SGST/UTGST, cess);
- m) Place of supply along with the name of State, in case of supply in the course of interstate trade or commerce;
- n) Address of the delivery where the same is different from the place of supply and
- o) Signature or digital signature of the supplier or his authorised representative.

GST invoice shall be prepared in triplicate, in case of supply of goods, in the following manner

- i. The original copy being marked as ORIGINAL FOR RECIPIENT;
- ii. The duplicate copy being marked as DUPLICATE FOR TRANSPORTER and
- iii. The triplicate copy being marked as TRIPLICATE FOR SUPPLIER.

22.19 ANTI-PROFITEERING CLAUSE

In case the GST rating of vendor on the GST portal / Govt. official website is negative / black listed, then the bids may be rejected by OIL. Further, in case rating of bidder is negative / black listed after award of work for supply of goods / services, then OIL shall not be obligated or liable to pay or reimburse GST to such vendor and shall also be entitled to deduct / recover such GST along with all penalties / interest, if any, incurred by OIL.

22.20 OIL will prefer to deal with registered bidder under GST. Therefore, bidders are requested to get themselves registered under GST, if not registered yet.

23. ARBITRATION:

Any dispute under this contract will be settled through Arbitration as per Indian Arbitration and Conciliation Act, 1996.

Place of Arbitration: Duliajan, Dibrugarh, Assam.

24. FORCE MAJEURE:

In the event of either party being rendered unable by 'Force Majeure' to perform any obligation required to be performed by them under the contract, the relative obligation of the party affected by such 'Force Majeure' will stand suspended as provided herein. The term force majeure as employed herein shall mean Acts of God such as earthquake, hurricane, typhoon, flood, volcanic activity etc.; war (declared / undeclared); riot, revolts, rebellion, terrorism, sabotage by persons other than the

CONTRACTOR's Personnel; fires, explosions, ionising radiation or contamination by radio-activity or noxious gas, if not caused by CONTRACTOR's fault; declared epidemic or disaster; acts and regulations of respective Govt. of the two parties, namely the COMPANY and the CONTRACTOR and civil commotions, lockout not attributable to the CONTRACTOR.

Upon occurrence of such cause, the party claiming that it has been rendered unable as aforesaid thereby, shall notify the other party in writing within 72 (Seventy Two) hours of the alleged beginning and ending thereof, giving full particulars and satisfactory evidence in support of its claim.

Should 'force majeure' condition as stated above occurs and should the same be notified within 72 (Seventy two) hours after its occurrence the 'force majeure' rate (if specified in the SCC of the Contract) shall apply for the first 15 (fifteen) days for each such occasion.

Either party shall have the right to terminate the Contract if such 'force majeure' conditions continue beyond successive 60 (Sixty) days [or exclusively mentioned in the SCC of the Contract] with prior written notice of 15 days, provided termination of the Contract does not result into safety hazard to the life and property on account of withdrawal of operations or the operation is at critical stage. COMPANY shall have the absolute right to decide whether any safety hazard exists or operation is at critical position and decision of the COMPANY shall binding upon the CONTRACTOR.

Should either party decide not to terminate the Contract even under such condition, no payment would apply after expiry of fifteen (15) days force majeure period. [or exclusively mentioned in the SCC of the Contract]

Time for performance of the relative obligation suspended by Force Majeure shall then stand extended by the period for which such cause lasts.

If however, relative obligation of the party affected by such 'Force Majeure' is limited to part of the obligation(s), the contract shall not be terminated and the parties shall continue to perform their respective obligations, which are not affected by the 'force majeure' condition, provided the obligations affected by the 'force majeure' do not preclude the parties in performing the obligations not affected by such conditions.

25. I.B. VERIFICATION REPORT AND SECURITY REVIEW:

Contractor will be required to submit the verification report to ascertain character and antecedents from the Civil Administration towards the persons engaged under this contract to the Head of the user Department before engagement.

26. In case of any doubt or dispute as to the interpretation of any clause herein contained, the decision of the Company's Engineer shall be final and binding on the contractor.

27. SET OFF CLAUSE:

"Any sum of money due and payable to the contractor (including Security Deposit refundable to them) under this or any other contract may be appropriated by Oil India Limited and set off against any claim of Oil India Limited (or such other person or persons contracting through Oil India Limited) for payment of a sum of money arising out of this contract or under any other contract made by the contractor with Oil India Limited (or such other person or persons contracting through Oil India Limited)."

28. COMMISSION OF MISCONDUCT / SUBMISSION OF FRAUDULENT DOCUMENT BY THE BIDDER/CONTRACTOR AND BANNING THEREOF:

The information and documents furnished by the bidder/CONTRACTOR in respect of the tender/contract are accepted by COMPANY to be true and genuine. However, if it comes to the notice of the COMPANY anytime either during the pendency of the tender or after award of the contract or after completion the contract that a Bidder/CONTRACTOR furnished fraudulent document/false information in relation to the subject tender/contract or committed any misconduct, appropriate action shall be taken against the Bidder/CONTRACTOR for debarment/banning of the bidder/CONTRACTOR from participating in any future tender of the COMPANY in terms of the COMPANY's Banning Policy, 2017 besides making the CONTRACTOR liable for other penal action including termination of ongoing contract(s) at his/her risk and peril. In such event, the Bid Security/Performance Security in respect of ongoing contract(s) shall be forfeited by the COMPANY.

29. ERRING / DEFAULTING AGENCIES: Erring and defaulting agencies like bidder, contractor, supplier, vendor, service provider will be dealt as per OIL's Banning Policy dated 6th January, 2017

available in OIL's website: www.oil-india.com. Moreover, OIL reserves the right to take legal or any other action on the basis of merit of the case.

30. SUB-LETTING: The contractor shall not sub-let the WHOLE of the Works. Except where otherwise provided by the contract, the Contractor shall not sub-let any PART of the Works without the written consent of the Engineer-in-Charge and such consent, if given, shall not relieve the Contractor from any liability or obligation under the Contract and he shall be responsible for the acts, defaults or neglects of any sub-contractor, his agents, servants or workmen, provided always that the provision of labour on a piece-work basis shall not be deemed to be a sub-letting under this Clause.

31. TERMINATION:

- a) **Termination on expiry of the contract:** This Agreement shall be deemed to have been automatically terminated on the expiry of the contract period unless OIL has exercised its option to extend this contract in accordance with the provisions, if any, of this contract.
- b) **Termination of contract for death:** If the CONTRACTOR is an individual or a proprietary concern and the individual or the proprietor dies or if the CONTRACTOR is a partnership concern and one of the partners dies then unless, the COMPANY is satisfied that the legal heir of the individual or the proprietary concern or the surviving partners are capable of carrying out and completing Contract, the COMPANY is entitled to cancel the Contract for the uncompleted part without being in any way liable for any compensation payment to the estate of the deceased CONTRACTOR and/or to the surviving partners of the CONTRACTOR's firm on account of the cancellation of Contract. The decision of the COMPANY in such assessment shall be final & binding on the parties. In the event of such cancellation, the COMPANY shall not hold the estate of the deceased CONTRACTOR and/or the surviving partners of CONTRACTOR's firm liable for any damages for non-completion of the Contract.
- c) **Termination on account of Force Majeure:** Unless the contract provides otherwise, either party shall have the right to terminate this Contract on account of Force Majeure as set forth in Article-24.0 above.
- d) **Termination on account of insolvency:** In the event that the CONTRACTOR or its collaborator or its guarantor at any time during the term of the Contract, becomes insolvent or makes a voluntary assignment of its assets for the benefit of creditors or is adjudged bankrupt or under the process of insolvency or liquidation, then the COMPANY shall, by a notice in writing have the right to terminate the Contract and all the CONTRACTOR's rights and privileges hereunder, shall stand terminated forthwith.

However, COMPANY shall be at liberty to give the Receiver or Liquidator or Insolvency Professional Manager, as appointed by the Competent Court/Tribunal, the option of carrying out the Contract subject to its technical & financial competence and his providing a guarantee for due and faithful performance of the Contract.

- e) **Termination for Unsatisfactory Performance:** If the COMPANY considers that, the performance of the CONTRACTOR is unsatisfactory, or not as per the provision of the Contract, the COMPANY shall notify the CONTRACTOR in writing and specify in details the cause of dissatisfaction. The COMPANY shall have the option to terminate the Contract by giving 15 days' notice in writing to the CONTRACTOR, if CONTRACTOR fails to comply with the requisitions contained in the said written notice issued by the COMPANY. In the event CONTRACTOR rectifies its non-performance to the satisfaction of the COMPANY, the option of termination may not be exercised by the COMPANY. If however CONTRACTOR repeats non-performance subsequently, COMPANY shall exercise the option to terminate contract by giving 07 days' notice. Such CONTRACTOR shall be put on holiday as per the Banning Policy of OIL [available at www.oil-india.in].
- f) **Termination due to change of ownership and Assignment:** In case the CONTRACTOR's rights and /or obligations under this Contract and/or the CONTRACTOR's rights, title and interest to the equipment/ material, are transferred or assigned without the COMPANY's written consent, the COMPANY may at its option, terminate this Contract. COMPANY shall not be however under any obligation to accord consent to the CONTRACTOR for change of ownership & assignment of the contract.

- g) If at any time during the term of this Contract, breakdown of CONTRACTOR's equipment results in CONTRACTORS being unable to perform their obligations hereunder for a period of 15 successive days, COMPANY at its option, may terminate this Contract in its entirety or partially to the extent of non-performance, without any further right or obligation on the part of the COMPANY, except for the payment of money then due. No notice shall be served by the COMPANY under the condition stated above.
- h) Notwithstanding any provisions herein to the contrary, the Contract may be terminated at any time by the COMPANY on giving 30 (thirty) days written notice to the CONTRACTOR due to any other reason not covered under the above Article from (a) to (g) and in the event of such termination the COMPANY shall not be liable to pay any cost or damage to the CONTRACTOR except for payment of services as per the Contract upto the date of termination.
- i) **Consequence of Termination:** In all cases of termination herein set forth, the relative obligations of the parties to the Contract shall be limited to the period up to the date of termination. Notwithstanding the termination of this Contract, the parties shall continue to be bound by the provisions of this Contract that reasonably require some action or forbearance after such termination.

Upon termination of this Contract, CONTRACTOR shall return to COMPANY all of COMPANY's properties, which are at the time in CONTRACTOR's possession.

In the event of termination of contract, COMPANY will issue Notice of termination of the contract with date or event after which the contract will be terminated. The contract shall then stand terminated and the CONTRACTOR shall demobilize their personnel & materials. No demobilization charges shall be payable by COMPANY in case of Article from (d) to (g).

IN WITNESS whereof the parties hereunto set their hands seals the day and year first written above:-

(Signature of Contractor or his legal Attorney)

(Full name of signatory)

(Seal of Contractor's firm)

(Signature of witness)

(Full name of Signatory)

Address:

(Signature of Acceptor)

Designation: -----

WORKS CONTRACT**SCHEDULE OF WORK, UNIT AND QUANTITY**

Sl. No.	Description of item	Qty.	Unit	Rate (in ₹)	Total (in ₹)
	GROUP A				
1	Earth work in excavation by mechanical means (Hydraulic excavator) / manual means over areas (exceeding 30cm in depth. 1.5 m in width as well as 10 sqm on plan) including disposal of excavated earth, lead upto 50m and lift upto 1.5m, disposed earth to be levelled and neatly dressed. All kinds of soil.	480.80	M3	141.85	68201.48
2	Filling available excavated earth (excluding rock) in trenches, plinth, sides of foundations etc. in layers not exceeding 20 cm in depth consolidating each deposited layer by ramming and watering.	240.41	M3	150.68	36224.98
3	Supplying and filling in plinth with sand under floors, including watering, ramming, consolidating and dressing complete.	323.00	M3	1220.16	394111.68
4	Providing and laying in position cement concrete of specified grade excluding the cost of centering and shuttering - All work up to plinth level: 1:3:6 (1 Cement : 3 coarse sand (zone-III) : 6 graded stone aggregate 20 mm nominal size)	43.80	M3	4410.48	193179.02
5	Providing and laying damp-proof course 40mm thick with cement concrete 1:2:4 (1 cement : 2 coarse sand (zone-III) derived from natural sources : 4 graded stone aggregate 12.5mm nominal size derived from natural sources)	82.48	M2	232.30	19160.10
6	Extra for providing and mixing water proofing material in cement concrete per 50kg work in doses by weight of cement as per manufacturer's specification.	27.14	KG	49.62	1346.69
7	Providing and laying in position specified grade of reinforced cement concrete excluding the cost of centering, shuttering, finishing and reinforcement - All works up to plinth level: 1:1.5:3 (1 cement : 1.5 coarse sand : 3 graded stone aggregate 20 mm nominal size)	110.63	M3	4468.34	494332.45
8	Reinforced cement concrete work in walls (any thickness), including attached pilasters, buttresses, plinth and string courses, fillets, columns, pillars, piers, abutments, posts and struts etc. above plinth level up to floor five level, excluding cost of centering, shuttering, finishing and reinforcement : 1:1.5:3 (1 cement : 1.5 coarse sand(zone-III) derived from natural sources : 3 graded stone aggregate 20 mm nominal size derived from natural sources)	34.63	M3	5507.98	190741.35
9	Reinforced cement concrete work in beams, suspended floors, roofs having slope up to 15° landings, balconies, shelves, chajjas, lintels, bands, plain window sills, staircases and spiral stair cases above plinth level up to floor five level, excluding the cost of centering, shuttering, finishing and reinforcement with 1:1.5:3 (1 cement : 1.5 coarse sand(zone-III) derived from natural sources : 3 graded stone aggregate 20 mm nominal size derived from natural sources).	88.57	M3	5797.56	513489.89
10	Centering and shuttering including strutting, propping etc, and removal of form for: Foundations, footings, bases of columns etc. for mass concrete	515.35	M2	228.94	117984.23
11	Centering and shuttering including strutting, propping etc, and removal of form for: Lintels, beams, plinth beams, girders, bressumers and cantilevers	475.30	M2	436.33	207387.65
12	Centering and shuttering including strutting, propping etc, and removal of form for: Columns, Pillars, Piers, Abutments, Posts and Struts	431.43	M2	575.34	248218.94
13	Centering and shuttering including strutting, propping etc. and removal of form for: Stairs, (excluding landings) except spiral-staircases.	48.57	M2	495.21	24052.35
14	Centering and shuttering including strutting, propping etc, and removal of form for: Edges of slabs and breaks in floors and walls Under 20 cm wide	71.95	M	139.45	10033.43

Sl. No.	Description of item	Qty.	Unit	Rate (in ₹)	Total (in ₹)
15	Centering and shuttering including strutting, propping etc, and removal of form for: Suspended floors, roofs, landings, balconies and access platform with water proof ply 12 mm thick	319.43	M2	613.46	195957.53
16	Centering and shuttering including strutting, propping etc, and removal of form for: Weather shade, Chajjas, corbels etc., including edges	5.57	M2	608.73	3390.63
17	Laying Brick Flat Soling (75mm thick) including grading the base and spreading 25mm thick sand bed at bottom and grouting soling with cement mortar (prop. 1:3) and carrying all materials from a distance of upto 30.00m.	755.97	M2	595.21	449960.90
18	Brick work with common burnt clay F.P.S. (non-modular) bricks of class designation 7.5 in foundation and plinth in: Cement mortar 1:4 (1 cement : 4 coarse sand)	105.89	M3	7600.14	804778.82
19	Half brick masonry with common burnt clay F.P.S. (non-modular) bricks of class designation 7.5 in superstructure above plinth level up to floor V level. Cement mortar 1:4 (1 cement :4 coarse sand)	1527.19	M2	1015.30	1550556.01
20	12 mm Cement plaster of mix 1:4 (1 cement : 4 fine sand)	2739.56	M2	173.00	473943.88
21	15 mm cement plaster on the rough side of single or half brick wall of mix: 1:4 (1 cement: 4 fine sand).	1984.16	M2	198.83	394510.53
22	Cement plaster skirting up to 30 cm height, with cement mortar 1:3 (1 cement: 3 coarse sand), finished with a floating coat of neat cement. 18mm thick	79.32	M2	308.92	24503.53
23	12 mm cement plaster finished with a floating coat of neat cement of mix : 1:4 (1 cement: 4 fine sand)	35.08	M2	210.06	7368.90
24	Providing and fixing 1st quality ceramic glazed wall tiles conforming to IS: 15622 (thickness to be specified by the manufacturer), of approved make, in all colours, shades except burgundy, bottle green, black of any size as approved by Engineer-in-Charge, in skirting, risers of steps and dados, over 12 mm thick bed of cement mortar 1:3 (1 cement : 3 coarse sand) and jointing with grey cement slurry @ 3.3kg per sqm, including pointing in white cement mixed with pigment of matching shade complete.	51.90	M2	764.02	39652.64
25	Providing and laying rectified Glazed Ceramic floor tiles of size 300x300 mm or more (thickness to be specified by the manufacturer), of 1st quality conforming to IS : 15622, of approved make, in all colours, shades, except White, Ivory, Grey, Fume Red Brown, laid on 20 mm thick Cement Mortar 1:4 (1 Cement : 4 Coarse sand), jointing with grey cement slurry @ 3.3 kg/ sqm including pointing the joints with white cement and matching pigments etc., complete.	184.90	M2	889.74	164512.93
26	Providing and laying Polished Granite stone flooring in required design and patterns, in linear as well as curvilinear portions of the building all complete as per the architectural drawings with 18 mm thick stone slab over 20 mm (average) thick base of cement mortar 1:4 (1 cement : 4 coarse sand) laid and jointed with cement slurry and pointing with white cement slurry admixed with pigment of matching shade including rubbing, curing and polishing etc. all complete as specified and as directed by the Engineer-in-Charge. Polished Granite stone slab of all colour and texture except Black, Cherry/Ruby Red	333.42	M2	2101.68	700742.15
27	Providing and laying Vitrified tiles in different sizes (thickness to be specified by manufacturer), with water absorption less than 0.08 % and conforming to I.S. 15622, of approved make, in all colours & shade, in skirting, riser of steps, over 12 mm thick bed of cement mortar 1:3 (1 cement: 3 coarse sand), jointing with grey cement slurry @ 3.3 kg/ sqm including grouting the joint with white cement & matching pigmentsetc. complete. Size of Tile 600x600 mm	146.23	M2	1113.94	162891.45

Sl. No.	Description of item	Qty.	Unit	Rate (in ₹)	Total (in ₹)
28	Providing and laying Vitrified tiles in floor in different sizes (thickness to be specified by the manufacturer) with water absorption less than 0.08% and conforming to IS:15622, of approved brand & manufacturer, in all colours and shade, laid on 20 mm thick cement mortar 1:4 (1 cement: 4 coarse sand) jointing with grey cement slurry @3.3 kg/sqm including grouting the joints with white cement and matching pigments etc. The tiles must be cut with the zero chipping diamond cutter only . Laying of tiles will be done with the notch trowel, plier, wedge, clips of required thickness, leveling system and rubber mallet for placing the tiles gently and easily. Double charge vitrified tile polished finish of Size of Tile 600 x 600 mm	324.54	M2	961.17	311938.11
29	Providing and laying 60mm thick factory made cement concrete interlocking paver block of M -30 grade made by block making machine with strong vibratory compaction, of approved size, design & shape, laid in required colour and pattern over and including 50mm thick compacted bed of coarse sand, filling the joints with line sand etc. all complete as per the direction of Engineer-in-charge.	75.00	M2	736.57	55242.75
30	Supplying and stacking at site. 53 mm to 22.4 mm size stone aggregate	7.50	M3	2290.23	17176.73
31	Laying, spreading and compacting stone aggregate of specified sizes to WBM specifications in uniform thickness, hand picking, rolling with 3 wheeled road/vibratory roller 8-10 tonne capacity in stages to proper grade and camber, applying and brooming requisite type of screening / binding material to fill up interstices of coarse aggregate, watering and compacting to the required density.	7.50	M3	418.55	3139.13
32	Providing wood work in frames of doors, windows, clerestory windows and other frames, wrought framed and fixed in position with hold fast lugs or with dash fasteners of required dia & length (hold fast lugs or dash fastener shall be paid for separately). Sal wood	1.49	M3	90353.89	134627.30
33	Providing and fixing 35 mm thick factory made laminated veneer lumber door shutter conforming to IS : 14616 and TADS 15:2001 (Part B), fixing with butt hinges of required size with necessary screws, all complete as per directions of Engineer- in-charge and panelling with panels of : (Note:- Butt hinges and necessary screws shall be paid separately) 12 mm thick one side Pre-laminated particle board (decorative lamination on one side and other sides balancing lamination) grade -1, medium density flat pressed, three layer particle board FPT - I or graded wood particle board FPT-1 conforming to IS : 3087 bonded with BWP type synthetic resin adhesive as per IS : 848 and pre-laminated conforming to IS : 12823, Grade -1, Type II marked :	50.72	M2	2584.37	131079.25
34	Providing and fixing ISI marked flush door shutters conforming to IS : 2202 (Part I) non-decorative type, core of block board construction with frame of 1st class hard wood and well matched commercial 3 ply veneering with vertical grains or cross bands and face veneers on both faces of shutters: 30 mm thick including ISI marked Stainless Steel butt hinges with necessary screws	4.73	M2	1550.59	7334.29

Sl. No.	Description of item	Qty.	Unit	Rate (in ₹)	Total (in ₹)
35	<p>Providing and fixing factory made uPVC white colour sliding glazed window upto 1.50 m in height dimension comprising of uPVC multi-chambered frame with in-built roller track and sash extruded profiles duly reinforced with 1.60 ± 0.2 mm thick galvanized mild steel section made from roll forming process of required length (shape & size according to uPVC profile), appropriate dimension of uPVC extruded glazing beads and uPVC extruded interlocks, EPDM gasket, wool pile, zinc alloy (white powder coated) touch locks with hook, zinc alloy body with single nylon rollers (weight bearing capacity to be 40 kg), G.I fasteners 100 x 8 mm size for fixing frame to finished wall and necessary stainless steel screws etc. Profile of frame & sash shall be mitred cut and fusion welded at all corners, including drilling of holes for fixing hardware's and drainage of water etc. After fixing frame the gap between frame and adjacent finished wall shall be filled with weather proof silicon sealant over backer rod of required size and of approved quality, all complete as per approved drawing & direction of Engineer-in-Charge. (Single / double glass panes, wire mesh and silicon sealant shall be paid separately). Variation in profile dimension in higher side shall be accepted but no extra payment on this account shall be made.</p> <p>Note: For uPVC frame and sash extruded profiles minus 5% tolerance in dimension i.e. in depth & width of profile shall be acceptable.</p> <p>Two track two panels sliding window made of (small series) frame 52 x 44 mm & sash 32 x 60 mm both having wall thickness of 1.9 ± 0.2 mm and single glazing bead of appropriate dimension. (Area of window upto 1.75 sqm)</p>	23.22	M2	6446.19	149680.53
36	<p>Providing and fixing factory made uPVC white colour sliding glazed window upto 1.50 m in height dimension comprising of uPVC multi-chambered frame with in-built roller track and sash extruded profiles duly reinforced with 1.60 ± 0.2 mm thick galvanized mild steel section made from roll forming process of required length (shape & size according to uPVC profile), appropriate dimension of uPVC extruded glazing beads and uPVC extruded interlocks, EPDM gasket, wool pile, zinc alloy (white powder coated) touch locks with hook, zinc alloy body with single nylon rollers (weight bearing capacity to be 40 kg), G.I fasteners 100 x 8 mm size for fixing frame to finished wall and necessary stainless steel screws etc. Profile of frame & sash shall be mitred cut and fusion welded at all corners, including drilling of holes for fixing hardware's and drainage of water etc. After fixing frame the gap between frame and adjacent finished wall shall be filled with weather proof silicon sealant over backer rod of required size and of approved quality, all complete as per approved drawing & direction of Engineer-in-Charge. (Single / double glass panes, wire mesh and silicon sealant shall be paid separately). Variation in profile dimension in higher side shall be accepted but no extra payment on this account shall be made.</p> <p>Note: For uPVC frame and sash extruded profiles minus 5% tolerance in dimension i.e. in depth & width of profile shall be acceptable.</p> <p>Three track three panels sliding window with fly proof SS wire mesh (Two nos. glazed & one no. wire mesh panels) made of (small series) frame 92 x 44 mm & sash 32 x 60 mm both having wall thickness of 1.9 ± 0.2 mm and single glazing bead of appropriate dimension (Area of window upto 1.75 sqm)</p>	45.90	M2	9343.72	428876.75
37	<p>Providing and fixing glazing in aluminium door, window, ventilator shutters and partitions etc. with EPDM rubber / neoprene gasket etc. complete as per the architectural drawings and the directions of engineer-in-charge . (Cost of aluminium snap beading shall be paid in basic item): With float glass panes of 5 mm thickness (weight not less than 12.50 kg/sqm)</p>	62.64	M2	1097.15	68725.48
38	<p>Steel reinforcement for R.C.C. work including straightening, cutting, bending, placing in position and binding all complete upto plinth level.</p> <p>Thermo-Mechanically Treated bars of grade Fe-500D or more.</p>	23189.89	KG	74.72	1732748.58
39	<p>Providing and fixing M.S. grills of required pattern in frames of windows etc. with M.S. flats, square or round bars etc. including priming coat with approved steel primer all complete.</p> <p>Fixed to steel windows by welding</p>	2231.00	KG	139.07	310265.17

Sl. No.	Description of item	Qty.	Unit	Rate (in ₹)	Total (in ₹)
40	Providing and fixing in position collapsible steel shutters with vertical channels 20x10x2 mm and braced with flat iron diagonals 20x5 mm size, with top and bottom rail of T-iron 40x40x6 mm, with 40 mm dia steel pulleys, complete with bolts, nuts, locking arrangement, stoppers, handles, including applying a priming coat of approved steel primer.	6.00	M2	7209.11	43254.66
41	Providing and fixing stainless steel (Grade 304) railing made of Hollow tubes, channels, plates etc., including welding, grinding, buffing, polishing and making curvature (wherever required) and fitting the same with necessary stainless steel nuts and bolts complete, i/c fixing the railing with necessary accessories & stainless steel dash fasteners , stainless steel bolts etc., of required size, on the top of the floor or the side of waist slab with suitable arrangement as per approval of Engineer-incharge, (for payment purpose only weight of stainless steel members shall be considered excluding fixing accessories such as nuts, bolts, fasteners etc.).	936.59	KG	502.92	471029.84
42	Structural steel work riveted, bolted or welded in built up sections, trusses and framed work, including cutting, hoisting, fixing in position and applying a priming coat of approved steel primer all complete.	7700.00	KG	90.10	693770.00
43	Steel work welded in built up sections/ framed work, including cutting, hoisting, fixing in position and applying a priming coat of approved steel primer using structural steel etc. as required. In gratings, frames, guard bar, ladder, railings, brackets, gates and similar works	543.38	KG	112.82	61304.13
44	Providing and fixing false ceiling at all height including providing and fixing of frame work made of special sections, power pressed from M.S. sheets and galvanized with zinc coating of 120 gms/sqm (both side inclusive) as per IS : 277 and consisting of angle cleats of size 25 mm wide x 1.6 mm thick with flanges of 27 mm and 37mm, at 1200 mm centre to centre, one flange fixed to the ceiling with dash fastener 12.5 mm dia x 50mm long with 6mm dia bolts, other flange of cleat fixed to the angle hangers of 25x10x0.50 mm of required length with nuts & bolts of required size and other end of angle hanger fixed with intermediate G.I. channels 45x15x0.9 mm running at the spacing of 1200 mm centre to centre, to which the ceiling section 0.5 mm thick bottom wedge of 80 mm with tapered flanges of 26 mm each having lips of 10.5 mm, at 450 mm centre to centre, shall be fixed in a direction perpendicular to G.I. intermediate channel with connecting clips made out of 2.64 mm dia x 230 mm long G.I. wire at every junction, including fixing perimeter channels 0.5 mm thick 27 mm high having flanges of 20 mm and 30 mm long, the perimeter of ceiling fixed to wall/partition with the help of rawl plugs at 450 mm centre, with 25mm long dry wall screws @ 230 mm interval, including fixing of gypsum board to ceiling section and perimeter channel with the help of dry wall screws of size 3.5 x 25 mm at 230 mm c/c, including jointing and finishing to a flush finish of tapered and square edges of the board with recommended jointing compound , jointing tapes , finishing with jointing compound in 3layers covering upto 150 mm on both sides of joint and two coats of primer suitable for board, all as per manufacturer's specification and also including the cost of making openings for light fittings, grills, diffusers, cutouts made with frame of perimeter channels suitably fixed, all complete as per drawings, specification and direction of the Engineer in Charge but excluding the cost of painting with : 12.5 mm thick tapered edge Glass Reinforced Gypsum (GRG) board conforming to IS: 2095- (Part 3):1996 (Boards with BIS certification marks)	451.06	M2	999.27	450730.73

Sl. No.	Description of item	Qty.	Unit	Rate (in ₹)	Total (in ₹)
45	Providing and fixing tiled false ceiling of specified materials of size 595x595 mm in true horizontal level, suspended on inter locking metal grid of hot dipped galvanized steel sections (galvanized @ 120 grams/ sqm, both side inclusive) consisting of main "T" runner with suitably spaced joints to get required length and of size 24x38 mm made from 0.30 mm thick (minimum) sheet, spaced at 1200 mm center to center and cross "T" of size 24x25 mm made of 0.30 mm thick (minimum) sheet, 1200 mm long spaced between main "T" at 600 mm center to center to form a grid of 1200x600 mm and secondary cross "T" of length 600 mm and size 24x25 mm made of 0.30 mm thick (minimum) sheet to be interlocked at middle of the 1200x600 mm panel to form grids of 600x600 mm and wall angle of size 24x24x0.3 mm and laying false ceiling tiles of approved texture in the grid including, required cutting/making, opening for services like diffusers, grills, light fittings, fixtures, smoke detectors etc. Main "T" runners to be suspended from ceiling using GI slotted cleats of size 27 x 37 x 25 x1.6 mm fixed to ceiling with 12.5 mm dia and 50 mm long dash fasteners, 4 mm GI adjustable rods with galvanised butterfly level clips of size 85 x 30 x 0.8 mm spaced at 1200 mm center to center along main T, bottom exposed width of 24 mm of all T-sections shall be pre-painted with polyester paint, all complete for all heights as per specifications, drawings and as directed by Engineer-in-charge. 12.5 mm thick square edge PVC Laminated Gypsum Tile of size 595x595 mm, made of Gypsum plasterboard, manufactured from natural gypsum as per IS 2095 part I and laminated with white 0.16mm thick fire retardant PVC film on the face side and 12micron metalizedpolyester on the back side with all edges sealed with SUB HEAD : 12.0 ROOFING 266 Code Description Unit Rate No.the face side PVC film which goes around and wraps the edges and is bonded to the edges and the back side metalized polyester film so as to make the tile a completely sealed unit.	117.37	M2	1560.29	183131.24
46	Supply,fitting & fixing of Technicol roof shingles on Fiber cement board , with ridges , starters , Silpauline , screws , washers etc roofing materials of approved colour with water proofing layer on MS Structure with all necessar accessories in roof & barge board .(M.S. Structure will be measured separately)	475.97	M2	3101.69	1476311.39
47	Providing and applying plaster of paris putty of 2 mm thickness over plastered surface to prepare the surface even and smooth complete.	4187.89	M2	157.71	660472.13
48	Finishing walls with Acrylic Smooth exterior paint of required shade:New work (Two or more coat applied @ 1.67 ltr/10 sqm over and including priming coat of exterior primer applied @ 2.20kg/ 10sqm.	867.93	M2	129.68	112553.16
49	Wall painting with acrylic emulsion paint of approved brand and manufacture to give an even shade : Two or more coats on new work	3342.95	M2	100.55	336133.62
50	Finishing with Deluxe Multi surface paint system for interiors and exteriors using Primer as per manufacturers specifications : Painting wood work with Deluxe Multi Surface Paint of required shade. Two or more coat applied @ 0.90 ltr/10 sqm over an under coat of primer applied @0.75 ltr/10 sqm of approved brand and manufacture	133.09	M2	110.60	14719.75
51	Finishing with Deluxe Multi surface paint system for interiors and exteriors using Primer as per manufacturers specifications : Painting Steel work with Deluxe Multi Surface Paint to give an even shade. Two or more coat applied @ 0.90 ltr/ 10 sqm over an under coat of primer applied @ 0.80 ltr/ 10 sqm of approved brand and manufacture	265.65	M2	106.41	28267.82
52	Providing and fixing aluminium sliding door bolts, ISI marked anodised (anodic coating not less than grade AC 10 as per IS : 1868), transparent or dyed to required colour or shade, with nuts and screws etc. complete : 300x16 mm	10.00	NO	222.50	2225.00
53	Providing and fixing chromium plated brass 100 mm mortice latch and lock with 6 levers and a pair of lever handles of approved quality with necessary screws etc. complete.	21.00	NO	676.71	14210.91

Sl. No.	Description of item	Qty.	Unit	Rate (in ₹)	Total (in ₹)
54	Providing and fixing aluminium tower bolts, ISI marked, anodised (anodic coating not less than grade AC 10 as per IS : 1868) transparent or dyed to required colour or shade, with necessary screws etc. complete : 250x10 mm	26.00	NO	88.22	2293.72
55	Providing and fixing aluminium handles I.S.I. marked anodised (anodic coating not less than grade AC 10 as per IS: 1868) transparent or dyed to required colour or shade with nuts and screws etc. complete.with nuts and screws etc. complete : 125 mm	20.00	NO	51.71	1034.20
56	Making plinth protection 50 mm thick of cement concrete 1:3:6 (1 cement: 3 coarse sand : 6 graded stone aggregate 20 mm nominal size) over 75mm thick bed of dry brick ballast 40 mm nominal size, well rammed and consolidated and grouted with fine sand, including finishing the top smooth.	79.31	M2	547.76	43442.85
57	Demolishing cement concrete manually/ by mechanical means including disposal of material within 50 metres lead as per direction of Engineer - in - charge. Nominal concrete 1:3:6 or richer mix (i/c equivalent design mix)	7.50	M3	1183.67	8877.53
58	Demolishing R.C.C. work manually/ by mechanical means including stacking of steel bars and disposal of unserviceable material within 50 metres lead as per direction of Engineer - in-charge.	8.50	M3	1726.84	14678.14
59	Demolishing brick work manually/ by mechanical means including stacking of serviceable material and disposal of unserviceable material within 50 metres lead as per direction of Engineer-in-charge. In cement mortar	15.50	M3	1000.58	15508.99
60	Dismantling doors, windows and clerestory windows (steel or wood) shutter including chowkhats, architrave, holdfasts etc. complete and stacking within 50 metres lead : Of area 3 sq. metres and below.	20.00	NO	202.18	4043.60
61	Dismantling wood work in frames, trusses, purlins and rafters up to 10 metres span and 5 metres height including stacking the material within 50 metres lead : Of sectional area 40 square centimetres and above	4.50	M3	2479.55	11157.98
62	Dismantling steel work in built up sections in angles, tees, flats and channels including all gusset plates, bolts, nuts, cutting rivets, welding etc. including dismembering and stacking within 50 metres lead.	450.00	KG	3.04	1368.00
63	Dismantling roofing including ridges, hips, valleys and gutters etc., and stacking the material within 50 metres lead of: G.S. Sheet	195.00	M2	88.16	17191.20
64	Providing and fixing water closet squatting pan (Indian type W.C. pan) with 100 mm sand cast Iron P or S trap, 10 litre low level white P.V.C. flushing cistern, including flush pipe, with manually controlled device (handle lever) conforming to IS : 7231, with all fittings and fixtures complete, including cutting and making good the walls and floors wherever required: White Vitreous china Orissa pattern W.C. pan of size 580x440 mm with integral type foot rests	1.00	NO	4655.41	4655.41
65	Providing and fixing white vitreous china pedestal type water closet (European type W.C. pan) with seat and lid, 10 litre low level white P.V.C. flushing cistern, including flush pipe, with manually controlled device (handle lever), conforming to IS : 7231, with all fittings and fixtures complete, including cutting and making good the walls and floors wherever required : W.C. pan with ISI marked white solid plastic seat and lid	3.00	NO	4446.34	13339.02
66	Providing and fixing white vitreous china flat back or wall corner type lipped front urinal basin of 430x260x350 mm and 340x410x265 mm sizes respectively with automatic flushing cistern with standard flush pipe and C.P. brass spreaders with brass unions and G.I clamps complete, including painting of fittings and brackets, cutting and making good the walls and floors wherever required : Range of three urinal basins with 10litre white P.V.C. automatic flushing cistern	2.00	NO	8768.46	17536.92

Sl. No.	Description of item	Qty.	Unit	Rate (in ₹)	Total (in ₹)
67	Providing and fixing one piece construction white vitreous china squatting plate with an integral longitudinal flushing pipe, white P.V.C. automatic flushing cistern, with fittings, standard size G.I. / PVC flush pipe for back and front flush with standard spreader pipes with fittings, G.I clamps and C.P. brass coupling complete, including painting of fittings and cutting and making good the walls and floors etc. wherever required Single squatting plate with 5 litre P.V.C. automatic flushing cistern	1.00	NO	5831.22	5831.22
68	Providing and fixing wash basin with C.I. brackets, 15 mm C.P. brass pillar taps, 32 mm C.P. brass waste of standard pattern, including painting of fittings and brackets, cutting and making good the walls wherever require: White Vitreous China Wash basin size 630x450 mm with a pair of 15 mm C.P. brass pillar taps	11.00	NO	2635.33	28988.63
69	Providing and fixing Stainless Steel A ISI 304 (18/8) kitchen sink as per IS:13983 with C.I. brackets and stainless steel plug 40 mm, including painting of fittings and brackets, cutting and making good the walls wherever Required Kitchen sink with drain board 510x1040 mm bowl depth 250 mm	1.00	NO	4960.82	4960.82
70	Providing and fixing 600x450 mm beveled edge mirror of superior glass (of approved quality) complete with 6 mm thick hard board ground fixed to wooden cleats with C.P. brass screws and washers complete.	7.00	NO	1090.74	7635.18
71	Providing and fixing PTMT soap Dish Holder having length of 138mm, breadth 102mm, height of 75mm with concealed fitting arrangements, weighing not less than 106 gms.	4.00	NO	84.01	336.04
72	Providing and fixing PTMT liquid soap container 109 mm wide, 125 mm high and 112 mm distance from wall of standard shape with bracket of the same materials with snap fittings of approved quality and colour, weighing not less than 105 gms	4.00	NO	126.98	507.92
73	Providing and fixing PTMT towel ring trapezoidal shape 215 mm long, 200 mm wide with minimum distances of 37 mm from wall face with concealed fittings arrangement of approved quality and colour, weighing not less than 88 gms.	7.00	NO	177.70	1243.90
74	Providing and fixing toilet paper holder : C.P. brass	4.00	NO	545.70	2182.80
75	Providing and fixing PTMT Bottle Trap for Wash basin and sink. Bottle trap 31mm single piece moulded with height of 270 mm, effective length of tail pipe 260 mm from the centre of the waste coupling, 77 mm breadth with 25 mm minimum water seal, weighing not less than 260 gms	6.00	NO	282.23	1693.38
76	Providing and fixing Chlorinated Polyvinyl Chloride (CPVC) pipes, having thermal stability for hot & cold water supply including all CPVC plain & brass threaded fittings This includes jointing of pipes & fittings with one step CPVC solvent cement, trenching, refilling & testing of joints complete as per direction of Engineer in Charge. External work 100 mm nominal dia Pipes metre	80.00	M	2376.28	190102.40
77	Providing and fixing bend of required degree with access door, insertion rubber washer 3 mm thick, bolts and nuts complete. 100 mm dia Sand cast iron S&S as per IS - 3989	30.00	NO	518.80	15564.00
78	Providing and fixing plain bend of required degree 100 mm dia Sand cast iron S&S as per IS : 3989	34.00	NO	381.74	12979.16
79	Providing and fixing soil, waste and vent pipes : 100 mm dia Sand cast iron S&S pipe as per IS: 1729	15.00	M	867.75	13016.25
80	Providing and fixing PTMT grating of approved quality and colour. Circular type 100 mm nominal dia	12.00	NO	28.83	345.96

Sl. No.	Description of item	Qty.	Unit	Rate (in ₹)	Total (in ₹)
81	Constructing brick masonry chamber for underground C.I. inspection chamber and bends with bricks in cement mortar 1:4 (1 cement : 4 coarse sand) C.I. cover with frame (light duty) 455x610 mm internal dimensions, total weight of cover with frame to be not less than 38 kg (weight of cover 23 kg and weight of frame 15 kg), R.C.C. top slab with 1:1.5:3 mix (1 cement : 1.5 fine sand : 3 graded stone aggregate 20 mm nominal size), foundation concrete 1:5:10 (1 cement : 5 fine sand : 10 graded stone aggregate 40 mm nominal size), inside plastering 12 mm thick with cement mortar 1:3 (1 cement : 3 coarse sand), finished smooth with a floating coat of neat cement on walls and bed concrete etc. complete as per standard design: Inside dimensions 455x610 mm and 45 cm deep for single pipe line : With common burnt clay F.P.S. (non modular) bricks of class designation 7.5	2.00	NO	5207.07	10414.14
82	Making soak pit 2.5 m diameter 3.0 metre deep with 45 x 45 cm dry brick honey comb shaft with bricks and S.W. drain pipe 100 mm diameter, 1.8 m long complete as per standard design. With common burnt clay F.P.S. (non modular) bricks of class designation 7.5	1.00	NO	18931.52	18931.52
83	Providing and fixing Chlorinated Polyvinyl Chloride (CPVC) pipes, having thermal stability for hot & cold water supply including all CPVC plain & brass threaded fittings This includes jointing of pipes & fittings with one step CPVC solvent cement, trenching, refilling & testing of joints complete as per direction of Engineer in Charge. External work 50 mm nominal dia Pipes	40.00	M	663.81	26552.40
84	Providing and fixing G.I. Pipes complete with G.I. fittings and clamps, i/c making good the walls etc. concealed pipe, including painting with anti corrosive bitumastic paint, cutting chases and making good the wall : 15 mm dia nominal bore	60.00	M	357.54	21452.40
85	Providing and fixing G.I. Pipes complete with G.I. fittings and clamps, i/c making good the walls etc. concealed pipe, including painting with anti corrosive bitumastic paint, cutting chases and making good the wall : 20 mm dia nominal bore	50.00	M	392.39	19619.50
86	Providing and fixing C.P. brass long nose bib cock of approved quality conforming to IS standards and weighing not less than 810 gms. 15 mm nominal bore	10.00	NO	620.76	6207.60
87	Providing and fixing C.P. brass long body bib cock of approved quality conforming to IS standards and weighing not less than 690 gms. 15 mm nominal bore	10.00	NO	615.00	6150.00
88	Providing and fixing C.P. brass stop cock (concealed) of standard design and of approved make conforming to IS:8931. 15 mm nominal bore	16.00	NO	516.33	8261.28
89	Providing and fixing gun metal non- return valve of approved quality (screwed end) 50 mm nominal bore Horizontal	2.00	NO	1018.88	2037.76
90	Providing and fixing gun metal non- return valve of approved quality (screwed end) 50 mm nominal bore Vertical	2.00	NO	1146.64	2293.28
91	Supplying chemical emulsion in sealed containers including delivery as specified. Chlorpyriphos/ Lindane emulsifiable concentrate of 20%.	194.00	L	174.42	33837.48
92	Diluting and injecting chemical emulsion for POST-CONSTRUCTIONAL antitermite treatment (excluding the cost of chemical emulsion) : Treatment of soil under existing floors using chemical emulsion @ one litre per hole, 300 mm apart including drilling 12 mm diameter holes and plugging with cement mortar 1 :2 (1 cement : 2 Coarse sand) to match the existing floor: 2.35.3.1 With Chlorpyriphos/Lindane E.C. 20% with 1% concentration.	350.00	M2	162.43	56850.50

Sl. No.	Description of item	Qty.	Unit	Rate (in ₹)	Total (in ₹)
	GROUP B				
1	Wiring for light point/ fan point/ exhaust fan point/ call bell point with 3 nos Single core 1.5 sq.mm size FRLS PVC insulated copper cable in recess using medium grade ISI approved 25mm size PVC conduit & accessories, suitable GI box as required.(Colour codes – Phase –R/Y/B; Neutral –Black & Earth-Green)). Concealed Point wiring includes laying of PVC conduit in the roof/Wall also.	191.00	P	1431.78	273469.98
2	Wiring for light plug point with 3 nos Single core 1.5 sq.mm size FRLS PVC insulated copper cable in recess using medium grade ISI approved 25mm size PVC conduit & accessories, etc as required.(Colour codes – Phase –R/Y/B; Neutral –Black & Earth-Green)).Concealed wiring includes laying of PVC conduit in the roof/Wall also.	260.00	M	188.39	48981.40
3	Wiring for circuit/ sub main from MCB DB to desired Switch Board with 3 nos Single core 2.5 sq.mm size FRLS PVC insulated copper cable in recess using medium grade ISI approved 25mm size PVC conduit & accessories, (Colour codes : Phase –R/Y/B; Neutral –Black & Earth- Green)).Concealed circuit wiring includes laying of PVC conduit in the roof/Wall also.	1815.00	M	227.97	413765.55
4	Wiring for circuit/ sub main/Power wiring from MCB DB to desired Switch Board/power point with 3 nos Single core 4 sq.mm size FRLS PVC insulated copper cable in recess using medium grade ISI approved 25mm size PVC Conduit & accessories, (Colour codes : Phase –R/Y/B; Neutral –Black & Earth- Green). Concealed circuit wiring includes laying of PVC conduit in the roof/Wall also.	700.00	M	278.05	194635.00
5	Wiring for circuit/ sub main wiring from Main panel to DB, DB to MCB DB with 3 nos Single core 10 sq.mm size FRLS PVC insulated copper cable in recess using medium grade ISI approved 32mm size PVC conduit & accessories, (Colour codes: Phases - R/Y/B; Neutral –Black & 1 Nos Earth-Green)).Concealed sub main wiring includes laying of PVC conduit in the roof/Wall also.	180.00	M	852.27	153408.60
6	Wiring for circuit/ sub main wiring from Main panel to DB, DB to MCB DB with 6 nos Single core 10 sq.mm size FRLS PVC insulated copper cable in recess using medium grade ISI approved 32mm size PVC conduit & accessories, (Colour codes: Phases - R/Y/B; Neutral –Black & 1 Nos Earth-Green)).Concealed sub main wiring includes laying of PVC conduit in the roof/Wall also.	100.00	M	1565.68	156568.00
7	Supply and Fixing of 3 Module type Switch Board Box shall be made out of steel sheet of min 1.20 mm thickness and complete finished box should be duly pretreated, zinc coated & passivated or made of GI sheet of 1.2mm thickness to accommodate specified number of electrical accessories and suitable for indoor electrical installation with provision for earthing terminal. Modular type Frame Plate with matching Cover Plate suitable for above Switch Board Box suitable to accommodate specified number of electrical accessories. Frame Plate shall be made out of polycarbonate.The configurations for the relevant plate are defined as under: A- Number of Rows: 1. B- Number of openings:3. C- Size of opening.: 1M Internal connection of wire is included in the item.	97.00	NO	139.63	13544.11
8	Supply and Fixing of 8 Module type Switch Board. Box shall be made out of steel sheet of min 1.20 mm thickness and complete finished box should be duly pretreated, zinc coated & passivated or made of GI sheet of 1.2mm thickness to accommodate specified number of electrical accessories and suitable for indoor electrical installation with provision for earthing terminal.Frame Plate with matching Cover Plate suitable for above Switch Board Box suitable to accommodate specified number of electrical accessories. Frame Plate shall be made out of polycarbonate. The configurations for the relevant plate are defined as under: A- Number of Rows: 1 B- Number of openings:8 C- Size of opening.1M	24.00	NO	420.14	10083.36

Sl. No.	Description of item	Qty.	Unit	Rate (in ₹)	Total (in ₹)
9	Supplying and fixing 3 module GI box with modular plate and cover in front on recess, including providing and fixing 3 pin 5/6 amps modular socket outlet and 5/6 amps modular switch, connection etc. as required. Modular type switch shall be ISI marked switch modular, unenclosed, push / piano type suitable for flush mounting with screw type terminals suitable for 250V, 50Hz. supply and conforming to IS: 3854/1997 Reaffirmed 2007. Modular socket outlet, flush type mounting, non-shuttered type for 250V,50Hz. supply and conforming to IS:1293/ 2005 with amendments No.1,2&3.The dimensions shall be as per annexure A of IS: 1293/2005 with amendments No.1,2&3 Note:- Dimensions and withdrawal force values for 2-pin sockets and 5-pin sockets shall be as per IS:1293.	52.00	NO	394.55	20516.60
10	Supplying and fixing 3 module GI box with modular plate and cover in front on recess, including providing and fixing 6 pin 5/6 & 15/16 amps modular socket outlet and 15/16 amps modular switch, connection etc. as required.Modular type switch shall be ISI marked switch modular, unenclosed, push / piano type suitable for flush mounting with screw type terminals suitable for 250V, 50Hz. supply and conforming to IS: 3854/1997 Reaffirmed 2007. Modular socket outlet, flush type mounting, non-shuttered type for 250V,50Hz. supply and conforming to IS:1293/ 2005 with amendments No.1,2&3.The dimensions shall be as per annexure A of IS: 1293/2005 with amendments No.1,2&3 Note:- Dimensions and withdrawal force values for 2-pin sockets and 5-pin sockets shall be as per IS:1293.	24.00	NO	518.33	12439.92
11	Supplying and installation of recess type 20A metallic plug/socket DB complete with 20A Plug and Socket and 20 A DP RCBO,30mA sensitivity for AC.	11.00	NO	6065.55	66721.05
12	Supply and fixing of 6 A Modular switch in the existing modular boxes. Modular type switch shall be ISI marked modular, unenclosed, push / piano type suitable for flush mounting with screw type terminals suitable for 250V, 50Hz. supply and conforming to IS: 3854/1997 Reaffirmed 2007.	191.00	NO	57.41	10965.31
13	Supply and fixing of modular Blank Plate matching with modular switch boxes.	261.00	NO	25.02	6530.22
14	Supplying and fixing 3 pin, 5 amp ceiling rose	80.00	NO	56.79	4543.20
15	Supply and fixing 1 Module step Fan Regulator 100W.Electronic Fan regulator step type (Capacitor Type) with minimum 4 steps(5 position) flush mounting type to IS:11037/1984(Reaffirm 2005) suitable for electric ceiling fan of voltage 230V, AC,50 Hz having wattage up to 100 Watts Max. The capacitor used shall be of standard make.	31.00	NO	312.42	9685.02
16	Supply, Installation, testing and commissioning of 1400 mm sweep ceiling fan without modular step regulator, including wiring the down rods of standard length (upto 30 cm).Fan shall have double bearing with minimum air delivery shall be 230 CMM. Minimum Power input shall be 60 W .	31.00	NO	3452.64	107031.84
17	Supplying and fixing of Mild steel hexagonal/Round fan box with 12mm Rod ,18G in the fan position.	31.00	NO	221.97	6881.07
18	Supply, Installation, testing and commissioning of Exhaust Fan, 300 mm sweep, 900±10% PM heavy duty metallic exhaust fan in the existing pening, including making the hole to suit the size of the above fan, making good the damage, connection, testing, commissioning etc. as required.Minimum power input shall be 50 W.Pre-lubricated double ball bearing for maintenance free running and conforming to IS 2312-1967 with latest amendment.	7.00	NO	6527.42	45691.94

Sl. No.	Description of item	Qty.	Unit	Rate (in ₹)	Total (in ₹)
19	Supply,Installation, testing and commissioning of high performance suspension mounting, LM-79 certified 1x4 LED panel luminaire & LM-80 certified LED chip with aluminium extruded channel & white powder coating. Fitting shall be with high translucent diffuser & white optics reflector for glare free light distribution with 40 +/-10% w system wattage, system efficacy >85 lm/W, with output more than 3400 Lumen. THD shall be <10% and PF shall be >0.9. Colour temperature shall be in between 5500 to 6500 K. The driver shall be external type. Luminaire life time shall not be less than 40,000 Hrs.The fitting shall be complete with all accessories etc., including supplying and fixing ball and socket arrangement, 2 nos. downrods of 20 mm dia X 1.6 mm thick steel conduit upto 75 cm length, painting and wiring the down rods and connection with 1.5 sq. mm FR PVC insulated,copper conductor, three core cable and earthing etc. as required.	7.00	NO	6828.93	47802.51
20	Supply,Installation, testing and commissioning of surface mounting powder coated, Aluminum extrusion housing, IP20 acrylic diffuser fitted 4 ft (1200 mm) LED Batten LM-79 certified luminaire & LM-80 certified LED chip (SMD) complete with all mounting accessories. The product should have an even light distribution with max.20 +/-10% w system wattage, system efficacy >90 lm/W system lumen greater than 1800 Lumen. and CCT 6500k, CRI >80. THD shall be <10% and PF >0.9. Life time shall not be less than 40,000 hours.The product should have an electronic constant current driver with open & short circuit protection, reverse polarity protection and surge protection.	13.00	NO	1512.33	19660.29
21	Supply,Installation, testing and commissioning of surface mounting Powder coated, Aluminum extrusion housing, IP20 Diffused Acrylic glass fitted 2ft LED Batten LM-79 certified luminaire & LM-80 certified LED complete with all mounting accessories. The product should have an even light distribution with system lumen greater than 1300 Lumen with max.10 +/-10% w system wattage. and CCT 6500k, CRI >80 and system efficacy >90 lm/W. Lifetime should be at least 40000 hours.The product should have an Electronic constant current driver with Open & Short circuit protection, reverse polarity protection and surge protection, PF >0.9, THD <10%.	5.00	NO	780.56	3902.80
22	Supply,Installation, testing and commissioning of recessed type 35 to 38 W LED CRCA powder coated luminaire complete with all mounting accessories for fixing in the POP type ceiling including supplying, fixing arrangement and connection with 3x1.5 sq. mm FR PVC insulated,copper conductor, single core cable and earthing etc. as required.Minimum output Lumen shall be 3200 and colour temperature shall be 5500K to 6500K.Driver shall be external. Efficacy shall be more than 90%. Power factor>0.9, THD < 10% , IEC Compliant for safety.	70.00	NO	5164.64	361524.80
23	Supply,Installation, testing and commissioning of recessed accent lighting luminaire (downlight) with matt finish reflector complete with green perform LED lamps with all accessories including fixing arrangement in the ceiling, wiring and connection with 1.5 mmsq FRLS single core copper conductor.Minimum lumen out shall be 1200 Lumen,CRI>80%,driver shall be constant current non integrated, Optics High Efficiency diffuser with more than 85% transmittance.	58.00	NO	2660.74	154322.92
24	Supplying and fixing metal box of 200 mm X 250 mm X 100 mm on surface or in recess with suitable size of phenolic laminated sheet cover in front including painting etc as required.	10.00	NO	274.67	2746.70
25	Supplying and fixing metal box of 150 mm X 150 mm X 60 mm on surface or in recess with suitable size of phenolic laminated sheet cover in front including painting etc as required.	121.00	NO	172.89	20919.69
26	Supply,Installation,Testing & commissioning of 16 WAY SPN MCB DB with double door , single pole and neutral, sheet steel, MCB distribution board, 240 volts, on surface , complete with 100 A tinned 12 way copper busbar, 12 way neutral busbar, 12 way earth bar, din bar, detachable gland plate, interconnections, phosphatized and powder painted including earthing etc. as required.DB shall have following as incomer :63 A RCBO, sensitivity 30mA -1 nos.Outgoings are 10 A MCB ,C curve-6 nos,20 A MCB,C curve- 6 nos.Make of RCBO, MCBs and box shall be of same make. All accessories like Lugs/Thimble etc	6.00	NO	11678.33	70069.98

Sl. No.	Description of item	Qty.	Unit	Rate (in ₹)	Total (in ₹)
	.required for installation shall be supplied by Contractor.				
27	Supply,Installation,Testing & commissioning 3 phase 8 way 63A MCB DB: 3 phase 8 way TPN prewired MCB DB with double door of following specification: DB shall be as per IS 8623, Suitable for Flush mounting and surface mounting application with 100 A copper busbar for each phase, with neutral bar, earth bar and cable ties for cable management, fully insulated busbar and neutral bar. DB shall have proper arrangement for door earthing and corner shields for better protection, Pan assembly for ease of installation, masking sheet, reversible doors, with provision for four pole RCBO as incomer and SP MCB as outgoing, supplied with wire set and MCBs. Wires shall be FRLS copper single core cables of sufficient capacity. DB shall have protection against mechanical impact, minimum protection index shall be IK 09 with acrylic door of IEC-62262 and Ingress protection of IP43. Limiting dimensions of DB shall be: front side length with door: 700 mm, breadth: 500 mm and depth 70 mm. Knockouts on the top shall be of following dimensions: 1 no., 32 mm dia; 8 nos., 25 mm dia. Knockouts on bottom shall be of following dimensions: 1 no., 32 mm dia; 8 nos., 25 mm dia. Knockouts on both sides shall be of following dimensions: 1 no. 32 mm dia and 2 nos., 25 mm dia. Part 1:DB shall have 63 A,10kA 30 mA 4P RCBO as incomer as per IS: 12460 with latest ammendments, Part 2. Outgoing distribution in each phase shall consist of 8 nos. of MCB (2 nos. of 10 A and 6 nos. of 20 A MCB), all C curve, 10 KA capacity, Total no. of MCBs in DB- 24 nos. All MCBs shall be as per IS/IEC 60947-2. All accessories like Lugs/Thimble etc. required for installation shall be supplied by Contractor.	2.00	NO	24701.77	49403.54
28	Supply,Installation,Testing & commissioning 160 A, 12 W, VTPN MCCB DB Supply of 3 Phase, 12 WAY, vertical TPN MCCB DB, as per the following specifications: A. Incoming: a. 160 A Thermal adjustable MCCB: 1 no b. Rating: 4 pole, 160 A, 25kA, 50Hz, 415VAC c. Protection: Thermal and Magnetic Protection B. Outgoing Feeders: a. 63 A TP C curve MCB: 6 nos b. 63 A SP C curve MCB: 18 nos c. All outgoing MCBs shall be 'C' curve, 240v AC, 10kA breaking capacity, with DMC housing, suitable for class-II tropicalisation (as per IEC) & approved by ISI or IEC. MCBs shall have integrated label holder, biconnect upper & lower terminals & air channels for low temperature rise. C. Bus bar: 250 A, Tinned Copper D. Constructional details of DB: DB shall be as per IS-8623 with latest amendment. DB shall have external earth terminal & mounting holes. Cable ties & wire leads for wiring incomer MCCB to respective phase & neutral buses shall be supplied and wired with single core 35 sqmm stranded copper cable with tinned copper lugs. Enclosure shall be IP-43& IK-09 with double door. DB shall have detachable cable entry gland plate on top and bottom side for keeping spare length of cables. All wires inside DB shall have ferrules for identification of circuit number. All unused openings shall be fitted with Blanking Plates. The DB shall be provided with 250 amp tinned copper bus bar for phase & neutral. Neutral & Earth bar shall be 8 way each & suitable for termination of wires with pin type cable lugs. All accessories like Gland/Lugs/Thimble etc .required for installation shall be supplied by Contractor.	2.00	NO	74976.06	149952.12

Sl. No.	Description of item	Qty.	Unit	Rate (in ₹)	Total (in ₹)
29	Supply and fixing of Earthing with G.I. earth pipe 3 metre long, 100 mm dia (Conforming to BIS:1239) including accessories, and providing masonry enclosure with cover plate having locking arrangement and watering pipe etc. with charcoal/ coke and salt as required.	4.00	EA	7831.34	31325.36
30	Supplying and laying 50 mm X 3 mm G.I strip at over ground as strip earth electrode, including connection/ terminating with G.I. nut, bolt, spring, washer etc. as required.(Jointing shall be done by overlapping and with 2 sets of G.I. nut bolt & spring washer spaced at 50mm)	50.00	M	152.55	7627.50
31	Supply & fixing of 3.5x35 mmsq PVCA 1100v grade, Heavy duty, PVC insulated, PVC sheathed, galvanised steel wire armoured cable with stranded, Aluminium conductor. Cable should be fixed with proper size of saddles at suitable interval. All core insulations shall be colour coded with red, yellow ,blue and black colours. All insulated cores laid up together, covered with inner sheath of extruded black PVC compound, galvanised steel wire armour and black PVC outer sheath. Sufficient filler shall be used to give overall circular shape to the cable. The cable shall be approved by IS: 1554 with latest amendments. PVC insulation should be as per IS-5831. Armour should be as per IS-3975. Conductor should be as per IS-8130. Manufacturer's name, cable size, voltage grade, ISI mark should be marked on the cable outer sheath in permanent manner at regular interval. Sequential marking should be provided on the cable outer sheath at every one meter length for measurement during use.	50.00	M	520.57	26028.50
32	Supply & fixing of 1x16 mmsq PVC 1100v grade, Heavy duty, PVC insulated, Black PVC sheathed cable with stranded, Aluminium conductor. The cable shall be approved by IS: 1554 with latest amendments. PVC insulation should be as per IS-5831. Manufacturer's name, cable size, voltage grade, ISI mark should be marked on the cable outer sheath in permanent manner at regular interval. Sequential marking should be provided on the cable outer sheath at every one meter length for measurement during use.	50.00	M	380.51	19025.50
33	Supply & fixing of 3.5x70 mmsq PVCA 1100v grade, Heavy duty, PVC insulated, PVC sheathed, galvanised steel wire armoured cable with stranded, Aluminium conductor. Cable should be fixed with proper size of saddles at suitable interval. All core insulations shall be colour coded with red, yellow ,blue and black colours. All insulated cores laid up together, covered with inner sheath of extruded black PVC compound, galvanised steel wire armour and black PVC outer sheath. Sufficient filler shall be used to give overall circular shape to the cable. The cable shall be approved by IS: 1554 with latest amendments. PVC insulation should be as per IS-5831. Armour should be as per IS-3975. Conductor should be as per IS-8130. Manufacturer's name, cable size, voltage grade, ISI mark should be marked on the cable outer sheath in permanent manner at regular interval. Sequential marking should be provided on the cable outer sheath at every one meter length for measurement during use.	70.00	M	935.33	65473.10
34	Supply & fixing of 1x25 mmsq PVC 1100v grade, Heavy duty, PVC insulated, Black PVC sheathed cable with stranded, Aluminium conductor. The cable shall be approved by IS: 1554 with latest amendments. PVC insulation should be as per IS-5831. Manufacturer's name, cable size, voltage grade, ISI mark should be marked on the cable outer sheath in permanent manner at regular interval. Sequential marking should be provided on the cable outer sheath at every one meter length for measurement during use.	70.00	M	414.16	28991.20

Sl. No.	Description of item	Qty.	Unit	Rate (in ₹)	Total (in ₹)
35	Supply of 3.5x120 mmsq PVCA 1100v grade, Heavy duty, PVC insulated, PVC sheathed, galvanised steel wire armoured cable with stranded, Aluminium conductor. Cable should be fixed with proper size of saddles at suitable interval. All core insulations shall be colour coded with red, yellow ,blue and black colours. All insulated cores laid up together, covered with inner sheath of extruded black PVC compound, galvanised steel wire armour and black PVC outer sheath. Sufficient filler shall be used to give overall circular shape to the cable. The cable shall be approved by IS: 1554 with latest amendments. PVC insulation should be as per IS-5831. Armour should be as per IS-3975. Conductor should be as per IS-8130. Manufacturer's name, cable size, voltage grade, ISI mark should be marked on the cable outer sheath in permanent manner at regular interval. Sequential marking should be provided on the cable outer sheath at every one meter length for measurement during use.	500.00	M	1039.06	519530.00
36	Supply of 1x70 mmsq PVC 1100v grade, Heavy duty, PVC insulated, Black PVC sheathed cable with stranded, Aluminium conductor. The cable shall be approved by IS: 1554 with latest amendments. PVC insulation should be as per IS-5831. Manufacturer's name, cable size, voltage grade, ISI mark should be marked on the cable outer sheath in permanent manner at regular interval. Sequential marking should be provided on the cable outer sheath at every one meter length for measurement during use.	500.00	M	260.58	130290.00
37	Making of cable trench in the soil as per following details:- The trench will be made in soil along the route decided in consultation with OIL. The trench will be 750mm deep, 400mm wide. The trench bottom will be filled with 75mm thick layer of clean sand and levelled to give flat bedding for cable. The cable shall be laid on this sand bed. After laying the cable in the trench the trench will be filled with another layer of clean sand of thickness 75mm. This sand layer will be leveled and complete trench length covered with A- Class bricks. The bricks will be placed perpendicular to the cable route closely without any gap. The trench will then filled with soil and the soil surface shall be dressed properly.	180.00	M3	1085.86	195454.80

Sl. No.	Description of item	Qty.	Unit	Rate (in ₹)	Total (in ₹)
38	<p>The LT Panel shall have:</p> <p>INCOMERS: 250 A, 4 pole, 36 kA moulded case circuit Breaker, 415V AC, 50Hz with built-in thermal magnetic adjustable O/C, S/C and instantaneous short circuit release; earth leakage protection with CBCT+ ELR combination: 2 Nos. (with mechanical and electrical interlock)</p> <p>Each Incomer shall have: (a) Digital multifunction meter with accuracy class 0.5 and with RS-485 port with MODBUS protocol for data logging/downloading. The meter shall preferably be of size 96mm x 96mm and shall measure the following electrical parameters: Voltage, Current, Frequency, KVA, KVAh, PF, KWH, and KVAh. The multifunction meter shall have inbuilt memory to store data for minimum 75 days. (b) Cast resin Current Transformer as per IS 2705 & IS 4201 and shall be sized adequately: 03 nos. (c) LED Indication lights for 'Feeder ON', 'Feeder OFF' & 'TRIP': 03 nos. (d) Moulded HRC Fuse Holders with HRC Fuses/MCBs for control circuit protection (e) Rotary Handle for operating the MCCBs</p> <p>OUTGOING FEEDERS: (a) 160 A, 4 pole, 36kA Moulded case circuit Breaker, 50Hz, 415V AC with microprocessor based O/C, S/C, E/F release: 4 nos.</p> <p>Each Outgoing feeder shall have: (i) Digital Ammeter, 3 Phase with inbuilt selector switch with size 96x96 mm: 1 Set (ii) Cast resin Current Transformer as per IS 2705 & IS 4201 and adequately sized: 03 nos. (iii) LED Indication lights for 'Feeder ON', 'Feeder OFF' & 'TRIP': 03 nos. (iv) Moulded HRC Fuse Holders with HRC Fuses/MCBs for control circuit protection (v) Extended rotary handle for operating the MCCBs.</p> <p>Busbar: TPN Copper Busbar, 325 Amps</p> <p>Note: For detailed specifications, kindly refer SCC of the contract</p>	1.00	NO	164160.00	164160.00
39	<p>Supplying, assembling, fixing, testing and commissioning of following luminaires with all fixing accessories complete with necessary drivers, lamps, fitting clamps/down rods/etc, of suitable length etc. as required complete in al respect and as directed by the engineer in charge/consultant: 1) Picture Light(Philips Muziris 7W PICTURE Light) or equivalent</p>	20.00	NO	2695.65	53913.00
40	<p>Supplying, assembling, fixing, testing and commissioning of following luminaires with all fixing accessories complete with necessary drivers, lamps, fitting clamps/down rods/etc, of suitable length etc. as required complete in al respect and as directed by the engineer in charge/consultant: 1) Flood Light (Philips BVP120 LED 35 CW FG S1 PSU GR) or equivalent</p>	6.00	NO	8289.55	49737.30

Sl. No.	Description of item	Qty.	Unit	Rate (in ₹)	Total (in ₹)
41	<p>PART 'A' (Supply)</p> <p>1) Variable Refrigerant Volume / Flow System: Supply of Modular type outdoor units, with all multi scroll DC Inverter compressors for cooling & heating applications. The unit runs with inverter compressor only. All inverter capacity controlling compressors shall be suitable for 415 ± 10% volts, 50 Hz. special coated fins, panel, inverter based condenser fan M.S. hot dip galvanized stands / supports, electrical & microprocessor panel, isolating valves and all the necessary accessories for proper functioning of the units. All ODUs are having Hi- POR technology for Oil return mechanism to high pressure side and Active Refrigerant Control systems to increase efficiency and performance of the unit. The manufacturer must be OEM for this project and must have manufacturing and testing facility in India. Unit shall yield COP of 3.69 at 100% load at AHRI condition (Ambient 35Deg DBT & Inside : 19Deg WBT) . Condenser shall be capable to operate for outside ambient of 53 Deg C. All Outdoor unit must have " Ocean Black Fin " heat exchanger in the unit in dual layered & double sided with a black coating to shield it from Salt, Sand & other elements brought in by the air. The Manufacturer must be OEM for this project and must have manufacturing and testing facility in India.</p> <p>1.1) Outdoor Unit: a) 14 HP (2 nos.)</p> <p>1.2) Indoor Units: Supply of 4-Way Cassette unit of following Capacities. The unit is having inbuilt drain pump. The set includes IDU, Panel & Cordless Remote: a) Cassette Type 2.0 TR (1 no.) b) Cassette Type 3.0 TR (2 no.) c) Cassette Type 4.0 TR (3 nos.) d) Hi-wall Type 2.0 TR (3 nos.) d) Y- Joints for all the units e) Copper piping & communication cable for the units (as per requirement)</p> <p>PART 'B' (Installation, Testing and Commissioning) Installation, testing & commissioning of 28 HP VRV System with 100% DC Inverter Scroll Compressor, complete Indoor Unit as specified in equipment schedule along with low side works of Indoor installation, piping with nitrile insulation, drain pipe, nitrogen flushing, vacuuming, gas charging and balancing of the complete system.</p>	1.00	SET	1812508.00	1812508.00

Note:

a) Bidder must quote overall price within the range of “At Par” to “+10%” of Company’s Internal Estimate.

b) Bidder must include all impale plant, labour, supervision, materials, erection of display board, sign/caution board, insurance, profit, taxes and duties, together with all general risks, liabilities and in their quoted rates excluding PF and GST.

WORKS CONTRACT**SPECIAL CONDITIONS OF CONTRACT**

DESCRIPTION OF WORK/SERVICES: Construction of Double Storied Sangini Building with electrifications including supply of all materials except cement at Duliajan.

A. SCOPE OF CIVIL WORK**1.0 GENERAL:**

The contractor must complete the work in all respect within the work duration allotted to him as per work order. However, any delay in completion of the work due to reasons not attributable to the contractor will be considered based on hindrance register maintained during delay analysis of the work after its completion and the same will be considered during calculation of LD as per Contract. Moreover, the duration of the work allotted to the contractor is excluding such type of hindrances not attributable to the contractor.

All materials used in the work shall conform to the latest revision of the relevant Indian Standard Specifications to the extent practicable. Where no such specifications exist, they shall be of the best quality available in the market. Wherever ISI certified materials and products are available these alone shall be used. All materials shall be stored at site in accordance with IS-4082-1996.

Unless specially provided for in the contract the tendered rates shall include the cost of carriage, transport, loading, unloading and stacking as directed for all materials required on the work. Where a tender provides a rate for transport of materials, it includes for all loading, unloading and stacking on the site in such position and manner as directed. Any materials found not conforming to specification must be removed from site within 48 hours.

2.0 SITE CLEARANCE:

Before the earthwork is started, the area coming under cutting and/refilling shall be cleared of shrubs, vegetation, grass, uprooting of tree stumps and such others, and rubbish removed up to a distance of 50 metres outside the periphery of the area under clearance. The rate of such site clearance is included in the rate of earthwork.

3.0 STORAGE:

Materials shall be transported, handled and stored at site carefully to the approval of Engineer so as to prevent any damage of any kind to be kept at his own risk and cost.

Cement issued to the Contractor shall be stored in a weatherproof shed, the floor of which shall be raised 300 mm clear from the ground and 600 mm away from the wall all round in order to protect from rain and moisture. Empty cement bag shall be returned to the Company in good condition.

4.0 CEMENT CONCRETE/ REINFORCED CEMENT CONCRETE WORK:

All C.C. work in 1:3:6 proportions shall be done with 18 mm graded down broken stone. Broken stone shall be properly screened before use. All reinforced cement concrete work to be done in prop. 1:1.5:3 unless otherwise specified -- 18mm down to 12 mm graded down broken stone as per related drawings and instructions of site Engineer to be followed in case of any discrepancies. Proper vibration to be done as per IS recommendation. Floor paneling to be done in the line of expansion joint as directed by Engineer In-charge.

5.0 CURING OF CONCRETE:

Curing shall be done in accordance with IS:456 by keeping the concrete surface covered with wet hessian cloths, canvas or similar absorbent materials and kept constantly wet for a period of not less than 7 days from the date of pouring of concrete. Brick work and plastered surface to be kept wet by sprinkling with water for at least 7 days.

6.0 MATERIALS AND WORK SPECIFICATIONS:

Cement- Cement shall be issued by the company from its Store at Duliajan.

Cement shall be stored in weatherproof shade with raised wooden plank flooring to prevent deterioration by dampness or intrusion of foreign matter. It shall be stored in such a way as to allow the removal and use of cement in chronological order of receipt, i.e. first received being first used. Cement deteriorated and or clotted shall not be used on work but shall be removed at once from the site.

Fine Aggregate - Fine aggregate shall be hard, durable, clean and free from adherent coating and organic matter. It shall not contain harmful impurities such as pyrites, coal, lignite, mica, shale or similar laminated material, clay, alkali, soft

fragments, sea shells and organic impurities in such quality as to affect the strength or durability of the concrete. Fine aggregate to be used for reinforced concrete shall not contain any material liable to attack the steel reinforcement. Fine aggregate which is chemically reactive with alkalis of cement is harmful as cracking of concrete may take place.

Coarse Aggregate - Coarse aggregate shall be obtained from natural sources such as stone, gravel, etc. crushed or un-crushed or a continuation thereof from approved quarries. This shall consist of coarse material most of which is retained on 4.75mm sieve. Aggregate shall be hard, strong, dense, durable, clean and free from veins and adherent coatings. It shall be free from soft, feeble, thin, elongated or laminated pieces and shall be roughly cubical in shape. It shall be clear and free from dirt and any other deleterious matter.

Reinforcement and Structural Steel work - The following types of steel for reinforcement shall be used in reinforced concrete construction and these shall conform to Indian Standards or as revised from time to time mentioned against each

1) Mild steel and medium tensile steel bars and hard drawn steel wire - IS: 432.

2) HYSD bars - IS: 1786.

Reinforcement bars and structural steel of only primary producers shall be used in this project. Bending & Placing steel reinforcement in position-Bending shall be carried out as per relevant IS specification and direction of the Engineer-in-charge. All reinforcement bars shall be accurately placed in position with spacing and cover as shown in the drawing or as specified and firmly held so during the placing and vibrating and setting of concrete. Bars shall be thoroughly cleared of rust, seals, grease, oil and any other foreign matter before placing them in position. The overlap jointing shall be staggered. The bars shall be fixed with 22G binding wire. Precast cover blocks 1:2 (1 cement: 2sand) cement mortar 40 mm square and necessary thickness shall be used to keep the reinforcement bars in proper position. For this block, no extra payment to be made. Wire required for binding shall not be measured separately. Tack welding shall also be permitted in lieu of building with steel wire.

Proportioning of mix - Proportioning shall be done by volume. Boxes of suitable size shall be used for measuring sand and aggregates. The size of the boxes (internal) shall be 35 x 25cm and 40cm deep. The unit of measurement for cement, shall be a bag of cement weighting 50 Kg and this shall be taken as 0.035 cubic metre. While measuring the aggregate and sand the boxes shall be filled without shaking, ramming or hammering. The proportioning of sand shall be on the basis of its dry volume and in case of damp sand, allowances for bulkage shall be made.

Mixing - Mixing of reinforced cement concrete shall, as a rule be done in a mechanical mixer. However, the Engineer-in-charge may permit hand mixing in specific cases where in his opinion it is not practicable to resort to mechanical mixing, either on account of the quality of cement concrete required is small or for any other reason. In such cases, it should be ensured that the inferior quality of concrete produced by hand mixing will not adversely affect the structure.

Consistency - The quantity of water to be used for each batch containing 50 Kg of cement, to give the required consistency shall not be more than 34 litres for 1:3:6, mix 32 litres for 1:2:4 mix, 30 litres for 1:1.5:3 mix and 27 litres for 1:1:2 mix. In case of vibrated concrete, the above quantity shall be suitably reduced. The quantity of water shall be regulated by carrying out regular Slump Test.

Placing of concrete - Before placing the concrete the sub-base/form work shall be cleared of all injurious or foreign matter, watered and well consolidated. Formwork shall be clean and free from all foreign material. It is necessary that the time between mixing and placing of concrete does not exceed the initial setting process. Mixed concrete that has been left standing shall not be used after the initial set has commenced the addition of water (or cement) to make such a mixture more workable shall not be allowed. In foundation trenches or such other situations, the entire concrete used in the work shall be laid gently (not thrown) in layers not exceeding 15cm. The concrete so deposited shall be thoroughly vibrated by means of mechanical vibrators till dense concrete is obtained.

Curing - Concrete shall be carefully protected during first stage of hardening from harmful effects or excessive heat, drying winds, rain or running water and shock. After the concrete has begun to harden i.e. about 1 to 2 hours after its laying it shall be protected from quick drying with moist gunny bags or any other material approved by the Engineer-in-charge. After 24 hours of laying of concrete the surface shall be cured by flooding water up to 25mm depth or by

covering with wet adsorbent materials. The curing shall be done for a minimum period of 7 days from the date of pouring of concrete, unless otherwise specified.

Finishing - In case of roof slabs the top surface shall be finished even and smooth with wooden trowel, before the concrete beings to set. The surface of RCC slab on which the cement concrete or mosaic floor is to be laid shall be roughened with brushes while the concrete is green. This shall be done carefully without disturbing the concrete. Before laying the floor, the laitance shall be removed, the surface of slab hacked and a coat of cement slurry at 2.75 Kg of cement per square metre shall be applied, so as to get a good bond between RCC and concrete floor. The exposed surface which is to receive plaster or where it is to be joined with brick masonry wall, shall be properly roughened immediately after the removal of form work, taking care to remove the laitance completely without disturbing the concrete. Before the surface is plastered, it shall be cleaned and wetted so as to give good bond between concrete and plaster.

7.0 FORM WORK:

The formwork shall be rigid and so corrected as to retain the shape and dimensions of the member being cast. Form work for concrete shall be seasoned timber/steel or other approved materials as per directions of the Engineer. It shall be sufficiently tightened to prevent loss of cement slurry and all holes and joints shall be chaulked with putty. It shall have sufficient strength and rigidity to withstand the load of concrete, and vibrations, movement of men, materials and plants and any other incidental loads without excessive deflection beyond permissible limits. The formwork shall be so constructed as to be removable in sections by inscribing or otherwise loosening - them without hammering or levering with force. Only wedges, clamps bolts or screws etc. shall be used in preference to nails or spikes. All side pieces shall be easily removable without disturbing the bottom pieces. Where however, use of nails and spikes become unavoidable, these shall be left projecting so that they can easily be withdrawn.

Surface treatment for shuttering - Forms shall be cleaned of all dust, wood shavings, dirt and other matter by washing with water. This process is facilitated by providing draining holes in the shuttering. The surface shall then be coated with soap solution applied before concreting is done. Soap solution for the purpose shall be prepared by dissolving yellow soap in water to get consistency of paint. Alternatively, a coat of raw linseed oil/refined pale paraffin mineral oil or form oil of approved manufacture may be applied. In case steel shuttering is used, soap solution or row linseed oil shall be applied after thoroughly cleaning the surface. Care shall be taken that such approved composition is kept out of contact with the reinforcement.

In normal circumstances (temperature not below 15 degree C) and where ordinary Portland cement is used form may generally be removed after the expiry of the following periods.

- a) Vertical form work to columns, walls, beams = (16-24) hours
- b) Slabs side (props left under): 3 days
- c) Beam soffits (props. left under): 7 days
- d) Removal of props under slabs
 - i) Spanning up to 4.5 m: 7 days
 - ii) Spanning over 4.5 m: 14 days
- e) Removal of props under beams and arches:
 - i) Spanning up to 6 m: 14 days
 - ii) Spanning above 6 m: 21 days

In no circumstances shall forms be struck until the concrete reaches a strength of at least twice the stress to which concrete may be subjected at the time of removal of form work. All form works shall be removed without such shock or vibration as would damage the concrete. Form work for long span deep beams to be supported by MS props or Bhaluka Bamboo props as required based on the design for the formwork to take care the massive load of the green concrete.

8.0 BRICKWORK:

- a) All bricks shall be of 75 class designation quality locally available as approved by the Site Engineer.
- b) Bricks shall be of size as specified in the item of work or of nominal size where no particular size is mentioned.
- c) Bricks shall be well burnt, sound, hard with sharp edges of uniform size and shape free from cracks, stones or particles of lime and other defects, shall be kiln burnt and satisfy the following requirement:
 - i) They shall give a clear metallic sound when struck
 - ii) They shall be of uniform color and size
 - iii) They shall not be cracked, stratified or under or over burnt
 - iv) The tolerance in dimensions shall be +/- 12mm in length, 6mm in width and 3mm in height.

- v) Keys or frogs shall be formed on one of the larger sizes, except in the case of machine extruded bricks where no frogs are required
 - vi) The increase in weight when soaked in water for 24 hours shall not be more than 20% of the dry weight of the bricks.
- d) If required by the Site Engineer, necessary test shall be conducted at the contractor's expense to ensure quality. In general, the bricks shall be the best quality locally available.

Bricks used for masonry in cement mortar or composite mortar shall be thoroughly soaked in clean water for at least an hour immediately before use (The absence of bubbling when the soaked brick is immersed in water is the test for thorough soaking). The soaked bricks shall be kept on a platform free from dirt, mud or any foreign element. Bricks shall be laid in English bond unless otherwise specified. Care must be taken that the bricks are perfectly clean and free from lime, moss or dirt of any kind. If necessary they must be scrubbed before use. Half or cut bricks shall be not used except for closures which may be required to complete the bond. It shall be ensured that all horizontal and vertical joints are completely filled with mortars without any void in brickwork. Brickwork shall be raised truly plum (or true to required better where so specified). All courses shall be laid truly horizontal. Vertical joints shall be truly vertical and those in alternate courses shall be in the same vertical line. The thickness of brick courses shall be uniform. Great care must be taken to masonry in progress of construction damp. When work is left off for the day troughs shall be formed, by means of fillets of mortar 51mm high all-round the unfinished work and shall be kept filled with water. Vertical or inclined surfaces must be frequently watered from a rose headed can. Water should not be dashed with violence against new work as this washes out the mortar. Should the work be delayed owing to holidays or for other reason, the contractor must make adequate arrangements for keeping the work wetted, and shall continue to do so for at least ten days or such longer time as directed, after the brickwork has been completed.

- a) Brick work in cement mortar with 75 designation brick including racking out joints and curing complete as directed, in sub structure and superstructure in mortar of specified proportion.
- b) 115mm thick 75 designation brick nogged wall in cement mortar embedded with protruding M.S. rod 6mm dia in column including racking out joint and curing complete as directed in super structure above plinth in proportion as specified.

9.0 CEMENT MORTAR:

- i) Must be freshly mixed: Cement mortar will only be mixed in such quantities as can be used up on the work within half an hour of mixing. Mortar which has been mixed longer or which has taken its initial set will on no account be used on the work or remixed with fresh mortar. It must be immediately removed from the site or work.
- ii) Method of mixing: The cement and sand will be mixed dry in the specified proportions, by turning over at least three times on the mixing platform. Only sufficient water will then be added, thorough a rose of a watering can, to produce a workable mixture. The wet mortar will be thoroughly worked or mixed by repeatedly turning over, not less than three times on the mixing board.
- iii) Size of mixing platform and precaution against list : All mixing of mortar must be done on platforms of angle size and workman bringing the material to and from the platform must not be permitted to walk about on it, thereby bringing mud or dirt to the place, where the mortar is being mixed. The platform must be clean and level and all joints closed or filled so that the cement is not washed out.
- iv) Proportion of cement and sand: Where not otherwise specified, cement mortar for plaster will consist of one part of cement to two parts of sand. For mortar for brick or stone masonry work the proportion unless otherwise specified, will be one part of cement to three parts sand.

10.0 SYNTHETIC ENAMEL PAINT:

Preparation of surface: The surfaces before painting shall be cleaned of all rust, scale, dirt and other foreign matter sticking to it with wire brushes, steel wool in case of steel surfaces and sand papering in case of wooden surfaces. Thereafter, one coat approved primer paint will be applied on the surface. Synthetic enamel paint (Superior quality as approved) shall be applied - two or more coats to give an even shade.

11.0 FILLING EXCAVATED EARTH IN FOUNDATION TRENCHES AND PLINTH OR UNDER FLOORS:

As soon as the work in foundation has been completed and measured, the sides of foundations shall be cleared of all debris, bricks bats, mortar dropping etc., and filled with earth in layers not exceeding 30cms, each layer shall be adequately watered, rammed and consolidated before the succeeding one is laid. Earth shall be rammed with iron rammers where feasible, and with the butt ends crowbars where rammer cannot be use.

The plinth shall be similarly filled with earth in layers not exceeding 30cms, adequately watered and consolidated by ramming with iron or wooden rammers. When filling reaches the finished level, the surface shall be flooded with water for at least 24 hours, allowed to dry and then rammed and consolidated, in order to avoid any settlement at a later stage.

Sand filling in plinth: Sand shall be clean and free from dust, organic and other foreign matter. Sand filling shall be done in a manner similar to earth filling in plinth. Concreting of floor shall not be started till the Engineer-in-charge has inspected and approved the filling.

12.0 PRE PAINTED GALVALUME/GALVANISED SHEET ROOFING

Pre-Painted Galvalume Sheet at all levels shall be fitted and fixed with self-drilling, self-tapping screws complete (roof trusses, purlins to be measured and paid separately) of make Dyna roof/sathyam/century wells and of thickness as specified in the respective items. Preferably it shall be carried out by a reputed party.

13.0 TESTS FOR QUALITY CONTROL:

The various tests shall be carried out by the contractor as and when instructed by the Engineer-in-charge and no separate payment shall be made unless otherwise specified in the schedule of rates. Following tests / test certificate to be produced by the contractor at his own cost as and when directed by the Engineer-in-charge.

- i) Water for construction and curing ('PH' value should not be less than 6.)
- ii) Manufacture Test certificate for steel materials, reinforcement steel, and structural steel should be produced prior to its use in construction.
- iii) Test for fine and coarse aggregate
- iv) Any other tests as per the direction of Engineer-in-charge.

14.0 MEASUREMENT & PAYMENT:

Payment for all works done shall be made on the basis of actual work done as per the schedule of rates. For all extra work done on the advice of the Company's Engineer and which is not included in the schedule of rates, deviation order for the same shall be made on the rates as decided by the Company's Engineer.

15.0 SAFETY MEASURE:

Safety measure as per OIL regulations shall be strictly adhered to by the Contractor. Safety belts and other measure taken by the Contractors shall be borne by the Contractor. If any loss or damage caused to life during the erection and execution, the contractor shall be fully responsible for the loss.

16.0 RECORD KEEPING:

- i) A site order book will be maintained at site which will be in the custody of the Engineer-in-charge or his representative and all instructions given to the Contractor will be recorded in the site order book and the same has to be signed by the contractor to comply with the instruction given therein.
- ii) A register to be maintained at site which will be in the custody of the Engineer-in-charge or his representative to maintain the records of use of cement and the same has to be signed by the contractor
- iii) A separate register to be maintained at site by the contractor to record the works executed and remarks columns to be added in this to record the hindrance.

In case of any ambiguity/conflict among various documents the decision of Engineer-in-charge will be final and binding.

17.0 CONTRACTOR'S GODOWN

The contractor must make adequate arrangement as directed by the Engineer-in-Charge, for the storage in suitable godown of all perishable materials such as cement. On no account may cement be stacked on the ground either in or outside godown.

18.0 SPECIAL INSTRUCTION TO THE CONTRACTOR

- i. Contractor must use mixture machine and vibrator for the RCC works. The Contractor shall use pump if needed for dewatering for excavation job for which no extra payment will be made.
- ii. Watch and ward, loss or damage to Company's property, theft and other incidental charges shall be Contractor's responsibility.
- iii. Efficient workmen to be engaged by the Contractor.

- iv. The Contractor's representative should report to Engineer-in charge on all working days at 7.00AM for instruction.
- v. Materials if rejected should be removed from site within 48(forty eight) hours of rejection, failing which the company reserves the right to get the rejected materials removed at the risk and cost of the contractor.
- vi. The Company reserves the right to get the part or whole work completed through other agency at the risk and cost of the contractor if he fails to complete the work within the stipulated time without any valid reasons. The Company's decision shall be final and binding on the Contractor.
- vii. The Contractor shall obtain labour clearance within fourteen days of signing the contract.
- viii. Water that may accumulate on the site during progress of the works or in trenches and excavation from other than accepted risks shall be removed from the site to the satisfaction of the Engineer-in-charge and at the Contractor's expense.
- ix. If needed water and electricity will have to be arranged by the Contractor at his own cost. However, if felt, water and single phase power supply may be provided by Company on Chargeable basis depending on its availability & approved by the competent authority.
- x. The Contractor and his workmen have to strictly observe the safety precautionary rules as per Mines Act (Latest edition) while executing the work.
- xi. No road closure will be allowed during execution of work and necessary traffic signal/road boards to be displayed at proper place by the Contractor at his own cost. The Contractor shall be wholly responsible for any accident arising out of non-fulfilment of this condition.
- xii. The Contractor will be required to work expeditiously at the site and must visit the site before tendering.
- xiii. Welding and cutting sets with fuel & operator, welder, fitter etc. shall be arranged by the Contractor at his cost at site for fabrication and erection work.
- xiv. Hot and Cold permit, Gas leakage testing certificate issued by the Concerned Department to be submitted by the contractor (wherever applicable) to Engineer-in-Charge before starting of dismantling or the other execution of job.
- xv. The contractor must engage at least one or as mentioned in the Contracts Agreement qualified Technical personal (Preferable BE/B Tech in Civil Engineering or diploma in Civil Engineering) for the overall execution of the job and the complete bio-data of the person should be submitted to the engineer in charge within 7 days of the signing of the Contract agreement.
- xvi. The contractor must submit a work plan in bar chart for the overall job within 14 days of issuing of work order.

19.0 GENERAL HSE (Health Safety & Environment) POINTS TO BE FOLLOWED BY THE CONTRACTOR:

1. The contractor shall be solely responsible to comply all the statutory norms as applicable while executing the job. It will be solely the Contractor's responsibility to fulfill all the legal formalities with respect to the Health, Safety and Environmental aspects of the entire job (namely; the person employed by him, the equipment, the environment, etc.) under the jurisdiction of the district of that state where it is operating. . Ensure that all sub-contractors hired by him comply with the same requirement as the contractor himself and shall be liable for ensuring compliance all HSE laws by the sub-contractors. It will be the responsibility of the Contractor/his Supervisor/representative to ensure strict adherence to all HSE measures and Statutory Rules during operation in OIL's installations and safety of workers engaged by him. The crew members will not refuse to follow any instruction given by representative of OIL.
2. Contractor's arrangement for health and safety management shall be consistent with those of the company (OIL).
3. A contractor employee must, while at work, take reasonable care for the health and safety of people who are at the employee's place of work and who may be affected by employee's act or omissions at work.
4. The Contractor shall ensure complete safety of the personnel engaged by him, and of all the equipment, they will handle and must take full responsibility for their safety.
5. Every person deployed by the contractor in a mine must wear safety gadgets to be provided by the contractor. The Contractor shall provide proper Personnel Protective Equipment as per the hazard identified and risk assessed for the job and conforming to statutory requirement and company PPE schedule. Safety appliances like protective footwear, Safety Helmet, Full Body harness and Fall Prevention Devices shall conform to relevant IS Codes. Necessary supportive document shall have to be submitted as proof. If the Contractor fails to provide the safety items as mentioned above to the working personnel, the Contractor may apply to the Company (OIL) for providing the same. In case of exigency OIL will provide the safety items if available. However in turn, OIL will recover the actual cost of the items by deducting from Contractor's Bill. However, it will be the Contractor's sole responsibility to ensure that the persons engaged by him in the mines use the proper PPE while at work. Contractor employees should be trained in proper use and maintenance of

PPE. In absence of appropriate PPEs, the representative of OIL has the right to stop the work which will be binding for the Contractor. Moreover, the accountability towards any delay in work/penalty due to non-adherence to PPE shall be binding to the Contractor.

6. The Contractor may frame a mutually agreed bridging document if required between OIL & the Contractor for all issues not envisaged under the terms and conditions of the contract with the roles and responsibilities clearly defined.

7. The contractor has to keep a register of the persons employed by him/her. The contractor's supervisor shall take and maintain attendance of his men every day for the work, punctually.

8. Standard Operating Procedures (SOPs) related to scope of work shall be handed over to the representative of OIL by Contractor including an assessment of risk, wherever possible and safe method to deal with it/them. The SOP should clearly mention the risk arising to men, machineries & material from the operations to be done by the Contractor and how it is to be managed. However, in case of any doubts, the Contractor shall reconfirm the same from the Engineer In Charge (OIL).

9. Contractor has to ensure that all work is carried out in accordance with the Statute and the SOP for the job. For the purpose, he may deploy adequate qualified and competent personnel for carrying out the job in a safe manner. The work which is not covered under SOP, the Contractor shall develop it and submit to the representatives of OIL.

10. In case of deviation of SOP or non-availability of SOP, Job Safety Analysis (JSA) shall be carried out before commencement of the work.

11. Necessary cold and hot work permits, wherever applicable, including excavation clearance and permission for working at height, Confined Space Entry are to be obtained by the competent person of the Contractor from user department/authorized representative of OIL before start of the job(s). Work permit should be in line as per the guidelines issued by HSE Department.

12. If the company arranges any safety class / training for the working personnel at site (company employee, contractor worker, etc) the contractor will not have any objection to any such training.

13. The Contractor shall not engage minor laborer below eighteen (18) years of age under any circumstances.

14. The contractor should prevent the frequent change of his deployed employees as far as practicable. However, if OIL Engineer in Charge found any person not appropriate with respect to the job, the Contractor has to remove the person and replace a suitable person within the timeline as per the terms of the Contract.

15. OIL will communicate all information to the Contractor or his authorized representatives only. Contractor shall submit details of authorized representative wherever applicable.

16. The Contractor shall have to report all incidents including near miss to the representatives of OIL.

17. Any compensation arising out of the job carried out by the Contractor whether related to pollution, Safety or health will be paid by the Contractor only.

18. Any compensation arising due to accident of the Contractor's personnel while carrying out the job, will be payable by the Contractor and their medical treatment/facilities in case of accidents should be provided by the same Contractor. The Contractor's personnel should be aware about the existing as well as probable hazards and ensure their training to tackle such untoward events by the Contractor.

19. Necessary sign board/warning signals like caution, "hot work" in progress, emergency telephone numbers, no entry without permission etc. should be used wherever applicable. The said signals/sign boards shall have to be arranged by the Contractor and shall be in line with the circular of signboards issued by HSE Department , Oil India Limited.

20. Barricading of area to be done with reflecting tapes as applicable during work.

21. The First-Aid box should be provided by the Contractor and the same has to be kept ready to use at the site throughout the working hours.

22. Smoking is provided in all Company restricted areas except in authorized smoking areas/shelter. Carrying of matches and lighters into the Hazardous Area is prohibited. Cellular phones shall not be used in operating areas/hazardous areas unless they have been classified as 'intrinsically safe' for use in that atmosphere. Consumption of alcohol and possession of non-prescribed drug in Company work site is strictly prohibited.

23. In case Contractor is found non-compliant of HSE laws as required and all the above mentioned general HSE points, company will have the right for directing the Contractor to take action to comply with the requirements, and for further non-compliance, appropriate action will be initiated against the Contractor.

24. When there is a significant risk to health, environment or safety of a person or place arising because of a non-compliance of HSE Measures Company will have the right to direct the contractor to cease work until the non-compliance is corrected.

25. Considering the ongoing Covid-19 pandemic, those who are engaged in the above operations should follow the Covid-19 Protocol as per the prevailing Government Guidelines.

26. Any requirement arise by the Statutory Authorities during the period of contract shall be applicable and binding for the Contractor.

27. The Contractor or his representative shall arrange daily toolbox meetings and maintain records.

28. All safety gears as per requirement of job are to be provided to the working personnel before commencement of the work.

29. For any HSE matters not specified in the contract document, the contractor will abide the relevant and prevailing Acts/rules/regulations/ pertaining to Health, Safety and Environment.

20.0 PLANTS AND EQUIPMENTS TO BE PROVIDED BY THE CONTRACTOR:

The contractor should be capable of mobilizing the following plants and equipment to the site as and when required for successful completion of the job:

- i) Concrete Mixture Machine - 02 Nos.
- ii) Concrete Vibrator (Needle Type) - 02 Nos.
- iii) Cube mould (150mm x 150mm x 150mm) - 09 Nos.
- iv) Welding and cutting set - 02 Nos.
- v) Hydra/Crane for installation of truss - 01 No.

B. SCOPE OF ELECTRICAL WORK

The SCC for the Electrical Part of the Tender comprises two basic parts as follows:

- I. GENERAL
- II. TECHNICAL

I. GENERAL

1.0 General conditions

- a) Special conditions of contract shall be read in conjunction with the General Conditions of Contract, Bill of Quantities, specifications of work, drawings and any other document forming part of this contract wherever the context so requires.
- b) Notwithstanding the sub -division of the documents into these separate sections and volumes, every part of each shall be deemed to be supplementary of every other part and shall be read with and into the contract so far as it may be practicable to do so.
- c) Where any portion of the General Conditions of contract is repugnant to or at variance with any provisions of the Special conditions of Contract, then unless different intention appears, the provisions of the Special Conditions of Contract shall be deemed to override the provision(s) of General Conditions of Contract only to the extent that such

repugnance or variance cannot be reconciled with the tender conditions of contract and shall be to the extent of such repugnance of variations, prevail; it being understood that the provisions of General Conditions of Contract shall otherwise prevail.

d) Wherever it is stated anywhere in this tender document that such and such a supply is to be effected or such and such a work is to be carried out, it shall be understood that the same shall be effected/carried out by the contractor at his own cost, unless a different intention is specifically and expressly stated herein or otherwise explicit from the context.

e) The materials, design and workmanship shall satisfy the relevant Indian Standards, the job specifications contained herein & codes referred to. Where the job specifications stipulate requirements in addition to those contained in the standard codes and specifications, these additional requirements shall also be satisfied. In the absence of any Standard/Specifications/Codes of practice for detailed specifications covering any part of the work covered in this tender, the instructions/directions of Company will be binding on the Contractor.

f) The items given under Bill of Quantity shall be read in conjunction with scope of work, scope of supply (by Contractor) and job specifications and in case of any irreconcilable conflict between them the provision in the item under "Bill of Quantity" will override the corresponding provision only if the scope of work, scope of supply and job specifications, which cannot be reconciled in such cases the decision of Company shall be final and binding on the contractor.

g) In case of contradiction between Indian Standards, General Conditions of Contract, Special Conditions of contract, Specifications Drawings, Bill of Quantity, the following shall prevail in order of precedence.

(i) Letter of intent / Detailed Letter of intent along with statement of Agreed Variations and its enclosures.

(ii) Bill of Quantity.

(iii) Special Conditions of Contract.

(iv) Job specifications

(v) Drawings

(vi) General Condition of contract

(vii) Indian Standard/Technical/Material Specifications.

2.0 STATUTORY REQUIREMENT FOR WORK

a) The contractor should have valid Electrical Contractor License issued or recognized/endorsed by State Licensing Board, Govt. of Assam. In case license expires during contract period the same shall be renewed by the contractor. The contract may be terminated if the license is not renewed.

b) In case the contractor/firm does not possess Electrical Contractor License, he/the firm may form a consortium with another person/firm who/which possesses valid Electrical Contractor License issued or recognized/endorsed by State Licensing Board, Govt. of Assam. In such a case, the partner having the valid Electrical contractor license shall be responsible for executing the electrical portion of the contract as per stipulations detailed in the tender.

c) Contractor shall employ wiremen with valid wireman permit (covering relevant portions), issued/recognized by State Licensing Board, Govt. of Assam to carry out all electrical jobs and shall deploy one supervisor holding valid Electrical supervisor's competency certificate (covering relevant portions), issued/recognized/endorsed by State Licensing Board, Govt. of Assam for supervision of electrical jobs.

d) Quality of jobs carried out by the Contractor shall be of high standard and should be as per the norms of BIS, NEC, CEA Regulations and other electrical standards recognized by the company.

3.0 POWER

Electricity required for wiring purpose shall be arranged by the contractor. However, electricity may be provided by the Company on chargeable basis at its discretion to use drill machine or any other portable tools required for wiring purposes if available at nearest point. The Contractor shall have to arrange for required switch board with proper safety device like RCBO/ELCB/RCCB to draw power and use safely from the existing source. However for welding machine power supply will not be provided by the company, contractor may use Diesel Welding Generators for the same.

4.0 SCOPE OF SUPPLY

Company does not envisage supplying any material for this work & contractor shall arrange all materials, instruments, tools and tackles etc. required for execution of the work.

5.0 SCOPE OF WORK

Brief details of work to be carried out by the contractor are as described below. This will include supply, storage, laying, installation, jointing and testing, obtaining approvals, testing and commissioning and completion of different works. The contractor shall finally give a certificate of electrical work executed by him stating the job done as per the requirement of Central Electricity Authority Regulations, 2010. The work shall be carried out as described in Schedule of Quantities

(SOQ), specifications, and drawings, BIS/NEC guidelines and as per the instructions by Engineer -in-charge (electrical), of the Company. The scope of work shall cover electrification works of any office building/Industrial house/ residential area or as specified by concerned Engineer in charge.

The broad items/activities covered under "electrical works" shall include the supply, installation, testing and commissioning of any or all of the following

- a) Point wiring of light points, call bell points, Ceiling fan points, and exhaust fan points.
- b) Plug points, general power points, metal clad plug & socket outlet points etc. including light and power accessories etc., complete in all respects.
- c) All surface/concealed wiring through BIS marked medium/heavy duty PVC Casing capping/conduit, on or through wall, roof, floor beams, false ceiling, floors etc.
- d) Main Distribution Boards (VTPN DB), Sub Distribution Boards (SPN DB) and switch boards as required.
- e) Cables from Power Source to LT Panel, LT Panel to Main Distribution Boards (VTPN DBs), Main Distribution Boards (VTPN DBs) to Sub Distribution Boards (SPN DBs & TPN DBs) and circuit wiring from sub distribution boards to various switch boards.
- f) Light fixtures and ceiling, wall & exhaust fans.
- g) VRF Air Conditioning System
- h) LT panel complete with necessary grouting using nuts & bolts.
- i) Earthing of LT Panel, all VTPN DBs, TPNDBs, SPN DBs, ACs etc. complete in all respects.

6.0 SCHEDULE OF QUANTITIES/RATE

- a) The quantities shown against the various items are only approximate and may vary to any extent individually subject to relevant clause of General Conditions of Contract. Any increase or decrease in the quantities shall not form the basis for alteration of rates quoted and accepted including where low/ high rates have been quoted by the successful bidder.
- b) The Engineer in charge reserves the rights to interpolate or extrapolate the rate for any new item of work not finding a place in the Bill of Quantity, for similar items of lower and/ or higher magnitude available in the Bill of Quantity.
- c) In case any activity though specifically not covered in Bill of Quantity description but covered under scope of work/spec./drawing etc., contractor has to carry out the same without any extra claim.
- d) The words "Bill of Quantity", "BOQ", "Schedule of Quantity" and "SOQ", appearing in this document, carry the same meaning.

7.0 MEASUREMENTS, BILLING & PAYMENT

- a) All works shall be measured in metric system based on actual work done as per the terms and conditions of the Contract.
- b) The bills based on Schedule of Quantity shall be prepared and submitted based on joint measurements (OIL and contractor). Contractor shall ensure that bills are submitted promptly and timely.

8.0 CONTRACT DRAWINGS

Contractor has to prepare all working drawings mentioned below and obtain approval from the engineer in charge (Electrical) before starting of the civil work.

- a) Layout diagram of complete wiring showing route for wiring from LT Panel to VTPNDB, VTPN DB to TPN DB, TPN DB to SPN DB, SPN DB to Switch Board, Light and ceiling fan positions, VRF AC positions etc.
- b) Schematic diagram for complete electrical work.
- c) Single line diagram of Electrical System
- d) The contract shall keep at least one copy each of drawings, conditions of contract, specifications, instructions and schedule of quantities at the site of works available for reference by any authorized representative Engineer-in-charge(Electrical), at all times during the progress of the works.

9.0 COMPLETION DOCUMENTS

The contractor shall submit 4 copies of AS BUILT layout drawings to OIL after completion of the work. These complete drawings shall give the following information:

- a) Layout of all equipment, switch boards, DB's etc.
- b) Single line diagram of Electrical System
- c) Location of DB's, Sub-mains, junction boxes & earthing
- d) Schematic diagram for overall electrical distribution
- e) Layout of lighting & power wiring
- f) Cable schedule

- g) Operation & Maintenance Manuals for equipment if any
- h) Manufacturers test report & data sheets for equipment if any
- i) Electrical test certificate for the electrical work done as per CEAR, 2010

II. TECHNICAL

1.0 SCOPE

This section covers the general technical requirements and measurement system of the various components in Internal Electrical Installation works.

2.0 TERMINOLOGY

The definition of terms shall be in accordance with IS: 732-1989 (Indian Standard Code of Practice for Electrical Wiring), except for the definitions of "point", "circuit", and "sub-main wiring", which are defined hereunder.

2.1 Point wiring:

A point wiring (other than socket outlet point wiring)

- a) Shall extend from the controlling switch/MCB /controller to the corresponding point/ device (lamps/luminaire/fan/exhaust fan/call bell etc.). Point/device refers to either single devices (like lamps, fans, etc.) or multiple devices controlled from one single switch/MCB/controller (like chandeliers, group of decorative lamps, etc.). Point wiring does not include switch which is covered under a separate item (supply and fixing of modular switch).
- b) Includes supply & fixing of all items as specified in SOQ, like device holders, wires, conduit/casing- capping, accessories like screws, raw plug, outlet boxes, junction boxes, pull -through boxes etc., including metal/PVC boxes if any, provided with switch boards for loose wires/conduit terminations, bushed conduit or porcelain tubing where wiring cables pass through wall etc.
- c) Shall be measured in terms of number of "points" only. There shall be no linear measurement for point wiring, or for the number and size of wires used.
- d) Details of wire size, material, conduit/casing capping, colour of insulation as in SoQ.
- e) It is to be noted that point wiring is estimated to cover approximately 7.0 metre wiring on an average.

2.2 Plug point (socket outlet point) wiring: A Socket (" plug point") outlet point wiring

- a) Shall extend from the switchboard to the corresponding wall socket outlet. Sockets may include a single socket or multiple sockets (of same rating) in one module.
- b) Shall be reckoned as total length of wiring and shall be measured on linear basis along the run of wiring.
- c) Details of wire size, material, conduit/casing capping, colour of insulation as in SoQ.

2.3 Circuit wiring

- a) Shall extend from the distribution board up to the switch board/box.
- b) Include all wiring accessories
- c) Shall be reckoned as total length of wiring and measured on linear basis along the run of wiring
- d) Details of wire size, material, conduit/casing capping, colour of insulation as in SoQ.

2.4 Power plug point wiring

- a) Shall extend from distribution board to combined 5/6 A & 15/16 A 6 pin socket outlet and 20A MCB Switch/ socket.
- b) Include all wiring accessories
- c) Shall be reckoned as total length of wiring and measured on linear basis along the run of wiring
- d) Details of wire size, material, conduit/casing capping, colour of insulation as in SoQ.

2.5 Sub-main wiring

- a) Shall extend from one main/distribution switchboard to another.
- b) Shall be reckoned as total length of wiring and measured on linear basis along the run of wiring.
- c) Includes all wiring accessories
- d) Details of wire size, material, conduit/casing capping, colour of insulation as in SoQ.

3.0 OTHER WIRING WORKS:

As per the details given in the SoQ.

4.0 SYSTEM OF DISTRIBUTION AND WIRING:**a) Control at the point of entry of supply:**

There shall be a circuit breaker on each live conductor of the supply mains at the point of entry.

b) Distribution:

The wiring shall be done on a distribution system through main and/or branch (sub-main) distribution boards. The system design as well as the locations of boards shall be as indicated in BOQ/drawings or as specified by the OIL Engineer-in-charge. Main distribution board (VTPN) shall be controlled by a circuit breaker. Each outgoing circuit shall also be controlled by a circuit breaker. The branch distribution board shall be controlled by a circuit breaker. Each outgoing circuit shall be provided with a miniature circuit breaker (MCB) of specified rating on the phase or live conductor. The loads of the circuits shall be divided, as far as possible, evenly between the number of ways of the distribution boards, leaving at least one spare circuit for future extension. The neutral conductors (incoming and outgoing) shall be connected to a common link (multilayer connector) in the distribution board and be capable of being disconnected individually for testing purposes.

'Power' wiring shall be kept separate and distinct from 'Lighting' wiring beyond the branch distribution boards.

c) Balancing of Circuits:

The balancing of circuits in three wire or poly phase installations shall be arranged beforehand to the satisfaction of the OIL Engineer -in-charge.

d) Wiring System:

i. Wiring shall be measured only as per "point wiring" or "linear basis ", as explained above.

ii. Lights, fans and call bells shall be wired in the 'lighting' circuits.

iii. 6/16A combined socket outlets and other power outlets shall be wired in the 'Power' circuits.

iv. 5A/6A Socket outlet shall be wired in the light plug point circuit.

v. The wiring throughout the system shall be such that there is no break in the neutral wire except in the form of linked MCCB's, MCB's, RCBO's etc.

e) Run of Wiring:

The wiring shall be in conduit as approved by OIL. Due consideration shall be given for neatness, good appearance and safety.

5.0 JOINTS IN WIRING:

No bare conductor in phase and / or neutral or twisted joints in phase, neutral, and / or protective conductors in wiring shall be permitted. There shall be no joints in the through -runs of wires. There shall be no looping of earth wires and neutral wires between points. All light points, plug points etc. shall have their individual neutral and earth wires laying up to the switchboard or distribution board as the case may be.

6.0 RATINGS OF OUTLETS:

MCBs / switches / controllers for devices like light fittings, ceiling fans, exhaust fan etc. shall be rated according to the corresponding device capacity.

RCCBs for household circuits and similar installations should be rated for 30mA tripping current. Socket Outlets shall be rated according to their intended use only.

7.0 CAPACITY OF CIRCUITS:

'Lighting' circuit shall not have more than a total of 10 points of light, fan and socket outlets, or a total connected load of 800W per circuit, whichever is less, "Power" circuit shall have only one outlet per circuit.

8.0 CONFORMITY TO CEA REGULATIONS, 2010 AND STANDARDS:

All electrical works shall be carried out in accordance with the provisions of CEA (Measures relating to safety and electric supply) Regulations 2010, National Electric code and National Building Code. The works shall also conform to relevant Indian Standards.

In all electrical installation works, relevant safety codes of practice shall be followed.

9.0 TESTING OF WIRING / INSTALLATION:

Wherever required by OIL's engineer-in-charge, capping shall not be fixed on the casing till the work has been inspected with the wires in position and approved. Inspection will be done in stages, as work progresses.

On completion of an electrical installation (or extension thereof) OIL's engineer -in-charge may require a test certificate for the installation/wiring job before energizing the circuits. In such instances, contractor shall issue a test certificate, countersigned by certified supervisor under whose supervision the job was carried out.

The following tests should be carried out:

- a) Insulation resistance test
- b) Earth continuity test
- c) Earth electrode resistance test

All necessary test instruments shall be arranged by the contractor.

10.0 GENERAL REQUIREMENTS OF COMPONENTS:

a) Quality of materials:

All materials shall be of such design, size, material and make as to satisfactorily function under the rated conditions of operation.

b) Ratings of components:

All components in a wiring installation, conductors, switches and accessories shall be of appropriate ratings of voltage, current, and frequency, as indicated in BOQ.

c) Conformity to Standards:

All components shall conform to relevant Indian Standard Specification, including amendments or revisions thereof up to the date of tender acceptance.

d) General Notes:

- i. All the items shall be brand new and shall bear BIS monogram, wherever specified.
- ii. Item shall be guaranteed for a period of one year from the date of installation of materials against any manufacturing defect or workmanship.

11.0 WIRES AND CABLES:

11.1 Wiring:

Conductors of wiring cables shall be of copper. The smallest size of conductor for various circuits including earthing shall be not less than as follows:

- a) 'Lighting': 1.5 sq. mm,
- b) 'Light Plug Point': 1.5 sq. mm,
- c) 'Circuit Wiring': 2.5 sq. mm,
- d) 'Power': 4 sq. mm,
- e) Sub-Main: 10 sq. mm,
- f) Main: 10 or 16 sq. mm depending on the installed load.

All wiring cables shall be FRLS, single core, multi-stranded, PVC insulated, unsheathed, 1100V grade, BIS marked & FIA & TAC approved, with flexible conductor.

11.2 Cables:

Cables shall be armoured, XLPE/PVC insulated and PVC sheathed power cables of 1100 V grade. They shall be fitted on wall surface/ Tray/False ceiling/False floor as required, clamping shall be with 1 mm thick saddle, wherever required.

12.0 PVC CONDUITS:

- a) All rigid conduit pipes shall be of medium duty PVC conduit of good quality and be BIS marked.
- b) The conduit wiring system shall be complete in all respects, including their accessories where a large number of control switches and/or fan regulators are required to be installed at one place, these shall be installed in more than one outlet box adjacent to each other for ease of maintenance.
- c) Bunching of cables:
Cables shall always be bunched so that the outgoing and return cables are drawn into the same conduit. Where the distribution is for three phase loads only, conductors for all the three phases and neutral wire shall be drawn in one conduit.

13.0 WIRING ACCESSORIES:

a) Control switches for points:

Control switches (single pole switches) carrying not more than 16A shall be modular type complete with plate, as specified, and the switch shall be " ON" when the knob is down. Control switch shall be placed only in the live conductor of the circuit. No single pole switch or fuse shall be inserted in the protective (earth) conductor, or earthed neutral conductor of the circuit.

b) Socket outlets:

6/16 pin Socket outlets shall be of shutter type modular complete with plate. These shall be rated either for 6A, or 6/16A combined. Combined 6 pin (6A/16A) socket outlet shall be provided in 'power' circuits wherever specified. 6A Socket outlets shall only be of 5 pin type; the earth pin shall be connected to earth through protective (loop earthing)

conductor. The control switches for 6A and 16A socket outlets shall be kept along with the socket outlets. Generally socket outlet shall be installed at a height of above 30 cm but below 130 cm from the floor level.

The layout of wiring shall be as approved by Engineer in Charge.

c) Switch box covers:

These shall be modular type of suitable size.

d) Ceiling rose – Only one flexible cord shall be connected per ceiling rose. For multiple pendants, each pendant shall have its own rose, or a specially designed rose shall be used.

14.0 FITTINGS:

Indoor type fittings specification:

Suspension mount and batten mount LED luminaire with all accessories and lamps, ready for installation as per the following description.

i) Optical system should provide all round glare and beam control. ii) Luminaire shall be as follows:

a) 1x4 (300 x 1200) size suspension type LED panel luminaire for rooms as detailed in SoQ.

b) 4 feet long (1200 mm) LED batten luminaire for passage/corridor as detailed in SoQ.

c) 2 feet long (600 mm) LED batten luminaire for washroom/toilet as detailed in SoQ.

iii) Luminaires shall be pre-wired up to the terminal block and fitted with High Performance driver (THD<10%) as standard, PF> 0.95; driver to conform to IS/IEC for safety/ performance.

iv) Luminaires shall be supplied with all standard accessories (including chains, brackets, mounting clamps etc.) for suspension and/or wall mounting.

v) Power supply: 230/240 V, 50 Hz, single phase

vi) The type of fittings shall be as specified in SOQ.

15.0 PRE-WIRED MCB DISTRIBUTION BOARDS:

Pre wired MCB DB's shall be provided where specified.

The complete board shall be factory fabricated and shall be duly pre-wired, ready for installation at site.

The board shall be of wall mounted, cubicle type construction, fabricated out of 1.6mm thick sheet steel, with stove enameled paint finish. The board shall be provided with a hinged cover of 1.6mm thick sheet steel on the front. Only the knob/dolly of the MCB's shall protrude out of the front covers through openings neatly machine made for the purpose. Knock out holes at the bottom, and detachable plate with knock out holes at the top of the board shall be provided.

VTPN and TPN DB shall also be provided with two nos. loose wire box and SPN DB shall be provided with one no. loose wire box as a compartment for the complete width and depth of the board, and of minimum height of 125mm in case of VTPN/TPN DB's, and 100 mm in case of SPN DB's.

Each distribution board shall be provided with a circuit list giving details of each circuit which it controls and the current rating of the circuit, and the size of the MCB. The board shall be complete with the following accessories:

a) 100 A copper bus bar(s) for MCB DBs

b) 250 A copper bus bar for VTPN DB (fitted with 160A MCCB)

c) Neutral link

d) Common earth bar

e) DIN bar for mounting MCB's

f) Screw type terminal connectors suitable for incoming and outgoing cables.

g) Earthing stud(s)

The board shall be fully prewired with single core PVC insulated copper conductors/insulated solid copper links, and terminated on to extended type terminal connectors, suitable for connections to the sizes of the respective conductors. All incoming and outgoing wiring to the pre wired MCB DB's shall be terminated only in extended terminal connectors to be provided within the DB. The terminal connectors shall therefore be so provided as to facilitate easy cable connections and subsequent maintenance. Connectors (Terminal blocks) are to be provided. A common copper earth bar shall be provided within the loose wire box. The common neutral bar as well as the terminal connectors shall, however, be provided within the main compartment just below the loose wire box.

16.0 MINIATURE CIRCUIT BREAKERS (MCB's):

'C' series MCB's shall be invariably used for all loads. Ratings (A), number of poles, type as MCB or isolator, etc. shall be as specified in the SOQ. The MCB's shall be of minimum 10KA rupturing capacity.

17.0 SWITCH BOARD LOCATIONS:

Switch boards shall be located as indicated on the drawings or as instructed by OIL's engineer. Switchboards should not be installed in places likely to be exposed to the weather. However exact location will be as per suitable available spaces. Unless otherwise specified, a switch board shall be installed so that its bottom is 1.30 m from the floor level. Switchboards shall be well clear of door openings and with an open (unimpeded) space in front of the switchboard for easy access.

Where it is required to terminate a number of casing capping or conduits on a board, it may be convenient to provide a suitable PVC adapter box for the purpose. Such boxes shall be provided with the prior approval of the Engineer-in-charge (Electrical) and this will not be paid for separately. No apparatus shall project beyond any edge of the panel.

18.0 FANS, REGULATORS AND CLAMPS:

Fan Regulators:

Electronic modular type fan regulator shall be of approved makes. The fans, regulators etc., are to be procured from authorized dealer to ensure genuineness of the material.

19.0 EARTHING:

Earthing shall be done with G.I. earth pipe 3 metre long, 100 mm dia (Conforming to BIS:1239) including accessories, and providing masonry enclosure with cover plate having locking arrangement and watering pipe etc. with charcoal/coke and salt as required.

G.I. Earth strap shall be supplied with the earth electrode for connecting the earth electrode to the equipment. Earth strap shall be terminated in the electrode/equipment with proper size of zinc coated nuts and bolts.

20.0 WORKMANSHIP:

Good workmanship is an essential requirement to be complied with. The entire work of manufacture/fabrication, assembly and installation shall conform to sound Engineering practice. The work shall be carried out under the direct supervision of a person holding a valid supervisor's certificate of

competency issued by the State Govt. for the type of work involved, employed by the contractor, who shall rectify then and there the defects pointed out by the Engineer -in-charge (Electrical) during the progress of work.

21.0 COMMISSIONING ON COMPLETION:

After the entire wiring is completed, a joint inspection shall be carried out. The contractor shall rectify the defects pointed out by OIL during inspection. The works shall be tested by the contractor and contractor shall submit the test certificates duly signed by the competent persons. The system shall be energized only after OIL approves the work done and submission of test certificate.

22.0 SUPPLY, INSTALLATION, TESTING AND COMMISSIONING OF LT PANEL:

a) The LT panel shall be 415 V AC, 50HZ indoor type panel with MCCBs as incomer and MCCBs as outgoing feeders, skid mounted ready for operation on being installed in a fixed position.

b) Standards:

All components used in the manufacture of the Panels shall conform to the relevant IEC/BIS standard specification. Few of the standards are mentioned as follows:

- i. IS: 13947-1993/IEC: 60947 General arrangements for switchgear and control gear for voltage not exceeding 1000 V
- ii. IS: 12063-1987/IEC: 60529 Degrees of Protection provided by enclosures of electrical Equipment
- iii. IS: 5/2004 Colour for ready mixed paints and enamel
- iv. IS: 732/1989 Code of Practice for Electrical Wiring Installations
- v. IS: 5039/1983 Distribution pillars for voltage not exceeding 1000 V
- vi. IS/IEC: 127-1994 Miniature Fuses- Fuse Holders for Miniature Cartridge Fuse Links - Specification
- vii. IS: 2551-1982 Danger Notice Plates
- viii. IEC: 60664 Insulation co-ordination within low voltage system including clearance creepage distances for equipment

c) The panel shall have:

- i) Incoming Feeders
- ii) Outgoing Feeders
- iii) Busbar

i) Incoming Feeders:

Incomer shall have 250 A, 4 pole, 50 kA moulded case circuit Breaker, 415V AC, 50Hz with microprocessor based O/C, S/C, E/F release: 2(Two) Nos. (with mechanical and electrical interlock)

Each Incomer shall have following features:

(a) Digital multifunction meter with accuracy class 0.5 and with RS-485 port with MODBUS protocol for data logging/downloading. The meter shall preferably be of size 96mm x 96mm and shall measure the following electrical parameters: Voltage, Current, Frequency, KVA, KVA_r, PF, KWH, and KVA_rh.

(b) Cast resin Current Transformer as per IS 2705 & IS 4201 and shall be sized adequately: 03 nos.

(c) LED Indication lights for 'Feeder ON', 'Feeder OFF' & 'TRIP': 03 nos.

(d) Moulded HRC Fuse Holders with HRC Fuses/MCBs for control circuit protection

(e) Rotary Handle for operating the MCCBs

(f) Protection type LSIgN

Ics = 100% Icu as per IEC 60947-2

Fault indication for GF (LED type) meant for human safety

Adjustable overload from 0.4 - 1 x I_n

Adjustable short circuit from 1.5 - 10 x I_r

Adjustable earth fault sensitivity selection 10 to 60%

ii) Outgoing Feeders:

Outgoing shall have MCCB of following ratings:

(a) 160 A, 4 pole, 36kA Moulded case circuit Breaker, 50Hz, 415V AC with microprocessor based O/C, S/C, E/F release: 4(four) nos.

Each outgoing feeder shall have following features:

(i) Digital Ammeter, 3 Phase with inbuilt selector switch: 1 Set

(ii) Cast resin Current Transformer as per IS 2705 & IS 4201 and adequately sized: 03 nos.

(iii) LED Indication lights for 'Feeder ON', 'Feeder OFF' & 'TRIP': 03 nos.

(iv) Moulded HRC Fuse Holders with HRC Fuses/MCBs for control circuit protection

(v) Extended rotary handle for operating the MCCBs.

(vi) Protection type LSIgN

Ics = 100% Icu as per IEC 60947-2

Fault indication for GF (LED type) meant for human safety

Adjustable overload from 0.36 - 1 x I_n

Adjustable short circuit from 1.5 - 10 x I_r

Adjustable earth fault sensitivity selection 10 to 60%

Innovative front indication LED's (Ready, Overload pre-alarm & Overload)

Suitable for 3P3W & 3P4W electrical distribution network

Adjustable neutral protection - N, N/2, OFF for 4 Pole MCCB

iii) Bus-Bar:

The bus chamber shall be sheet steel clad having front and rear bolted covers and shall consist of 1 set TP & N electrolytic grade, high conductivity Copper bus-bars, conforming to BIS. Current rating of bus bar sections 325 A, suitable for 415 V AC, 50 Hz system. Neutral bar shall be of same size as phase bus. The bus-bar shall be insulated with heat shrinkable PVC sleeves, make Raychem RPG or equivalent reputed make and shall be supported at required intervals with non- hygroscopic, non-deteriorating, and non-inflammable SMC / FRP Supports having adequate mechanical strength and a high tracking resistance, to withstand short circuit fault levels up to 50 kA for 1 sec.

All risers and connections from bus bar shall be carried out with same material as the main bus bars of current rating as per rating of individual cubicle switch. To suit the stringent site conditions, the bus bar system shall be designed with generous clearance between phases than specified in the standards. Adequate non-hygroscopic insulating sheet barriers between the bus chambers and feeders shall be provided. All necessary interconnection shall be duly tested as per IS: 8623

d) General Requirements and Constructional Details:

i. Panel shall be self-supporting, Indoor Type, dust, vermin/rodent proof, suitable for placing on a suitable RCC foundation. Any left holes/cable entries shall be blocked by using detachable metallic sheets to prevent entry of rodent/reptiles.

- ii. The structure of Panel shall be made with 2mm thick CRCA sheet and (75x40x6) mm base channel as required.
- iii. Heavy duty Lifting hooks (4 No's heavy duty lifting hooks) shall be provided for lifting of Panel.
- iv. The door shall be in parts and shall have locking arrangement with special type Knob type key. Danger Plate fitted on both sides.
- v. For cooling of the component louver arrangement shall be made in the Panel
- vi. Panel shall have a heavy duty base framework. The frame design shall be such that the height between cable entry plate and the connection hole of brought out link of incoming, outgoing MCCBs shall be minimum 450mm.
- vii. The entire sheet-work shall be given minimum nine tank anti-rust treatment as per IS and then powder coated in light grey shade no 631 as per IS: 631.
- viii. The design should be as per IS-8623, 13947, 13703, 4237 and IEC-61439 and suitable for ambient-40°C (Max)/ 5°C (Min), humidity-95% (Max). All components used must be suitable for the environment as mentioned.
- ix. All hardware should be of high tensile steel & Zinc passivated. Size of spring washers & flat washers should be as per relevant IS for individual bolt.
- x. All the components shall be mounted on separate steel plate with necessary stiffeners or suitable channels so that all the components can be checked and replaced from front side after opening the door.
- xi. All items will be labelled using riveted engraved metallic or mica labels.
- xii. All incoming and outgoing cables shall enter the enclosure from bottom side. Cable entry plate shall have individual detachable gland plates for all cables. These detachable plates shall be accessible and removable from inside. All cable entry plates shall have knockouts.

e) General Technical Requirements:

- i. All connection links between bus-bar and MCCBs & brought out links shall be made with rectangular sections of Aluminium confirming to IS 5082. Current rating of links shall be minimum 1.5 times (rating for unassembled sections) the device rating. Spreader bars supplied by MCCB manufacturer shall be used for all incoming and outgoing terminations for all MCCBs.
- ii. All control wiring shall be done with single core 2.5sqmm, FRLS PVC insulated, 1100v grade, IS approved stranded copper cable.
- iii. All control cable ends shall have crimped copper lugs for proper termination and ferrules for identification of wiring. All the control circuit wiring shall be connected with terminals blocks, ferrules for easy identification
- iv. All panel doors shall be earthed as per IS 3043.
- v. No bimetallic joints shall be permitted in the links of connections.
- vi. Special non-deteriorating Neoprene rubber gaskets shall be provided at panel doors.
- vii. Sufficient space should be provided for proper glanding, dressing, connecting up and maintenance of all cables. Sufficient nos. of cable entry holes shall be provided in the cable entry plate.
- viii. Protective shrouds of 4 mm thick hylam sheets shall be provided as insulation barriers between the bus chamber and feeders. Transparent fibreglass barriers shall also be provided on both incoming and outgoing side of all MCCBs.
- ix. A printed drawing of complete circuits shall be pasted on the outside of the inside of door of each feeder pillar.
- x. All items shall be duly fixed with zinc passivated high tension hard-wares. DIN channel shall be used for components having facility to mount on DIN channel.
- xi. All items of the Panel must be approved by ISI or IEC (with latest amendments) for performance and safety. 3 nos. MCB or fuse carrier and base with suitable fuse and fuse link shall be provided for power supply of multifunction meter. The auxiliary power supply of multifunction meter shall be 230 VAC.
- xii. Current transformer shall be cast resin type, with suitable specification.
- xiii. 2 No's passivated heavy duty type nuts and bolts shall be provided for connection of earthing on two opposite side.
- xiv. For all incoming and outgoing cable connection, brought out terminals shall be provided. Suitable size of single compression M.S cable gland of size mentioned in the point no.
- xv. For all incoming and outgoing cables along with Panel suitable size of holes shall be made into detachable gland plate for incoming and outgoing feeders. The cable gland is to be supplied and fitted in the Panel by bidder as per requirement of incoming and outgoing feeders.
- xvi. The Panel shall have provision for incoming and outgoing cable entries.

f) Name Plate and Marking:

1) Panel shall be provided with Aluminum /Stainless steel / Brass nameplate showing the following information indelibly marked in English:

- i. Manufacturer's Name
- ii. OIL's Purchase Order No. & date
- iii. Manufacturer's Serial Number

- iv. Year of Manufacture
- v. Rated Voltage Rating
- vi. No. of circuits (incoming & outgoing)
- vii. Rated Current of incoming circuit
- viii. Rated Current of outgoing circuit
- ix. Degree of protection

2) Danger Notice Plates:

Danger/Warning Notice plate as per IS 2551 shall be provided on the front and rear side of the feeder pillar using steel rivets. The language of the notice will be in English, Hindi and Assamese.

3) All feeders shall have engraved designation nameplates. Details of Feeder designation shall be provided by OIL.

g) Warranty:

The goods/equipment shall be of best quality and workmanship. Panel and all its components shall be warrantied for twelve (12) months from the date of commissioning against defects arising due to material, workmanship or design. The party shall agree to replace/repair the defective components at site at their cost during warranty period.

h) Drawing & Documents:

(a) Documents/drawings to be submitted after the award of the contract prior to supply:

- i) Copy of type test certificate conducted on similar type panel as per IS
- ii) GA drawing, SLD, termination details, wiring diagram and complete bill of material of the Panel shall be submitted to OIL for approval within 45 days after award of contract

(b) Documents/drawings to be submitted along with the supply (4 sets each):

- i) Approved GA drawing showing all details, including constructional detail and component layout for panels
- ii) Approved SLD & Schematic Diagram
- iii) Technical specification of all equipment including Manual/Catalogue/installation instructions etc.
- iv) Bill of Materials with technical details
- v) Routine, Acceptance & Type test certificates
- vi) Guarantee/warranty Certificate
- vii) List of recommended spares with pricing and part no. for two years operation

i) Pre-dispatch Inspection of Panel:

(a) OIL representatives shall carry out pre-dispatch inspection of the LT Panel and witness all necessary routine testing as per IS at manufacturer's works. Charges towards inspection and witness test, if any, shall be included in the price of the main equipment.

(b) Any alteration/modification requirements pointed out during the inspection shall be carried out by the manufacturer at no extra cost to OIL and confirmed before dispatch, without which dispatch clearance shall not be given.

j) Installation and Commissioning:

(a) Scope of Installation:

- i) Supplier shall install and commission the LT panel in the Electrical Room.
- ii) Supplier shall ensure proper earthing of the LT panel.
- iii) Supplier shall arrange for all the manpower, tools and tackles, instruments etc., necessary for installation and commissioning of the LT panel.

(b) Scope of Commissioning:

- i) Checking of the LT panel and indoor equipment for transit damage and rectification if any.
- ii) Cable connection from OIL's power source to LT panel and LT panel to all VTPN DBs.
- iii) Earthing connection from LT panel to electrode and measurement of earth resistance.
- iv) Testing of the equipment before energization (IR test and general checking), energization of the panel, operation checks.

v) Submission of testing and commissioning report

(c) General Notes on Installation & Commissioning:

- i) The commissioning works shall be done by the manufacturer or by the manufacturer's authorized party.
- ii) The bidder shall confirm that the jobs shall be carried out under the direct supervision of an Engineer/an electrical supervisor holding a valid Electrical supervisor certificate of competency issued by Govt. of Assam. The copy of certificate of competency should be submitted prior to the commencement of commissioning jobs.
- iii) The bidder shall obtain permit to work from OIL's Engineer before taking up commissioning works.
- iv) All masonry work/civil works for I&C of panel shall be in the scope of contractor

23.0 SUPPLY, INSTALLATION, TESTING AND COMMISSIONING OF VRF AIR CONDITIONING SYSTEM:

a) Supply

1) Variable Refrigerant Volume / Flow System:

Supply of Modular type outdoor units, with all multi scroll DC Inverter compressors for cooling & heating applications. The unit runs with inverter compressor only. All inverter capacity controlling compressors shall be suitable for 415 ± 10% volts, 50 Hz. special coated fins, panel, inverter based condenser fan M.S. hot dip galvanized stands / supports, electrical & microprocessor panel, isolating valves and all the necessary accessories for proper functioning of the units. All ODU's are having Hi- POR technology for Oil return mechanism to high pressure side and Active Refrigerant Control systems to increase efficiency and performance of the unit. The manufacturer must be OEM for this project and must have manufacturing and testing facility in India. Unit shall yield COP of 3.69 at 100% load at AHRI condition (Ambient 35 Deg DBT & Inside: 19Deg WBT). Condenser shall be capable to operate for outside ambient of 53 Deg C. All Outdoor unit must have "Ocean Black Fin " heat exchanger in the unit in dual layered & double sided with a black coating to shield it from Salt, Sand & other elements brought in by the air. The Manufacturer must be OEM for this project and must have manufacturing and testing facility in India.

1.1) Outdoor Unit:

a) 14 HP (2 nos.)

1.2) Indoor Units:

Supply of 4-Way Cassette unit of following Capacities. The unit is having inbuilt drain pump. The set includes IDU, Panel & Cordless Remote:

- a) Cassette Type 2.0 TR (1 no.)
- b) Cassette Type 3.0 TR (2 no.)
- c) Cassette Type 4.0 TR (3 nos.)
- d) Hi-wall Type 2.0 TR (3 nos.)
- e) Y- Joints for all units
- e) Copper piping & communication cable for the units (as per requirement)

2) Warranty:

- (a) Warranty of the entire unit shall be minimum one (1) year against any manufacturing defect from the date of commissioning.
- (b) Warranty of the compressors shall be minimum five (5) years against any manufacturing defect from the date of commissioning.

3) Documents:

- (a) Documents to be submitted after award of contract prior to supply of materials:
 - (i) Catalogue containing the features of offered make and model
 - (ii) Valid dealership certificate
- (b) Documents to be submitted at the time of supply:
 - (i) Duly signed warranty certificate
 - (ii) One set of operation/maintenance manual against each unit

b) Installation, Testing and Commissioning

- i. Installation, testing & commissioning of 28 HP VRV System with 100% DC Inverter Scroll Compressor, complete Indoor Unit as specified in equipment schedule along with low side works of Indoor installation, piping with nitrile insulation, drain pipe, nitrogen flushing, vacuuming, gas charging and balancing of the complete system.

- ii. All masonry work/civil works such as supports for the condensing units, cutting away and making good of RCC/PCC/ slabs and making & closing of trenches etc.
- iii. Power supply connection to all outdoor units from VTPN DB.
- iv. Power supply connection to all indoor units from 5 A switch sockets.
- v. Provision of drain points to be provided.
- vi. Any kind of false ceiling works, boxing work, wooden framework/carpentry work. Provisions of boxing, false ceiling and wooden frames for grills, if necessary and essential for the proper functioning of the systems.
- vii. Any under deck or over deck insulation, thermal or acoustic insulations works for false ceiling or walls etc. All air tight partitions above false ceiling.
- viii. Any kind of dismantling work.
- ix. Scaffolding of any kind to be provided.

C. The Make List of Electrical Items is enclosed as Appendix-I.

D. The 3D architectural view of the proposed Sangini Building is enclosed as Appendix-II.

E. CONTRACTOR'S RISKS:

All risks of loss of or damage to physical property and of physical injury and death to the personnel, which arise during the course of and in consequence of the performance of the contract, are the responsibility of the contractor.

F. INDEMNITY AND INSURANCE:

- 1. The contractor shall provide suitable insurance coverage from the date of issuance of work order to the end of defect liability period of the contract for the following events which are due to the contractor's risks, irrespective of whether such loss or damages are caused on account of negligence of the Contractor or their personnel.
 - a. Loss of or damage to the works plants and materials.
 - b. Loss of or damage to the equipment.
 - c. Loss of or damage of property (except the works, plant, materials & equipment) in connection with the contract.
 - d. Physical injury or death of all his manpower deployed by him.
- 2. In the event of any loss or damage, it shall be the responsibility of contractor to lodge the claim with insurer and Contractor shall put his best effort with the insurer for early settlement of the claim.
- 3. The policies and certificates for insurance shall be submitted by the contractor to the engineer in charge before the issuance of Work Order. In case, the Contractor fails to arrange the Insurance or arranges insufficient insurance, for the events, as mentioned above against any or all insurable risks, the Contractor shall be solely liable for loss or damage arising from such events or causes.
- 4. Contractor shall at his own expense arrange, secure, maintain and renew insurance for the events mentioned above throughout the contract period including the defect liability period.
- 5. Indemnity Agreement:
The contractor shall at all times indemnify and keep indemnified the Company and its personnel from and against all third party claims whatsoever, including but not limited to property loss and damage, personal accident, injury or death of or to property or person and any sub-contractor or agents of the contractor or Company.
- G. The contractor shall deposit the PAN and GST registration number (if applicable, as per Statutory GST Regulations) as and when required by the Company. If the above are not available with the contractor, the contractor must apply for the same after signing of the Contract and submit the same within 45 days of signing the contract (or as and when advised by the Company, after 45 days of signing the contract). Moreover, the statutory guidelines of Goods and Service Tax (GST) shall be adhered to by the contractor.
- H. A Hindrance Register shall be maintained in the enclosed Format to record all hindrances encountered during execution of works against the contract. The items of work affected due to any hindrance shall be clearly recorded in the Hindrance Register and the Engineer-in-charge of the Company as well as the site representative of the Contractor will sign on the register against the recorded hindrance. In case of encountering multiple hindrances

simultaneously over a period of time affecting the same item or different items, the net period of hindrance will be worked out considering the overlapping period.

- I. Company reserves the right to initiate actions against the bidder / contractor during processing of tender and / or during continuation of the contract as per OIL's Banning Policy dated 6th Jan 2017 available at OIL's website.
- J. Defect liability period shall be 6 months beyond the date of completion of works as certified by Engineer-In-Charge. During defect liability period, all corrective works shall be carried out entirely at Contractor's own expenses. If such corrective works are not carried out within a reasonable time, the Company, at its discretion, may have such remedial works carried out by other agencies and charge the cost thereof to the Contractor. This amount shall be deducted from contractor's bill/ Retention money/ Performance security.

WORKS CONTRACT

SCHEDULE OF COMPANY'S PLANTS, MATERIALS AND EQUIPMENT

- A. SCHEDULE OF MATERIALS AVAILABLE AT THE COMPANY'S STORES/STOCK PILES for permanent incorporation in works and
- B. SCHEDULE OF COMPANY'S PLANTS AND EQUIPMENT for use in the execution of work.
- 1) **MATERIALS:** Cement.
- 2) **PLANTS AND EQUIPMENT:** Nil.

NOTE:-

1. The Contractor is to arrange transportation of the above materials to site of work with proper safety.
2. Materials issued to Contractor must be under proper watch & ward so that no part is pilfered. If any pilferage takes place the matter will be referred to appropriate Govt. authorities for legal action as well as realization of the materials issued.
3. Cement issued to Contractor by the Company is meant only for the specific Company work relating to the Contract. However, if any quantity of Cement is left over from the quantities issued for any reason whatsoever, on the completion / cancellation / termination of the Contract the same shall have to be returned to the Company in full within one week of completion/cancellation of the work failing which the matter will be referred to appropriate Govt. authorities for legal action as well as realization of the Cement.
4. All other materials issue to the Contractor by the Company if subsequently found to be in excess of the actual requirement will have to be returned by the Contractor within two weeks of completion of the work failing which the cost of all such materials will be recovered from the Contractor at double the value of materials without any reference to him.
5. All empty Cement bags must be returned to company's Godown, Duliajan failing to which a sum of Rs.8.00 (Rupees Eight) only per bag will be recovered from contractors bill.

**To,
GM-CONTRACTS (HOD)
OIL INDIA LIMITED
DULIAJAN-786602**

SUB: SAFETY MEASURES

DESCRIPTION OF WORK/SERVICE: Construction of Double Storied Sangini Building with electrifications including supply of all materials except cement at Duliajan.

Sir,

We hereby confirm that we have fully understood the safety measures to be adopted during execution of the above contract and that the same have been explained to us by the concerned authorities. We also give the following assurances.

- a) Only experienced and competent persons shall be engaged by us for carrying out work under the said contract.
- b) The names of the authorized persons who would be supervising the jobs on day to day basis from our end are the following:
 - i) _____
 - ii) _____
 - iii) _____

The above personnel are fully familiar with the nature of jobs assigned and safety precautions required.

- c) Due notice would be given for any change of personnel under item (b) above.
- d) We hereby accept the responsibility for the safety of all the personnel engaged by us and for the safety of the Company's personnel and property involved during the course of our working under this contract. We would ensure that all the provisions under the Oil Mines Regulations, 2017 and other safety rules related to execution of our work would be strictly followed by our personnel. Any violation pointed out by the Company's Engineers would be rectified forthwith or the work suspended till such time the rectification is completed by us and all expenditure towards this would be on our account.
- e) We confirm that all persons engaged by us would be provided with the necessary Safety Gears at our cost.
- f) All losses caused due to inadequate safety measures or lack of supervision on our part would be fully compensated by us and the Company will not be responsible for any lapses on our part in this regard.
- g) We shall abide by the HSE (Health Safety & Environment) points mentioned in SCC.

(Seal)

Date_____

Yours Faithfully

M/s_____

CONTRACTOR

INTEGRITY PACT

Between

Oil India Limited (OIL) hereinafter referred to as "The Principal"

And

(Name of the bidder).....hereinafter referred to as "The Bidder/Contractor"

Preamble:

The Principal intends to award, under laid down organizational procedures, contract/s for **Construction of Double Storied Sangini Building with electrifications including supply of all materials except cement at Duliajan**. The Principal values full compliance with all relevant laws and regulations, and the principles of economic use of resources, and of fairness and transparency in its relations with its Bidder/s and Contractor/s.

In order to achieve these goals, the Principal cooperates with the renowned international Non-Governmental Organisation "Transparency International" (TI). Following TI's national and international experience, the Principal will appoint an external independent Monitor who will monitor the tender process and the execution of the contract for compliance with the principles mentioned above.

Section 1 - Commitments of the Principal

(1) The Principal commits itself to take all measures necessary to prevent Corruption and to observe the following principles:-

- I. No employee of the Principal, personally or through family members, will in connection with the tender for, or the execution of a contract, demand, take a promise for or accept, for him/herself or third person, any material or immaterial benefit which he/she is not legally entitled to.
- II. The Principal will, during the tender process treat all Bidders with equity and reason. The Principal will in particular, before and during the tender process, provide to all Bidders the same information and will not provide to any Bidder confidential/ additional information through which the Bidder could obtain an advantage in relation to the tender process or the contract execution.
- III. The Principal will exclude from the process all known prejudiced persons.

(2) If the Principal obtains information on the conduct of any of its employees which is a criminal offence under the relevant Anti-Corruption Laws of India, or if there be a substantive suspicion in this regard, the Principal will inform its Vigilance Office and in addition can initiate disciplinary actions.

Section 2 - Commitments of the Bidder/Contractor

(1) The Bidder/Contractor commits itself to take all measures necessary to prevent corruption. He commits himself to observe the following principles during his participation in the tender process and during the contract execution.

- I. The Bidder/Contractor will not, directly or through any other person or firm, offer, promise or give to any of the Principal's employees involved in the tender process or the execution of the contract or to any third person any material or immaterial benefit which he/she is not legally entitled to, in order to obtain in exchange any advantage of any kind whatsoever during the tender process or during the execution of the contract.
- II. The Bidder/Contractor will not enter with other Bidders into any undisclosed agreement or understanding, whether formal or informal. This applies in particular to prices, specifications, certifications, subsidiary contracts, submission or non-submission of bids or any other actions to restrict competitiveness or to introduce cartelisation in the bidding process.

- III. The Bidder/Contractor will not commit any offence under the relevant anticorruption Laws of India; further the Bidder/Contractor will not use improperly, for purposes of competition or personal gain, or pass on to others, any information or document provided by the Principal as part of the business relationship, regarding plans, technical proposals and business details, including information contained or transmitted electronically.
- IV. The Bidder/Contractor will, when presenting his bid, disclose any and all payments he has made, is committed to or intends to make to agents, brokers or any other intermediaries in connection with the award of the contract.
- V. Bidders to disclose any transgressions with any other company that may impinge on the anti-corruption principle.
- VI. The Bidder (s)/ Contractor of foreign origin shall disclose the name and address of the Agents/ representatives in India, if any. Similarly, the Bidder (s)/ Contractor (s) of Indian Nationality shall furnish the name and address of the foreign principals, if any. Further, all the payments made to the Indian agent/ representative have to be in India Rupees only.
- VII. Bidders not to pass any information provided by Principal as part of business relationship to others and not to commit any offence under PC/ IPC Act.
 - (2) The Bidder/Contractor will not instigate third persons to commit offences outlined above or be an accessory to such offences.
 - (3) The Bidder/Contractor signing Integrity Pact shall not approach the Courts while representing the matters to IEMs and he/she will await their decision in the matter.

Section 3 - Disqualification from tender process and exclusion from future Contracts

If the Bidder, before contract award has committed a transgression through a violation of Section 2 or in any other form such as to put his reliability or risibility as Bidder into question, the Principal is entitled to disqualify the Bidder from the tender process or to terminate the contract, if already signed, for such reason.

- 1. If the Bidder/Contractor has committed a transgression through a violation of Section 2 such as to put his reliability or credibility into question, the Principal is entitled also to exclude the Bidder/Contractor from future contract award processes. The imposition and duration of the exclusion will be determined by the severity of the transgression. The severity will be determined by the circumstances of the case, in particular the number of transgressions, the position of the transgressions within the company hierarchy of the Bidder and the amount of the damage. The exclusion will be imposed for a minimum of 6 months and maximum of 3 years.
- 2. The Bidder accepts and undertakes to respect and uphold the Principal's Absolute right to resort to and impose such exclusion and further accepts and undertakes not to challenge or question such exclusion on any ground, including the lack of any hearing before the decision to resort to such exclusion is taken. This undertaking is given freely and after obtaining independent legal advice.
- 3. If the Bidder/Contractor can prove that he has restored/recouped the Damage caused by him and has installed a suitable corruption prevention system, the Principal may revoke the exclusion prematurely.
- 4. A transgression is considered to have occurred if in light of available evidence no reasonable doubt is possible.
- 5. Integrity Pact, in respect of a particular contract, shall be operative from the date Integrity Pact is signed by both the parties till the final completion of the contract **or as mentioned in Section 9- Pact Duration whichever is later**. Any violation of the same would entail disqualification of the bidders and exclusion from future business dealings. Any issue relating to execution of contract, if specifically raised before the IEMs shall be looked into by IEMs.

Section 4 - Compensation for Damages

1. If the Principal has disqualified the Bidder from the tender process prior to the award according to Section 3, the Principal is entitled to demand and recover from the Bidder liquidated damages equivalent to Earnest Money Deposit / Bid Security.
2. If the Principal has terminated the contract according to Section 3, or if the Principal is entitled to terminate the contract according to section 3, the Principal shall be entitled to demand and recover from the Contractor liquidated damages equivalent to Security Deposit / Performance Bank Guarantee.
3. The bidder agrees and undertakes to pay the said amounts without protest or demur subject only to condition that if the Bidder/Contractor can prove and establish that the exclusion of the Bidder from the tender process or the termination of the contract after the contract award has caused no damage or less damage than the amount or the liquidated damages, the Bidder/Contractor shall compensate the Principal only to the extent of the damage in the amount proved.

Section 5 - Previous transgression

1. The Bidder declares that no previous transgression occurred in the last 3 years with any other Company in any country conforming to the TI approach or with any other Public Sector Enterprise in India that could justify his exclusion from the tender process.
2. If the Bidder makes incorrect statement on this subject, he can be disqualified from the tender process or the contract, if already awarded, can be terminated for such reason.

Section 6 - Equal treatment of all Bidders/Contractor/Subcontractors

1. The Principal will enter into Pacts on identical terms with all bidders and contractors.
2. The Bidder / Contractor undertake(s) to procure from all subcontractors a commitment in conformity with this Integrity Pact. The Bidder/Contractor shall be responsible for any violation(s) of the provisions laid down in this agreement/Pact by any of its sub-contractors/sub-vendors.
3. The Principal will disqualify from the tender process all bidders who do not sign this Pact or violate its provisions.

**Section 7 - Criminal charges against violating
Bidders/Contractors/Subcontractors**

If the Principal obtains knowledge of conduct of a Bidder, Contractor or Subcontractor, or of an employee or a representative or an associate of a Bidder, Contractor or Subcontractor, which constitutes corruption, or if the Principal has substantive suspicion in this regard, the Principal will inform the Vigilance Office.

**Section 8 - External Independent Monitor/Monitors
(three in number depending on the size of the contract)
(to be decided by the Chairperson of the Principal)**

1. The Principal appoints competent and credible external independent Monitor for this Pact. The task of the Monitor is to review independently and objectively, whether and to what extent the parties comply with the obligations under this agreement.
2. The Monitor is not subject to instructions by the representatives of the parties and performs his functions neutrally and independently. He reports to the Chairperson of the Board of the Principal.
3. The Contractor accepts that the Monitor has the right to access without restriction to all Project documentation of the Principal including that provided by the Contractor. The Contractor will also grant the Monitor, upon his request and demonstration of a valid interest, unrestricted and

unconditional access to his project documentation. The same is applicable to Subcontractors. The Monitor is under contractual obligation to treat the information and documents of the Bidder/Contractor/Subcontractor with confidentiality. However, the documents/ records/ information having National Security implications and those documents which have been classified as Secret/ Top Secret are not to be disclosed.

4. The Principal will provide to the Monitor sufficient information about all meetings among the parties related to the Project provided such meetings could have an impact on the contractual relations between the Principal and the Contractor. The parties offer to the Monitor the option to participate in such meetings.
5. As soon as the Monitor notices, or believes to notice, a violation of this agreement, he will so inform the Management of the Principal and request the Management to discontinue or heal the violation, or to take other relevant action. The monitor can in this regard submit non-binding recommendations. Beyond this, the Monitor has no right to demand from the parties that they act in a specific manner, refrain from action or tolerate action. However, the Independent External Monitor shall give an opportunity to the bidder / contractor to present its case before making its recommendations to the Principal.
6. The Monitor will submit a written report to the Chairperson of the Board of the Principal within 8 to 10 weeks from the date of reference or intimation to him by the 'Principal' and, should the occasion arise, submit proposals for correcting problematic situations.
7. If the Monitor has reported to the Chairperson of the Board a substantiated suspicion of an offence under relevant Anti-Corruption Laws of India, and the Chairperson has not, within reasonable time, taken visible action to proceed against such offence or reported it to the Vigilance Office, the Monitor may also transmit this information directly to the Central Vigilance Commissioner, Government of India.
8. The word 'Monitor' would include both singular and plural.
9. In case of any complaints referred under IP Program, the role of IEMs is advisory and would not be legally binding and it is restricted to resolving the issues raised by an intending bidder regarding any aspect of the tender which allegedly restricts competition or bias towards some bidder.

Section 9 - Pact Duration

This Pact begins when both parties have legally signed it. It expires for the Contractor 12 months after the last payment under the respective contract, and for all other Bidders 6 months after the contract has been awarded.

If any claim is made/ lodged during this time, the same shall be binding and continue to be valid despite the lapse of this pact as specified above, unless it is discharged/determined by Chairperson of the Principal.

Section 10 - Other provisions

1. This agreement is subject to Indian Law. Place of performance and jurisdiction is the Registered Office of the Principal, i.e. New Delhi. The Arbitration clause provided in the main tender document / contract shall not be applicable for any issue / dispute arising under Integrity Pact.
2. Changes and supplements as well as termination notices need to be made in writing. Side agreements have not been made.
3. If the Contractor/ bidder is a Joint Venture or a partnership concern or a consortium, this agreement must be, signed by all partners or consortium members. In case of sub-contracting, the Principal contractor shall take the responsibility of the adoption of IP by the sub-contractor and all sub-contractors shall also sign the IP.

4. Should one or several provisions of this agreement turn out to be invalid, the remainder of this agreement remains valid. In this case, the parties will strive to come to an agreement to their original intentions.
5. Issues like warranty/ guarantee, etc. shall be outside the purview of IEMs.

For the Principal

for the Bidder/Contractor

Place: Duliajan.

Witness 1:

Date:

Witness 2:

(Note: Uploading in the OIL's e-portal with digital signature will be construed that the same has been signed by the bidder's authorized signatory who has signed the bid).

UNDERTAKING BY BIDDER IN RESPECT OF QUOTED PRICE

I/We do hereby solemnly affirm and declare as under:

- a) That I/we have gone through all the tender documents (i) Covering Letter (ii) BEC/BRC (iii) GCC (iv) SOQ (iv) SCC (v) SCPME (vi) SM (vii) IP and agree with all the terms and conditions provided there in.
- b) That I/we hereby offer to execute the work described above at the price quoted in the “Total Bid Value” (under RFx Information > Basic Data > Total Bid Value) inclusive of all liabilities including statutory liabilities except PF & GST in accordance with the Contract Terms & Conditions, which I/ we have fully understood.

(Note: Uploading in the OIL’s e-portal with digital signature will be construed that the same has been signed by the bidder’s authorized signatory who has signed the bid).

(TO BE TYPED ON THE OFFICIAL LETTER HEAD OF THE BIDDER)

To,
Oil India Limited
Contracts Department
Duliajan, Assam - 786602

Sub: UNDERTAKING/DECLARATION BY THE BIDDER (S) IN RESPECT OF TENDER NO. CDC9159P22

(To be submitted by the Bidders who are not covered under EPF&MP Act, 1952)

Dear Sirs,

This is in connection with the Bid submitted by(Name of the Bidder) against Tenderfor(subject of the Tender). As per the conditions stipulated in Clause no.....(Name of the Provision/Covering Letter etc.), we/I ,being authorized on behalf of(Name of the Contractor) hereby confirm and undertake as follows;

- That our Firm/Company shall be responsible to comply with all the applicable labour laws in respect of the present Contract.
- That we are fully conversant with the applicable laws and confirm that our Firm/Company is not covered under the Employees Provident Funds and Misc. Provisions Act, 1952 and applicable Rules there under, and therefore I we have not obtained any registration or Provident Fund Code under the Act.
- That if, during the period of the present Contract, we/our Firm /Company comes within the coverage of the aforesaid Acts or any other statutes; we shall comply with the same and submit the necessary documents to OIL. We further confirm that we will indemnify OIL towards any future statutory compliances/claims raised from any corner including statutory authorities against the Labour engaged by our Firm/Company in the Contract.
- That in the event of any contravention towards the applicable laws found on our part in respect of the present Contract, we undertake to indemnify OIL and deposit the claims, if any.
- That we shall fulfill all the obligations arising from under the labour laws in force from time to time and keep OIL indemnified against any loss/liability arising out of failure of our avoiding the laws.

We, further agree and undertake that in case of any violation of the above undertaking, OIL shall be at liberty to take appropriate action against us in terms of the Tender including but not limited to termination of contract and debarment from future business with OIL.

I/We declare that the information given above is true and any misstatement or misrepresentation or suppression of facts in connection with the above undertaking may entail rejection of the bid and cancellation of contract, if awarded.

Yours faithfully,

1. Authorized Signatory _____
(BIDDER)

Place:-

Date:-

CERTIFICATE OF ANNUAL TURNOVER & NET WORTH

TO BE ISSUED BY PRACTISING CHARTERED ACCOUNTANTS' FIRM ON THEIR LETTER HEAD

TO WHOM IT MAY CONCERN

This is to certify that the following financial positions extracted from the audited financial statements of M/s..... (Name of the Bidder) bearing PAN for the last three (3) completed accounting years upto(as the case may be) are correct.

YEAR	TURN OVER In INR (Rs.)	NET WORTH In INR (Rs.)

Place:

Date:

Seal:

UDIN:

Membership No. :

Registration Code. :

Signature

BID SECURITY DECLARATION

(To be submitted on Bidder's letter head)

**To,
Oil India Limited
Contracts Department
Duliajan, Assam - 786602**

Sub: BID SECURITY DECLARATION IN RESPECT OF TENDER NO. **CDC9159P22**

Dear Sirs,

I/We, the undersigned, declare that:

- 1.0 I/We understand that, according to your Tender conditions, bids must be supported by a 'Bid Security' in the form of a 'Bid-Securing Declaration'.
- 2.0 I/We the undersigned hereby declare that if we withdraw or modify our Bids during the period of its validity, or if we are awarded the contract and fail to sign the contract; we will be suspended for a period of two years. This suspension of two years shall be automatic without conducting any enquiry.

Yours faithfully,

For (Name of the firm _____)

Signature of Authorised Signatory

Name:

Designation:

Place:

Date:

(Affix Seal of the Organization here)

Annexure-IV

Format of Undertaking by bidders to declare percentage of Local Content in works offered
(To be submitted on Bidder's letter head)

To,
Oil India Limited
Contracts Department
Duliajan, Assam - 786602

Sub: PURCHASE PREFERENCE POLICY (LINKED WITH LOCAL CONTENT) (PP-LC):

Dear Sirs,

I/We _____ (Name of the bidder) undertake that we meet the mandatory minimum Local Content (LC) requirement i.e. 50 % as per Clause No. 2.5 & 4.4 (a) of the policy vide Letter No. FP-20013/2/2017-FP-PNG dated 17th November, 2020 of MoPNG to bid against **Tender No. CDC9159P22.**

The percentage of local content in the bid is _____%.

Yours faithfully,

For (**Name of the firm** _____)

Signature of Authorised Signatory/ POA

Name:

Designation:

Place:

Date:

(Affix Seal of the Organization here)

ANNEXURE V - FORMAT FOR HINDRANCE REGISTER

Description of Project : Contract No. & Date :

Contractor's Name : Scheduled Completion Date :

Sl. No.	Nature of Hindrance	Items of work that could not be executed because of this hindrance	Date of start of hindrance	Date of Removal of hindrance	Period of hindrance	Overlapping Period, if any	Net hindrance days	Remarks
Signature of Contractor's Representative			Signature of Engineer-in-charge			Signature of HoD		

Annexure- VI

Format of undertaking by Bidders towards submission of authentic information/documents

(To be typed on the official letter head of the bidder)

Sub: Undertaking of authenticity of information/documents submitted

Ref: Your Tender No. CDC9159P22

To,
Oil India Limited
Contracts Department
Duliajan, Assam – 786602

Dear Sirs,

With reference to our quotation against your above-referred tender, we hereby undertake that no fraudulent information/documents have been submitted by us.

We take full responsibility for the submission of authentic information/documents against the above cited bid.

We also agree that, during any stage of the tender/contract agreement, in case any of the information/documents submitted by us are found to be false/forged/fraudulent, OIL has right to reject our bid at any stage including forfeiture of our EMD and/or PBG and/or cancel the award of contract and/or carry out any other penal action on us, as deemed fit.

Yours faithfully,

For (Name of the firm _____)

Signature of Authorised Signatory

Name:

Designation:

Phone No.:

Place:

Date:

(Affix Seal of the Organization here)

Annexure- VII

**TO BE EXECUTED ON THE OFFICIAL LETTER HEAD OF THE BIDDER BY
THE AUTHORIZED SIGNATORY OF THE BIDDER**

Certificate of compliance of Financial Criteria in respect of Tender No. CDC9159P22

I the authorized signatory(s) of
..... (Bidder's/ Firm's name) do hereby
solemnly affirm and declare as under:-

**The Balance Sheet/Financial Statements for the financial year 2020-2021 has actually
not been audited as on the Original Bid closing Date.**

Yours faithfully,

For (Name of the firm _____)

Signature of the authorized signatory

Name of bidder/ firm:

Designation:

Place:

Date:

(Affix Seal of the Organization here)

Note to bidders: This certificate is to be issued only considering the time required for preparation of Financial Statements i.e. if the last date of preceding financial / accounting year falls within the preceding six months reckoned from the Original Bid Closing Date. In case of extension of due date for Tax Audit for the preceding financial/ accounting year, the Undertaking shall be applicable only if the original bid closing date falls within the extended period.

Make List of Electrical Items

SL No	Item Description	Approved make
1	All Cables and Wires	FINOLEX/HAVELLS /L&T/POLYCAB/RR KABEL
2	Copper lugs	DOWELL/3D-BILLET/JAINEX/SCHNEIDER
3	Metal clad switch-socket unit, 20 Amps	LEGRAND/SCHNEIDER/SIEMENS/ HAVELLS/ INDO-ASIAN
4	Ceiling fan, 1400 mm Sweep, White in Colour	HAVELLS/BAJAJ/ORIENT /USHA/CROMPTON GREAVES/PHILIPS
5	LIGHT FITTINGS (including Drivers and all accessories as required)	PHILIPS /CROMPTON/GE/BAJAJ/ HAVELLS/ JAQUAR
6	All MCCB	INDO ASIAN/LEGRAND/SIEMENS / ABB /L&T/SCHNEIDER
7	All MCB DB Note: MCB DB and MCBs/RCBO fitted therein have to be of same make.	ABB/INDO-ASIAN/L&T/ SCHNEIDER/ SIEMENS/LEGRAND
8	VTPN DB Note: VTPN DB and all components fitted therein have to be of same make.	ABB/INDO-ASIAN/L&T/ SCHNEIDER/ SIEMENS/LEGRAND
9	Modular switches/Socket/Box/ Blank plate	LEGRAND/SCHNEIDER/CRABTREE INDOASIAN ELVIRA/HAVELLS
10	Modular Fan regulator 100W and modular regulator	LEGRAND/SCHNEIDER/CRABTREE INDOASIAN ELVIRA/HAVELLS
11	Metal GI Box	LEGRAND/SCHNEIDER/CRABTREE INDOASIAN ELVIRA/HAVELLS
12	Metal enclosure for MCB	LEGRAND/SCHNEIDER/SIEMENS INDOASIAN/L&T
13	GI Pipe for earthing	JINDAL/TATA
14	Digital Earth Leakage Relay with CBCT	LEGRAND/SCHNEIDER/GE/PROKDV'S/NIC
15	Digital Multifunction Meter	SCHNEIDER POWER LOGIC PM200 SERIES/HPL- SOCOMEC/ SIEMENS /SECURE
16	Digital Ammeter with inbuilt selector switch	SCHNEIDER ELECTRIC/ HPL/ LT/SIEMENS
17	Current Transformer	KAPPA/ PRECISE ELECTRICAL/ PRAGATI ELECTRICAL/ SIEMENS/L&T/SCHNEIDER ELECTRIC
18	LED indication lamp	BINAY/TECNIC/L&T/SIEMENS
19	HRC Fuse	GE/ SIEMENS/ L&T/ SCHNEIDER/ COOPER BUSSMAN
20	VRF Air Conditioning System	VOLTAS/BLUE STAR/ SAMSUNG/ CARRIER/ LLOYD/ HAIER/ LG ELECTRONICS



