



OIL INDIA LIMITED
(A Govt. of India Enterprise)
P.O. DULIAJAN, DIST - DIBRUGARH
ASSAM, INDIA, PIN-786602

CONTRACTS DEPARTMENT
TEL: (91) 374-2800548
E-mail: contracts@oilindia.in
Website: www.oil-india.com
FAX: (91) 374-2803549

FORWARDING LETTER

Sub: IFB No. CDO4173P21 – Hiring of services for Comprehensive Annual Maintenance Contract (CAMC) for the new facilities installed post M B Lal Committee recommendations in Moran Tank Farm for a period of 2 (two) years extendable by 1 (one) year.

Dear Sir(s),

1.0 OIL INDIA LIMITED (OIL), a “Navaratna” Category, Government of India Enterprise, is a premier Oil Company engaged in exploration, production and transportation of crude oil & natural gas with its Headquarters at Duliajan, Assam. Duliajan is well connected by Air with nearest Airport being at Dibrugarh, 45 km away.

2.0 In connection with its operations, OIL invites Local Competitive Bids (LCB) from competent and experienced/approved Contractors/Firms for the mentioned work/service under **OPEN E-TENDER, SINGLE STAGE TWO BID SYSTEM** through OIL’s E-Procurement Portal: “<https://etender.srm.oilindia.in/iri/portal>” for **Hiring of services for Comprehensive Annual Maintenance Contract (CAMC) for the new facilities installed post M B Lal Committee recommendations in Moran Tank Farm for a period of 2 (two) years extendable by 1 (one) year.** One complete set of Bid Document covering OIL's IFB for hiring of above services is uploaded in OIL’s E-Procurement Portal. You are invited to submit your most competitive bid on or before the scheduled bid closing date and time through OIL’s E-Procurement Portal. For your ready reference, few salient points of the IFB (covered in detail in the Bid Document) are highlighted below:

(i)	IFB No./E-Tender No.	:	CDO4173P21
(ii)	Type of Bid	:	Open Indigenous E-Tender, Single Stage Two Bid System.
(iii)	Bid Closing Date & Time	:	As mentioned in the E-procurement portal.
(iv)	Technical Bid Opening Date & Time	:	As mentioned in the E-procurement portal.
(v)	Price Bid Opening Date & Time	:	As mentioned in the E-procurement portal.
(vi)	Bid Submission Mode	:	Bids must be uploaded online in OIL’s E-Procurement Portal.

(vii)	Bid Opening Place	:	Office of CGM (Contracts), Contracts Department, Oil India Limited, Duliajan-786602, Assam, India.
(viii)	Bid Validity	:	<p>Minimum 120 (One Hundred Twenty) days from Original Bid Closing Date.</p> <p>Note: In exceptional circumstances, OIL may solicit the Bidder's consent to an extension of the period of validity. The request and the response thereto shall be made in writing (or by Fax). A Bidder may refuse the request without forfeiting its Bid Security. A Bidder granting the request will neither be required nor permitted to modify their bid.</p>
(ix)	Mobilization Period	:	<p>Personnel's & Consumables: 30 (Thirty) days from the date of issue of LOA.</p> <p>Mandatory Spares: 60 (Sixty) days from the date of issue of LOA.</p>
(x)	Bid Security/EMD Amount	:	<p>Rs. 5,64,700.00 (Rupees Five Lakh Sixty Four Thousand and Seven Hundred only).</p> <p>a. The Bid Security should be submitted only in the form of Bank Guarantee as per BG format enclosed herewith (Proforma-V) issued by Nationalized/Scheduled Bank in favour of M/s Oil India Limited and payable at DULIAJAN.</p> <p>b. Alternately, Bid Security can also be paid through the online payment gateway against this tender.</p> <p>c. In case of Bidder(s) submitting Bid Security in the form of Bank Guarantee, the original hard copy of Bid Security should reach the office of CGM (CONTRACTS) on or before 12.45 PM (IST) on the bid closing/opening date otherwise bid will be rejected.</p> <p>d. A scanned copy of Bid Security document should also be uploaded along with the Un-priced Techno-Commercial Bid documents.</p> <p>e. This Bid Security Deposit shall be refunded to all unsuccessful bidders, but is liable to be</p>

			<p>forfeited in full or part, at Company's discretion, as per Clause No. 9.0 below. Bids without Bid Security Deposit in the manner specified above will be summarily rejected.</p> <p>No other mode of payment will be accepted by the Company. The Bid Security shall not earn any interest to the bidder from the Company.</p> <p>Notes:</p> <p>Bidders claiming waiver of Bid Security shall upload supporting documents as mentioned in Para. No. 4.0 below.</p> <p>Any offer not accompanied with the Bid Security shall be treated as invalid and summarily rejected. Any subsequent deposit of Bid Security after the bid closing date shall not be permitted. Also, adjustment of Bid Security due against the instant tender, against dues from the Company or on any account shall not be permitted.</p>
(xi)	Bid Security/EMD Validity	:	<p>As mentioned in the E-procurement portal.</p> <p>(Minimum 150 days from original bid closing date).</p>
(xii)	Original Bid Security to be submitted	:	<p>Office of CGM (CONTRACTS), CONTRACTS DEPARTMENT, OIL INDIA LIMITED, DULIAJAN, ASSAM-786602, INDIA</p>
(xiii)	Amount of Performance Security	:	<p>10% of annualized Contract value.</p> <p>a. Bidders can submit performance Security in the form of Bank Guarantee from any Scheduled Indian Bank as per BG format enclosed herewith (Proforma-VII) or in the form of Demand Draft.</p> <p>b. Performance Security Money shall not earn any interest.</p>
(xiv)	Validity of Performance Security	:	<p>90 days beyond contract period/duration.</p>
(xv)	Location of job		<p>Moran Tank Farm</p>
(xvi)	Duration of the Contract	:	<p>2 (two) years with a provision for extension by 1</p>

			(one) year.
(xvii)	Quantum of Liquidated Damage for Default in Timely Mobilization/ Completion	:	Refer clause No. 28 of General Conditions of Contract.
(xviii)	Bids to be addressed to	:	CGM (Contracts), Contracts Department, Oil India Limited, Duliajan-786602, Assam, India.
(xix)	Pre-Bid conference	:	Not Applicable
(xx)	Last Date of receipt of Queries	:	Not Applicable

Note:

a. The Bank Guarantee issuing bank branch shall ensure the following:

The Bank Guarantee issued by the bank shall be routed through SFMS platform as per the following details:

- (i) MT 760 / MT 760 COV for issuance of Bank Guarantee
- (ii) MT 760 / MT 767 COV for amendment of Bank Guarantee

The above message / intimation shall be sent through SFMS by the BG issuing Bank branch to HDFC Bank, Duliajan Branch, IFS Code – HDFC0002118; SWIFT Code - HDFCINBBICAL. Branch Address: HDFC Bank Limited, Duliajan Branch, Utopia Complex, BOC Gate, Jayanagar, Duliajan, Dibrugarh, PIN – 786602.

b. Bank Guarantee issued by a Scheduled Bank in India at the request of some other Non-Scheduled Bank of India shall not be acceptable.

3.0 GUIDELINES FOR PARTICIPATING IN OIL'S E-PROCUREMENT

3.1 Bids are to be submitted online through OIL's E-Procurement Portal with digital signature. To participate in OIL's E-Procurement tender, bidders should have a legally valid digital certificate **of Class 3 with Organizations Name** and **Encryption Certificate** as per Indian IT Act from the licensed Certifying Authorities operating under the Root Certifying Authority of India (RCAI), Controller of Certifying Authorities (CCA) of India (<http://www.cca.gov.in>). Digital Signature Certificates having "**Organization Name**" field other than **Bidder's Name** are not acceptable. However, aforesaid Digital Signature Certificates having Bidder's Name in the "Organization Name" field are acceptable.

Encryption certificate is mandatorily required for submission of bid. In case bidder creates response with one certificate (using encryption key) and then the bidder changes his Digital Signature Certificate, then the old certificate (used for encryption) is required in order to decrypt his encrypted response for getting the edit mode of the response. Once decryption is done, bidder may use new DSC certificate for uploading and submission of their offer. It is the sole responsibility of the bidder to keep their DSC certificate properly. In case of loss of the certificate, OIL INDIA LTD. is not responsible.

The authenticity of above digital signature shall be verified through authorized CA after bid opening and in case the digital signature used for signing is not of “**Class 3 with Organizations Name and Encryption Certificate**”, the bid will be rejected.

Bidder is responsible for ensuring the validity of digital signature and its proper usage by their employee.

The bid including all uploaded documents shall be digitally signed by duly authorized representative of the bidding company.

The bid including all uploaded documents shall be digitally signed by duly authorized representative of the Bidder/Bidding Company to bind the Bidder/Bidding company to the contract.

3.2 For participation, applicants already having User ID & Password for OIL’s E-Procurement Portal need to register against the IFB. New vendors/existing vendors not having User ID & Password for OIL’s E-Procurement Portal shall obtain User ID & password through online vendor registration system in E-Portal.

3.2.1 Bidders without having E-Tender Login ID and password should complete their online registration at least 07 (Seven) days prior to the scheduled Bid Closing Date and time of the tender. For online registration, bidder may visit OIL’s E-Tender site <https://etender.srm.oilindia.in/irj/portal>.

3.2.2 Necessary Login ID & Password will be issued by OIL only after submitting the complete online registration by the Bidder. In the event of late registration/incomplete registration by Bidder, OIL INDIA LIMITED shall not be responsible for late allotment of User ID & Password and request for bid closing date extension on that plea shall not be entertained by Company.

3.3 Parties, who do not have a User ID, can click on **Guest** login button in the E-portal to view and download the tender. **The detailed guidelines are available in OIL’s E-Procurement site (Help Documentation).** For any clarification in this regard, bidders may contact E-Tender Support Cell at Duliajan at erp_mm@oilindia.in, Ph.: 0374- 2807178/4903.

3.4 Details of process for submission of Bid Security (EMD) through the online payment gateway are available in Vendor User Manual under E-Procurement Portal. (**Note:** Important Points for on-line Payment can be viewed at Oil India's website at url: <http://oil-india.com/pdf/ETenderNotification.pdf>).

3.5 The link to OIL’s E-Procurement Portal has been provided through OIL’s web site (www.oil-india.com).

4.0 EXEMPTION FROM BID SECURITY PAYMENT: In case any bidder is exempted from paying the Bid security, they should request OIL with supporting documents. The detailed guidelines for exemption of the Bid security are given below.

- a) MSEs Units (manufacturers/Service Providers only and not their dealers/ distributors) who are already registered with District Industry Centres or Khadi & Village Industries Commission or Khadi & Village Industries Board or Coir Board or National Small Industries Corporation or Directorate of Handicrafts & Handloom or Udyog Aadhaar

Memorandum or any other body specified by Ministry of MSME are exempted from payment of Bid Security (EMD) irrespective of monetary limit mentioned in their registration.

- b) Central Government Departments and Central Public Sector Undertakings (CPSUs) are also exempted from submitting bid security.
- c) In case bidding MSE is owned by Schedule Caste or Schedule Tribe entrepreneur, valid documentary evidence issued by the agency who has registered the bidder as MSE owned by SC/ST entrepreneur should also be enclosed.
- d) Bids without EMD shall be rejected, if the technical offer does not include a valid copy of relevant MSE Certificate issued by appropriate authority.

5.0 Bid should be submitted online in OIL's E-Procurement site up to **11.00 AM (IST) (Server Time)** on the date as mentioned and will be opened on the same day at **2.00 PM (IST)** at the office of the CGM (Contracts) in presence of the authorized representatives of the bidders.

6.0 The rates shall be quoted per unit as specified in the **"PRICE BIDDING FORMAT"** attached under **"Notes and Attachments"** tab. Bidder should note that no pricing information is furnished in the **"Technical Attachment"** (Un-priced Techno-Commercial Bid) otherwise the bid will be rejected.

7.0 The tender is invited under **OPEN E-TENDER SINGLE STAGE TWO BID SYSTEM**. The bidder has to submit both the **"TECHNICAL"** and **"PRICED"** bid through electronic form in the OIL's E-Tender portal within the Bid Closing Date and Time stipulated in the E-Tender. For submission of Bids online at OIL's E-Tender Portal, detailed instructions are available in "User Manual" available in OIL's E-Tender Portal. The Technical Bid should be submitted as per Scope of Work & Technical Specifications along with all technical documents related to the tender and uploaded under **"Technical Attachment"** Tab only. **Bidders to note that no price details should be uploaded in "Technical Attachment" Tab Page.** The Price Bid rates shall be quoted per unit as specified in the **"PRICE BIDDING FORMAT"** attached under **"Notes and Attachments"** tab in the main bidding engine of OIL's E-Tender portal. The price quoted in the **"PRICE BIDDING FORMAT"** will only be considered for evaluation.

8.0 The Company reserves the right to reject any or all the tenders or accept any tender without assigning any reason.

9.0 (a) No Bidder can withdraw his bid within the validity or extended validity of the bid. Withdrawal of any bid within validity period will lead to forfeiture of his/her/their Bid Security Deposit in full and debar from participation in future tenders, at the sole discretion of the company.

(b) Once a withdrawal letter is received from any bidder, the offer will be treated as withdrawn and no further claim/correspondence will be entertained in this regard.

10.0 Conditional bids are liable to be rejected at the discretion of the Company.

11.0 The bidders are required to furnish the composition and status of ownership of the firm in whose name bid documents have been purchased/issued along with one or more of the following documentary evidences (which are applicable to the bidder) in support of the same and scanned copies of the same should be uploaded along with the Un-priced Techno-Commercial Bid documents.

11.1 In case of Sole Proprietorship Firm, Copies of Telephone/Electricity/Mobile Bill, PAN card, latest Income Tax Return form indicating therein the name, business and residential address, E-mail and telephone numbers of the owner and GSTIN number.

11.2 In case of HUF, Copies of Telephone/Electricity/Mobile Bill, PAN card, latest Income Tax Return form, Family Arrangement indicating therein the name, residential address, E-mail and telephone numbers of the owners in general and Karta in particular and GSTIN number.

11.3 In case of Partnership Firm, Copies of Telephone/Electricity/Mobile Bill, PAN card, latest Income Tax Return form indicating therein the name, residential address, E-mail and telephone numbers of all the partners (including the Managing Partner), registered partnership agreement/deed and GSTIN number.

11.4 In case of Co-Operative Societies, Copies of Telephone/Electricity/Mobile Bill, PAN card, latest Income Tax Return form indicating therein the name, residential address, E-mail and telephone numbers of all the Directors or persons who are at the helm of affairs, registration certificate from Registrar of Co-Operative Societies and GSTIN number.

11.5 In case of Societies registered under the Societies Registration Act, Copies of Telephone/Electricity/Mobile Bill, PAN card, latest Income Tax Return form indicating therein the name, residential address, E-mail and telephone numbers of all the Directors or persons who are at the helm of affairs, registration certificate from the Registrar of the state and GSTIN number.

11.6 In case of Joint Stock Companies registered under the Indian Companies Act, Copies of Telephone/Electricity/Mobile Bill, PAN card, latest Income Tax Return form indicating therein the name, residential address, E-mail and telephone numbers of all the Directors or persons who are at the helm of affairs, Certificate of Incorporation from the Registrar of Companies, Memorandum and Articles and GSTIN number.

11.7 In case of Trusts registered under the Indian Trust Act, Copies of Telephone/Electricity/Mobile Bill, PAN card, latest Income Tax Return form indicating therein the name, residential address, E-mail and telephone numbers of all the Trustee or persons who are at the helm of affairs, registration certificate from the Registrar of the state, Trust Deed and GSTIN number.

12.0 BIDDING DOCUMENTS:

12.1 The services required, bidding procedures and contract terms are prescribed in the Bidding Documents. This Bidding Document includes the following:

- a) A forwarding letter highlighting the following points:
 - (i) Company's IFB No.
 - (ii) Description of Service

- (iii) Bid closing date and time
- (iv) Bid opening date, time and place
- (v) Bid submission place
- (vi) The amount of Bid Security
- (vii) The amount of Performance Guarantee
- b) BEC/BRC
- c) General Conditions of Contract (GCC): **Part-I**
- d) Schedule of Work, Unit, Quantities (SOQ): **Part- II**
- e) Special Conditions of Contract (SCC): **Part-III**
- f) Schedule of Company's Plants, Materials and Equipments (SCPME): **Part-IV**
[Not applicable for this Tender]
- g) Safety Measures (SM): **Part-V**
- h) Integrity Pact: **Part-VI**
- i) Price Bidding Format (Attached under “**Notes and Attachments**” tab in the main bidding engine of OIL’s E-Tender portal)
- j) Proformas and Annexures
- k) Technical Evaluation Sheet for BEC-BRC & others

12.2 The bidder is expected to examine all instructions, forms, terms and specifications in the Bid document. Failure to furnish all information required in the Bidding Documents or submission of a bid not substantially responsive to the Bidding Documents in every respect will be at the Bidder's risk & responsibility and may result in the rejection of its bid without seeking any clarifications.

SPECIAL NOTE: Please note that all tender forms (Forwarding Letter, (BEC-BRC) Bid Evaluation Criteria & Bid Rejection Criteria, Part-I: (GCC) General Conditions of Contract, Part-II: (SOQ) Schedule of Work, Unit and Quantity, Part-III: (SCC) Special Conditions of Contract, Part-V: (SM) Safety Measures, Part-VI: (IP) Integrity Pact, Price Bidding Format, Technical Evaluation Sheet for BEC-BRC & others) and supporting documents are to be submitted through OIL’s E-Procurement site only except following documents which are to be submitted manually in sealed envelope super scribed with Tender No. and due date to The CGM (Contracts), Contracts Department, Oil India Limited, Duliajan-786602.

a) ORIGINAL BID SECURITY (Only in case of Bidder(s) submitting Bid Security in the form of BANK GUARANTEE):

A scanned copy of Bid Security should also be uploaded along with the Un-priced Techno-Commercial Bid documents.

b) ANY OTHER DOCUMENT REQUIRED TO BE SUBMITTED IN ORIGINAL AS PER TENDER REQUIREMENT:

Scanned copy(s) of the same should also be uploaded along with the Un-priced Techno-Commercial Bid documents.

The above documents including the Original Bid Security (in case of bidders submitting Bid Security in the form of Bank Guarantee) must be received at OIL’s CGM (Contracts)’s office at Duliajan **on or before 12.45 PM (IST) on the bid closing date** failing which the bid shall be rejected.

Bidders are requested to examine all instructions, forms, terms and specifications in the bid. Failure to furnish all information required as per the bid or submission of offers not substantially responsive to the bid in every respect will be at the bidders risk and may result in the rejection of its offer without seeking any clarifications. Offers sent without the requisite value of prescribed bid security (if called for in the bid) in original will be ignored straightway.

13.0 The Integrity Pact is applicable against this tender. OIL shall be entering into an Integrity Pact with the bidders as per format enclosed vide “Part-VI/Integrity Pact” of the tender document. This Integrity Pact Proforma has been duly signed digitally by OIL’s competent signatory. The Proforma has to be returned by the bidder (along with the Un-priced Techno-Commercial Bid) duly signed (digitally) by the same signatory who signed the bid, i.e., who is duly authorized to sign the bid. Uploading the Integrity Pact with digital signature will be construed that all pages of the Integrity Pact has been signed by the bidder’s authorized signatory who sign the Bid.

Note: OIL has appointed Shri Sutanu Behuria, IAS(Retd.), Shri Rudhra Gangadharan, IAS(Retd.) and Shri Jagmohan Garg, Ex-Vigilance Commissioner as Independent External Monitors (IEM) for a period of 03 (Three) years to oversee implementation of Integrity Pact in OIL. Bidders may contact the Independent External Monitors for any matter relating to the Integrity Pact at the following addresses:

- a. Shri Sutanu Behuria, IAS(Retd.);
E-mail id: sutanu2911@gmail.com
- b. Shri Rudhra Gangadharan, IAS(Retd.), Ex-Secretary, Ministry of Agriculture
E-mail id : rudhra.gangadharan@gmail.com
- c. Shri Jagmohan Garg, Ex-Vigilance Commissioner, CVC
E-Mail id: jagmohan.garg@gmail.com

14.0 PREPARATION OF BIDS:

14.1 LANGUAGE OF BIDS: The bid as well as all correspondence and documents relating to the bid exchanged between the Bidder and the Company shall be in English language, except that any printed literature may be in another language provided it is accompanied by an official and notarized English translated version, which shall govern for the purpose of bid interpretation.

14.2 DOCUMENTS COMPRISING THE BID:

(I) UN-PRICED TECHNO-COMMERCIAL BID:

- (i) Bid Documents duly filled up as indicated.
- (ii) Complete technical details/specifications of the equipment with catalogue, etc. as per tender requirement.
- (iii) Documentary evidence established in accordance with BEC/BRC part.
- (iv) Statement of Non-Compliance (if any).
- (v) Bid Security (scanned copy). Hard copy of original Bid Security (Only in case of bidder(s) submitting bid security in the form of Bank Guarantee) should be sent separately to reach **on or before 12.45 p.m. (IST) on the bid closing date failing which the bid shall be rejected.**
- (vi) Any other document as per tender requirement (scanned copy). Hard copy(s) of the same, if called for in the tender, should be sent separately

to reach on or before **12.45 p.m. (IST) on the bid closing date failing which the bid shall be rejected.**

Note: Please note that no price details should be uploaded in UN-PRICED TECHNO-COMMERCIAL BID under “Technical Attachment” Tab.

(II) PRICED BID:

The Priced Bid shall contain the rates/prices along with the currency and any other commercial information pertaining to the rates/prices. Bidder shall quote their rates/prices in the “**PRICE BIDDING FORMAT**” attached under “**Notes and Attachments**” tab in the main bidding engine of OIL’s E-Tender portal. The price quoted in the “**PRICE BIDDING FORMAT**” will only be considered for evaluation.

15.0 Bidder shall bear all costs associated with the preparation and submission of bid. Oil India Limited, hereinafter referred to as 'Company', will in no case be responsible or liable for those costs, regardless of the conduct or outcome of the bidding process.

16.0 TRANSFERABILITY OF BID DOCUMENTS:

16.1 Bid Documents are non-transferable. Bid can be submitted only in the name of the bidder in whose name the Bid Document has been issued.

16.2 Unsolicited offers will not be considered and will be rejected straightway.

17.0 FORMAT AND SIGNING OF BID:

The original and all copies of the bid shall be typed or written in indelible inks and shall be signed digitally by the Bidder to bind the Bidder to the contract.

18.0 AMENDMENT OF BIDDING DOCUMENTS:

18.1 At any time prior to the deadline for submission of bids, the company may, for any reason, whether at its own initiative or in response to a clarification requested by a prospective Bidder, modify the Bidding Documents by issuance of an Addendum.

18.2 The Addendum will be uploaded in OIL’s E-Tender Portal in the Tab “Technical RFx” and External Area – “Amendments” folder. The company may, at its discretion, extend the deadline for bid submission. Bidders are expected to take the Addendum into account in preparation and submission of their bid. **Bidders are to check from time to time the E-Tender Portal [“Technical RFx” Tab and under the folder “Amendments”] for any amendments to the bid documents before submission of their bids. No separate intimation shall be sent to the Bidders.**

19.0 SUBMISSION OF BIDS:

19.1 The bid including all uploaded documents shall be digitally signed by duly authorized representative of the bidder to bind the Bidder to the contract.

19.2 Any person signing the Bid or any other document in respect of this Bid Document or other relevant documents on behalf of the Bidder without disclosing his authority to do so shall be deemed to have the authority to bind the Bidder. If it is discovered at any time that the

person so signing has no authority to do so, the Company (OIL) may, without prejudice to any other right or remedy, cancel his Bid or Contract and hold the Bidder liable to the Company (OIL) for all costs and damages arising from the cancellation of the Bid or Contract including any loss which the Company (OIL) may sustain on account thereof.

19.3 Timely submission of the bids is the responsibility of the Bidder and Bids should be submitted before the bid closing date and time. Company shall not be responsible for any delay.

19.4 Bidder shall submit the Bid, duly completed in terms of the Bid Document.

19.5 Before submission of Bids, Bidders are requested to make themselves fully conversant with all Conditions of the Bid Document and other relevant information related to the works to be executed under this contract.

20.0 SCREEN SHOTS

On **“EDIT”** Mode, bidders are advised to upload **“Technical Bid”** and **“Priced Bid”** in the respective places as indicated above:

Note:

- * The **“Technical Bid”** shall contain all techno-commercial details **except the prices**.
- ** The **“Priced bid”** must contain the price schedule and the bidder’s commercial terms and conditions, if any. For uploading Priced Bid, first click on Add Attachment, a browser window will open, select the file from the PC and name the file under Description, Assigned to General Data and click on OK to digitally sign and upload the File. Please click on Save Button of the Response to Save the uploaded files.

21.0 MAINTENANCE OF TOTAL BID VALUE IN THE RESPONSE: For convenience of the Bidders and to improve transparency, the rates/costs quoted by bidders against the E-tender shall be available for online viewing after price bid opening to those bidders whose price bids

have been opened in the system. For tenders where **Detailed Price Information under RFx Information Tab is “No price”**, the Price Bid is invited through attachment form under “Notes & Attachment”. As per the existing process, Bidders must upload their pricing as per the “Price Bidding Format” under **“Notes & Attachment”**. Additionally the bidders must fill up the **on-line field “Total Bid Value”** under Tab Page **“RFx Information”** with the Total Cost (Including the GST component) as per the amount of the Price Bid in attachment form.

The screenshot shows the 'Create RFx Response' form. At the top, there are tabs: Submit, Read Only, Print Preview, Check, Technical RFx Response, and Close. Below these, the form displays 'RFx Response Number 60038748' and 'RFx Number'. The 'RFx Owner' is 'BHARALI' and the 'Total Value' is '0.00 INR'. The 'RFx Information' tab is selected, showing 'Basic Data', 'Questions', and 'Technical Attachments'. Under 'Event Parameters', the 'Currency' is set to 'Indian Rupee', 'Detailed Price Information' is 'No Price', and 'Terms of Payment' is empty. The 'Total Bid Value' field is highlighted with a red box. Three callouts provide additional information: 'Bidder to select the currency of the Response' points to the Currency dropdown; '“Total Bid Value” is mandatory in “No Price” RFx only' points to the Detailed Price Information field; and '“Total Bid Value” considering all the taxes & duties.' points to the Total Bid Value field.

The “Total Bid Value” as entered by the Bidder in the on-line response shall be displayed in the e-tender portal amongst the Techno-Commercially qualified bidders and Company will not take any responsibility whatsoever towards incorrect information furnished by the bidders in the “Total Bid Value” field.

It is to be noted that Amount mentioned in the “Total Bid Value” field will not be considered for bid evaluation and evaluation will be purely based on the “Price bidding Format”.

22.0 **DEADLINE FOR SUBMISSION OF BIDS:**

22.1 Bids should be submitted on-line up to **11.00 a.m. (IST) (Server Time) on the Bid Closing date** mentioned in the Forwarding Letter. Bidders will be permitted by System to make any changes in their bid after the bid has been uploaded by the bidder prior to the Bid Closing date and time as mentioned in the bid except in condition mentioned in clause 25.0 below. But no changes would be allowed by the system once the due date and time for submission of bids has been reached and bids are opened.

22.2 No bid can be submitted after the submission deadline is reached. The system time displayed on the e-procurement web page shall decide the submission deadline.

22.3 The documents in physical form must be received by Company at the address specified in the “Forwarding Letter” on or before **12:45 p.m. (IST) on the bid closing date**. Timely

delivery of the same at the address mentioned in the Forwarding Letter is the responsibility of the Bidders.

23.0 LATE BIDS: Bidders are advised in their own interest to ensure that their bids are uploaded in system before the closing date and time of the bid. Any Bid received by the Company after the Bid Closing Date & Time stipulated by the Company shall be rejected.

24.0 MODIFICATION AND WITHDRAWAL OF BIDS:

24.1 Bidders will be permitted by System to withdraw their bid or make any changes in their bid after the bid has been uploaded by the bidder prior to the Bid Closing date and time as mentioned in the bid. But no changes or withdrawal would be allowed by the system once the due date and time for submission of bids has been reached and bids are opened.

24.2 No bid can be modified/withdrawn subsequent to the deadline for submission of bids.

24.3 No bid may be withdrawn in the interval between the deadline for submission of bids and the expiry of the period of bid validity. Withdrawal of any bid within validity period will lead to forfeiture of his/her/their Bid Security Deposit in full and debar from participation in future tenders, at the sole discretion of the company.

25.0 EXTENSION OF BID SUBMISSION DATE: Normally no request for extension of Bid Closing Date & Time will be entertained. However, OIL at its discretion, may extend the Bid Closing Date and/or Time due to any reasons.

26.0 BID OPENING AND EVALUATION:

26.1.1 The bid will be opened on scheduled Bid opening date & time in the presence of any attending Bidder(s) or their Authorized Representative, if any. However, an authorized letter (format given in Proforma Section) from the Bidder must be produced by Bidder's representative at the time of opening of Tender, without which such representative won't be allowed to attend the opening of Tenders. Only one representative against each Bid will be allowed to attend the bid opening. Attending Bidder(s) & Authorized Representative(s) will have to sign a register evidencing their presence.

26.1.2 In case of two bid system, after the evaluation of the Technical Bids, the Price Bids of only the techno-commercially acceptable Bidders will be opened. The opening Date and Time will be intimated to the techno-commercially qualified Bidders in due course. Price bids will be opened in the same procedure as mentioned in Para 26.1.1 above.

26.2 In case it happens to be a bandh/holiday, the tender will be opened on the next working day (except Saturday). Accordingly, Bid Closing Date/time will get extended up to the next working day and time (except Saturday).

26.3 Bids which have been withdrawn pursuant to Clause 24.0 will not be allowed to be opened by the system. OIL shall examine bids to determine whether they are complete, whether requisite Bid Securities have been furnished, whether documents have been properly signed and whether the bids are generally in order.

26.4 OIL shall prepare, for its own records, minutes of bid opening including the information disclosed to those present in accordance with the sub-clause 26.3.

26.5 To assist in the examination, evaluation and comparison of bids, normally no clarifications shall be sought from the Bidders. However, for assisting in the evaluation of the bids especially on the issues where the Bidder confirms compliance in the evaluation and contradiction exists on the same issues due to lack of required supporting documents in the Bid (i.e. document is deficient or missing), or due to some statement at other place of the Bid (i.e. reconfirmation of confirmation) or vice versa, clarifications may be sought by OIL at its discretion. The request for clarification and the response shall be in writing and no change in the price or substance of the bid shall be sought, offered or permitted.

26.6 Prior to the detailed evaluation, OIL will determine the substantial responsiveness of each bid to the requirement of the Bidding Documents. For purpose of these paragraphs, a substantially responsive bid is one, which conforms to all the terms and conditions of the Bidding Document without material deviations or reservation. A material deviation or reservation is one which affects in any substantial way the scope, quality, or performance of work, or which limits in any substantial way, in-consistent way with the bidding documents, the Company's right or the bidder's obligations under the contract, and the rectification of which deviation or reservation would affect unfairly the competitive position of other bidders presenting substantial responsive bids. OIL's determination of bid's responsiveness is to be based on the contents of the Bid itself without recourse to extrinsic evidence.

26.7 A Bid determined as not substantially responsive will be rejected by the Company and may not subsequently be made responsive by the Bidder by correction of the non-conformity.

26.8 The Company may waive minor informality or nonconformity or irregularity in a bid, which does not constitute a material deviation, provided such waiver, does not prejudice or affect the relative ranking of any Bidder.

27.0 EVALUATION AND COMPARISON OF BIDS:

27.1 OIL will evaluate and compare the bids as per Bid Evaluation Criteria (BEC) of the bidding documents.

27.2 To ascertain the inter-se-ranking, the comparison of the responsive bids will be made on the basis of total amount quoted inclusive of all liabilities and GST for the items of part-II (i.e. schedule of works, units, quantity, rates) of the tender.

27.3 DISCOUNTS/REBATES: Unconditional discounts/rebates, if any, given in the bid or along with the bid will be considered for evaluation.

27.4 Post bid or conditional discounts/rebates offered by any bidder shall not be considered for evaluation of bids. However, if the lowest bidder happens to be the final acceptable bidder for award of contract, and if they have offered any discounts/ rebates, the contract shall be awarded after taking into account such discounts/ rebates.

27.5 Conditional bids are liable to be rejected at the discretion of the Company.

28.0 BACKING OUT BY BIDDER: In case any bidder withdraws their bid within the bid validity period, Bid Security will be forfeited and the party will be put on Holiday as per the Bidding Policy (available in OIL's website) of Company.

29.0 CONTACTING THE COMPANY:

29.1 Except as otherwise provided in Clause 27.0 above, no Bidder shall contact OIL on any matter relating to its bid, from the time of the bid opening to the time the Contract is awarded except as required by OIL vide sub-clause 26.5.

29.2 An effort by a Bidder to influence OIL in the bid evaluation, bid comparison or Contract award decisions may result in the rejection of their bid.

30.0 AWARD CRITERIA: OIL will award the Contract to the successful Bidder whose bid has been determined to be substantially responsive and has been determined as the lowest evaluated bid, provided further that the Bidder is determined to be qualified to perform the Contract satisfactorily.

31.0 OIL' S RIGHT TO ACCEPT OR REJECT ANY BID: OIL reserves the right to accept or reject any or all bids and to annul the bidding process and reject all bids, at any time prior to award of contract, without thereby incurring any liability to the affected bidder, or bidders or any obligation to inform the affected bidder of the grounds for OIL's action.

32.0 NOTIFICATION OF AWARD: Prior to the expiry of the period of bid validity or extended validity, OIL will notify the successful Bidder in writing by registered letter or by cable or telex or fax or e-mail (to be confirmed in writing by registered/couriered letter) that its bid has been accepted.

33.0 The selected bidder will be required to enter into a formal contract, which will be based on their bid and OIL's Standard Form of Contract.

34.0 The successful bidder shall furnish a Performance Security Deposit in the form of Bank Guarantee as specified above before signing the formal contract. The Performance Security Deposit will be refunded to the Contractor after satisfactory completion of the work, but a part or whole of which shall be used by the Company in realization of liquidated damages or claims, if any or for adjustment of compensation or loss due to the Company for any reason. This Security Money shall not earn any interest.

35.0 BACKING OUT BY L1 BIDDER AFTER ISSUE OF LOA: In case LOA issued is not accepted by the L1 bidder or the Performance Security is not submitted as per the terms of the contract within the time specified in the Bid Document, the Bid Security shall be forfeited and the bidder shall be dealt as per the Banning Policy (available in OIL's website) of Company.

36.0 FURNISHING FRAUDULENT INFORMATION/DOCUMENT: The information and documents furnish by the bidder/contractor in respect of the subject tender/contract are accepted to be true and genuine. However, if it is detected during technical scrutiny or after award of the contract or after expiry of the contract, that the bidder had submitted any fake/fraudulent document or furnished false statement, the offer/contract shall be rejected/cancelled, as the case may be and the bidder (if fake document/false statement pertains to such bidder) shall be dealt as per the Banning Policy (available in OIL's website) of Company. The bidder has to submit an undertaking in this regard as per attached **Proforma-IX**.

37.0 MOBILISATION ADVANCE PAYMENT:

37.1 Request for advance payment shall not be normally considered. However, depending on the merit and at the discretion of the Company, advance against mobilization charge may be given at an interest rate of 1% above the prevailing Bank rate (CC rate) of SBI, CAG Branch, Kolkata from the date of payment of the advance till recovery/refund.

37.2 Advance payment agreed to by the Company shall be paid only against submission of an acceptable bank guarantee whose value should be equivalent to the amount of advance plus the amount of interest covering the period of advance. Bank guarantee shall be valid for 02 months beyond completion of mobilization and the same may be invoked in the event of Contractor's failure to mobilize as per agreement.

37.3 In the event of any extension to the mobilization period, Contractor shall have to enhance the value of the bank guarantee to cover the interest for the extended period and also to extend the validity of bank guarantee accordingly.

38.0 PROVISION FOR ACTION IN CASE OF ERRING/DEFAULTING AGENCIES: Erring and defaulting agencies like bidder, contractor, supplier, vendor, service provider will be dealt as per OIL's Banning Policy dated 6th January, 2017 available in OIL's website: www.oil-india.com.

39.0 SIGNING OF CONTRACT:

39.1 The successful bidders(s) shall be notified by the Company of its intention to enter into an Agreement with him/her/them on the basis of his/her/their acceptance of the offer. Such notification shall be treated as a "Letter of Award (LOA)".

39.2 Within 02 Weeks from the date of issue of Letter of Award (LOA), the successful Bidder(s) will be required to pay an interest free Performance Security by way of Bank Guarantee (in specified format) or in the form of Demand Draft favouring "OIL INDIA LIMITED" payable at "DULIAJAN" from any Nationalized Bank. Upon furnishing of the Performance Security, the successful Bidder(s) will be required to enter into a formal Service Agreement based on the instant tender on the OIL Standard forms of agreement.

39.3 This Performance Security must be valid for 90 (Ninety) days after the date of expiry of the defect liability period of the contract. In the event of contract being extended within the provisions of the contract agreement, the contractor will have to extend suitably the validity of the "Security Deposit" for the extended period.

39.4 The "Performance Security" will be refunded to the contractor after 90 (Ninety) days of satisfactory completion of works/defect liability period (if any) under the contract (including extension, if any), but part or whole of which shall be used by the Company in realization of liquidated damages or claims, if any or for adjustment of compensation or loss due to the Company for any reason.

40.0 Time will be regarded as the essence of the Contract and the failure on the part of the Contractor to complete the work within the stipulated time shall entitle the Company to recover liquidated damages and/or penalty from the Contractor as per terms of the tender/contract.

41.0 The contractor will be required to allow OIL officials to inspect the work site and documents in respect of the workers' payment.

42.0 Failure of the successful bidders to comply with the conditions as specified in Para 39.2 above would render him liable for rejection and in turn forfeiture of Bid Security apart from any other actions the Company may take against him at its sole discretion. The bidder shall be dealt as per the Banning Policy (available in OIL's website) of Company.

43.0 OIL now looks forward to your active participation in the IFB.

Thanking you,

Yours faithfully,

OIL INDIA LIMITED

(NABAJYOTI RABHA)

SENIOR MANAGER CONTRACTS (OPERATIONS)

For **CGM (CONTRACTS)-HoD**

For **RESIDENT CHIEF EXECUTIVE**

Date: 17.04.2020

BID EVALUATION CRITERIA (BEC)/BID REJECTION CRITERIA (BRC)**1.0 BID EVALUATION CRITERIA (BEC)**

The bid shall conform generally to the specifications and terms and conditions given in the Tender Documents. Bids will be rejected in case services offered do not conform to the required parameters stipulated in the technical specifications. Notwithstanding the general conformity of the bid to the stipulated specifications, the following mandatory requirements will have to be particularly met by the Bidders without which the same will be considered as non-responsive and rejected. All the documents related to BEC must be submitted along with the Technical Bid.

1.1 FINANCIAL CRITERIA

1.1.1 Annual Financial Turnover of the bidder during any of preceding 03 (Three) financial/accounting years from the original bid closing date should be at least **Rs. 42,34,700.00 (Rupees Forty Two Lakh Thirty Four Thousand and Seven Hundred only)**.

1.1.2 Net worth of the bidder must be Positive for the preceding financial/accounting year.

Note: The Net worth to be considered against Clause 1.1.2 above, should be read in conjunction with the definition of Net worth as mentioned in Section 2 (57) of The Companies Act, 2013.

Notes to BEC Clause 1.1 above:

a. For proof of Annual Turnover & Net worth (refer clauses 1.1.1 & 1.1.2 above), any one of the following documents/photocopies must be submitted along with the bid:

(i) Audited Balance Sheet along with Profit & Loss account.

OR

(ii) A certificate issued by a practicing Chartered or Cost Accountant (with Membership Number and Firm Registration Number), certifying the Annual turnover & Net worth as per format prescribed in **Annexure-X**.

Note: Mention of UDIN (Unique Document Identification Number) is mandatory for all Certificates w.e.f. February 1, 2019, issued by Chartered Accountant in Practice.

b. Considering the time required for preparation of Financial Statements, if the last date of preceding financial/accounting year falls within the preceding six months reckoned from the original bid closing date and the Financial Statements of the preceding financial/accounting year are not available with the bidder, then the financial turnover of the previous three financial/accounting years excluding the preceding financial/accounting year will be considered. In such cases, the Net worth of the previous financial/accounting year excluding the preceding financial/accounting year will be considered. However, the bidder has to submit an undertaking in support of the same along with their technical bid as per **Proforma-X**.

- c. In case the bidder is a Central Govt. Organization/PSU/State Govt. Organization/Semi-State Govt. Organization or any other Central/State Govt. Undertaking, where the auditor is appointed only after the approval of Comptroller and Auditor General of India and the Central Government, their certificates may be accepted even though FRN is not available. However, bidder to provide documentary evidence for the same.
- d. In case the bidder is a Government Department, they are exempted from submission of documents mentioned under para **a.** and **b.** above.
- e. Bid will be rejected if not accompanied with adequate documentary proof in support of Annual turnover & Net worth as mentioned in Para 1.1.1 & 1.1.2.

1.2 TECHNICAL CRITERIA:

The bidder must have experience of successful completion/execution of “Maintenance Services” or “Operation & Maintenance (O&M)” in Central Govt./State Govt./Public Sector Undertaking/State Govt. Enterprise/Any Upstream or Downstream Oil/Gas Company of any one of the following:.

- a. Experience of handling Petroleum Production Facility/ Petroleum Process Facility/Petroleum Tank Farm with a minimum work experience **Rs. 70,57,800.00 (Rupees Seventy Lakh Fifty Seven Thousand and Eight Hundred only)** for a minimum period of 1 (one) year during the last 7(seven) years to be reckoned from the original bid closing date.
- b. Experience of handling Natural Gas - Production / Gathering /Processing / Compression facility with a minimum work experience of **1 (one) MMSCUMD or more** during the last 7(seven) years to be reckoned from the original bid closing date.
- c. Experience of handling Petroleum Production facility for a minimum production of **300 Barrels of Oil per Day** during the last 7(seven) years to be reckoned from the original bid closing date
- d. Experience of handling “Crude Oil”/”Petroleum Products” of Tank Farm with minimum storage capacity of **10,000 Barrels** during the last 7(seven) years to be reckoned from the original bid closing date.

Notes to BEC Clause 1.2 above:

- a. Maintenance Services/O&M Services as referred in 1.2 must have to meet the minimum working experience for the following under single contract:
 - a. Maintenance of Process Instrumentation and related control system.
 - b. Maintenance of Fire Fighting Equipment and related control system.
 - c. Maintenance of Electrical Systems including Air Conditioners.
 - d. Maintenance of Mechanical Pumps, Engines, Air Compressors etc.
- b. For proof of requisite Experience (refer Clause No. 1.2), the following documents/ photocopy (self-attested/attested) must be submitted along with the bid:

- I. **In case work experience is against OIL's Contract:** Bidder must submit Job Completion Certificate issued by the company indicating the following:
- A. Work order no./Contract no.
 - B. Gross value of job done
 - C. Period of Service
 - D. Nature of Service
- II. **In case work experience is not against OIL's Contract:** Bidder must submit the following:
- A. Contract document showing details of work,
AND
 - B. Job Completion Certificate showing:
 - (i) Gross value of job done
 - (ii) Nature of job done and Work order no./Contract no.
 - (iii) Contract period and date of completionOR
 - C. SES (Service Entry Sheet)/Certificate of Payment (COP) issued by the company indicating the following:
 - (i) Work order no./Contract no.
 - (ii) Gross value of jobs done
 - (iii) Period of Service
 - (iv) Nature of Service
- c. Only Letter of Intent (LOI)/Letter of Award (LOA), or Work Order(s) are not acceptable as evidence.
- d. Mere award of contract(s) will not be counted towards experience. Successful completion of the awarded contract(s) to the extent of volume & value, as stipulated respectively under Clause Nos. 1.2 will only be treated as acceptable experience.
- e. Following work experience will also be taken into consideration:
- (i) If the prospective bidder has executed contract in which similar work is also a component of the contract.
 - (ii) In case the start date of the requisite experience is beyond the prescribed 07 (seven) years reckoned from the original bid closing date but completion is within the prescribed 07 (seven) years reckoned from the original bid closing date.
 - (iii) If the prospective bidder is executing similar work which is still running and the contract value/quantity executed prior to original bid closing date is equal to or more than the minimum prescribed value in the BEC.

Proof of work experience against Para **e. (i) and (ii)** above, to satisfy a) similar work b) minimum prescribed value/qty c) prescribed period of 07 years, to be submitted as below:

- I. **In case requisite experience is against OIL's Contract:** Bidder must submit the breakup of similar work and its value/quantity mentioning SES No. and copies of all relevant SES.

- II. **In case requisite experience is NOT against OIL's Contract:** Bidder must submit the breakup of similar work and its value/quantity executed within the prescribed period of 07 (Seven) years reckoned from the original bid closing date. The breakup must be certified by the end user or a certificate issued by a practicing Chartered/Cost Accountant Firm (with Membership Number & Firm Registration Number).

Proof of work experience against Para **e. (iii)** above, to satisfy a) similar work b) minimum prescribed value/qty c) prescribed period of 07 years, to be submitted as below:

- I. **In case requisite experience is against OIL's Contract:** Bidder must submit the following:
- A. Breakup of similar work
 - B. SES (Service Entry Sheet)/Certificate of Payment (COP) issued by the company indicating the following:
 - (i) Work order no./Contract no.
 - (ii) Gross value of job done
 - (iii) Period of Service
 - (iv) Nature of Service
- II. **In case requisite experience is not against OIL's Contract:** Bidder must submit the following:
- A. Breakup of similar work
 - B. Contract document showing details of work.
 - C. LOA/LOI/Work order showing:
 - (i) Gross value of awarded
 - (ii) Nature of job awarded
 - (iii) Contract no./Work order no.
 - (iv) Contract period and date of completion
 - D. Certificate of Payment (COP)/SES (Service Entry Sheet) up to the previous month of the original bid closing date of this tender issued by the company indicating the following:
 - (i) Work order no./Contract no.
 - (ii) Gross value of job done
 - (iii) Period of Work Done
- f. In case of similar work executed through 'sub-contracting', the bidder shall submit relevant documents as mentioned under para 'b' and/or 'e' above, issued directly by the client organization/end user, along with confirmation towards consent of the client organization/end user for allowing 'sub-contracting'.
- g. SIMILAR work executed by a bidder for its own organization/subsidiary cannot be considered as experience for the purpose of meeting BEC.
- h. Bids submitted for part of the work will be rejected. Bid will be rejected if not accompanied with adequate documentary proof in support of Work experience as mentioned in Notes to BEC Clause 1.2 above.

1.3 Bidder must submit an undertaking, in original, from the OEM/Authorized Dealer of **Honeywell, Emerson Rosemount, SIEMENS, PHOENIX, ABB Ltd., Bajaj, Philips, HITACHI HiREL, Greaves Cotton Ltd, Kirlosker Oil Engines Ltd., Kirloskar Pneumatic Pvt., Mather & Platt Pumps Ltd., M/s NK Fire Safety, FIRETECH**

Equipment & Services Pvt. Ltd., Bluestar and Brady & Morris Engg. Co. Ltd in a letter clearly stating that they (OEM/Authorized Dealer) would facilitate the required services to the bidder on regular basis with Maintenance Crew/Technology /Spares/ Product updates etc. & also extend all necessary support during the maintenance period of the contract. In the absence of such undertaking, the bid is liable to be rejected. This undertaking shall be valid for the entire duration of the contract. A format of Undertaking is attached as **Annexure XP**.

1.4 Price bid shall be opened in respect of only the techno-commercially acceptable bidders whose bids have been found to be substantially responsive. A substantially responsive bid is one that meets the terms and conditions of the Tender and/or the acceptance of which bid will not result in indeterminate liability on OIL.

1.5 Bidders are required to quote for all the items as per Price Bid Format, otherwise the offer of the bidder will be straightway rejected.

1.6 If there is any discrepancy between the unit price and the total price, the unit price will prevail and the total price shall be corrected. Similarly, if there is any discrepancy between words and figure, the amounts in words shall prevail and will be adopted for evaluation.

1.7 The quantities shown against each item in the "Price Bid Format" shall be considered for the purpose of Bid Evaluation. It is, however, to be clearly understood that the assumptions made in respect of the quantities for various operations are only for the purpose of evaluation of the bid and the Contractor will be paid on the basis of the actual number of days/parameter, as the case may be.

1.8 The bidders are advised not to offer any discount/rebate separately and to offer their prices in the Price Bid Format after considering discount/rebate, if any.

1.9 Conditional and unsolicited discount will not be considered in evaluation. However, if such bidder happens to be the lowest recommended bidder, unsolicited discount without any condition will be considered for computing the contract price.

1.10 In case of identical overall lowest offered rate by more than 1(one) bidder, the selection will be made by draw of lot between the parties offering the same overall lowest price.

1.11 PURCHASE PREFERENCE CLAUSE: Purchase Preference to Micro and Small Enterprises registered with District Industry Centres or Khadi and Village Industries Commission or Khadi and Village Industries Board or Coir Board or National Small Industries Corporation or Directorate of Handicrafts and Handloom or any other body specified by Ministry of MSME:

1.11.1 In case participating MSEs Quote price within price band of L1+15%, such MSE shall be considered for award of contract by bringing down their price to L1 price in a situation where L1 price is from someone other than a MSE.

1.11.2 In case of more than one such MSE qualifying for 15% purchase preference, the contract shall be awarded to lowest eligible MSE amongst the MSEs qualifying for 15% purchase preference.

1.11.3 Documentation required to be submitted by MSEs: Copy of valid Registration Certificate, if bidder is a Micro or Small Enterprises (MSE) registered with District Industry Centres or Khadi and Village Industries Commission or Khadi and Village Industries Board or Coir Board or National Small Industries Corporation or Directorate of Handicrafts and Handloom or Udyog Aadhaar Memorandum or any other body specified by Ministry of MSME. The Registration Certificate should clearly indicate the monetary limit, if any and the items for which bidder are registered with any of the aforesaid agencies. In case bidding MSE is owned by Schedule Caste or Schedule Tribe entrepreneur, valid documentary evidence issued by the agency who has registered the bidder as MSE owned by SC/ST entrepreneur should also be enclosed.

1.12 Price Bids shall be evaluated on overall lowest cost to OIL (L-1 offer) basis i.e. considering total quoted price for all services including applicable GST (CGST & SGST/UTGST or IGST).

1.13 OIL will prefer to deal with registered bidder under GST. Therefore, bidders are requested to get themselves registered under GST, if not registered yet.

However, in case any unregistered bidder is submitting their bid, their prices will be loaded with applicable GST while evaluation of bid. Where OIL is entitled for input credit of GST, the same will be considered for evaluation of bid as per evaluation methodology of tender document.

1.14 Price Bid uploaded without giving any of the details of the taxes (Including rates and amounts) will be considered as inclusive of all taxes including GST.

When a bidder mentions taxes as extra without specifying the rates & amount, the offer will be loaded with maximum value towards taxes received against the tender for comparison purposes. If the bidder emerges as lowest bidder after such loading, in the event of order on that bidder, taxes mentioned by OIL on the Purchase Order/Contracts will be binding on the bidder.

1.15 Input Tax Credit on GST (Goods & Service Tax) for this service is NOT available to OIL & the bids will be evaluated based on total price including GST.

1.16 Based on the evaluation of techno-commercially qualified bidders, the job will be awarded to L-1 bidder.

2.0 BID REJECTION CRITERIA (BRC):

2.1 The bids are to be submitted in single stage under Two Bid System i.e. Un-priced Techno-Commercial Bid and Price Bid together. Only the Price Bid should contain the quoted price.

2.2 The price quoted by the successful bidder must be firm during the performance of the contract and not subject to variation on any account except as mentioned in the bid document. Any bid submitted with adjustable price quotation other than the above will be treated as non-responsive and rejected.

2.3 Bid security shall be furnished as a part of the Techno Commercial Un-priced Bid. The amount of bid security should be as specified in the forwarding letter. Any bid not accompanied by a proper bid security will be rejected.

2.4 Bid Documents/User Id & Password for OIL's E-Tender portal are not transferable.

2.5 Any bid received in the form of Physical document/ Telex/Cable/Fax/E-mail will not be accepted.

2.6 Bids shall be typed or written in indelible ink. The bidder or his authorized representative shall sign the bid digitally, failing which the bid will be rejected.

2.7 Bids shall contain no interlineations, erasures or overwriting except as necessary to correct errors made by bidder, in which case such corrections shall be initiated by the persons(s) signing (digitally) the bid. However, white fluid should not be used for making corrections. Any bid not meeting this requirement shall be rejected.

2.8 Any bid containing false statement will be rejected and action will be taken by Company as per Bid Document.

2.9 Bidders must quote clearly and strictly in accordance with the price schedule outlined in Price Bidding Format attached under "Notes and Attachments" tab in the main bidding engine of OIL's E-Tender portal; otherwise the bid will be rejected. All other techno-commercial documents other than price details to be submitted with Unpriced Techno-Commercial Bid as per tender requirement under "Technical Attachment" Tab Page only.

2.10 Bidder must accept and comply with the following provisions as given in the Tender Document in toto, failing which offer will be rejected:

- (i)** Firm price
- (ii)** EMD / Bid Bond
- (iii)** Period of validity of Bid
- (iv)** Price Schedule
- (v)** Performance Bank Guarantee / Security deposit
- (vi)** Delivery / Completion Schedule
- (vii)** Scope of work
- (viii)** Guarantee of material / work
- (ix)** Liquidated Damages clause
- (x)** Tax liabilities
- (xi)** Arbitration / Resolution of Dispute Clause
- (xii)** Force Majeure
- (xiii)** Applicable Laws
- (xiv)** Specifications
- (xv)** Integrity Pact

2.11 There should not be any indication of price in the Un-priced Techno-Commercial Bid. A bid will be straightway rejected if this is given in the Un-priced Techno-Commercial Bid.

2.12 Bid received with validity of offer less than 120 (one hundred twenty) days from the date of Technical Bid opening will be rejected.

2.13 The Integrity Pact is applicable against this tender. OIL shall be entering into an Integrity Pact with the bidders as per format enclosed vide “**Part-VI/Integrity Pact**” of the tender document. This Integrity Pact proforma has been duly signed digitally by OIL's competent signatory. The proforma has to be returned by the bidder (along with the Un-priced Techno-Commercial Bid) duly signed (digitally) by the same signatory who signed the bid, i.e., who is duly authorized to sign the bid. Uploading the Integrity Pact with digital signature will be construed that all pages of the Integrity Pact has been signed by the bidder's authorized signatory who sign the Bid.

3.0 GENERAL:

3.1 In case bidder takes exception to any clause of bidding document not covered under BEC/BRC, then the Company has the discretion to load or reject the offer on account of such exception if the bidder does not withdraw/modify the deviation when/as advised by company. The loading so done by the company will be final and binding on the bidders. No deviation will however be accepted in the clauses covered under BEC/BRC.

3.2 To ascertain the substantial responsiveness of the bid the Company reserves the right to ask the bidder for clarification in respect of clauses covered under BEC/BRC also and such clarifications fulfilling the BEC/BRC clauses in toto must be received on or before the deadline given by the company, failing which the offer will be will be evaluated based on the submission. However, mere submission of such clarification shall not make the offer responsive, unless company is satisfied with the substantial responsiveness of the offer.

3.3 If any of the clauses in the BEC/BRC contradict with other clauses of bidding document elsewhere, the clauses in the BEC/BRC shall prevail.

3.4 Bidder(s) must note that requisite information(s)/financial values etc. as required in the BEC/BRC & Tender are clearly understandable from the supporting documents submitted by the Bidder(s); otherwise Bids shall be rejected.

3.5 OIL will not be responsible for delay, loss or non-receipt of applications for participating in the bid sent by mail and will not entertain any correspondence in this regard.

3.6 The originals of such documents [furnished by bidder(s)] shall have to be produced by bidder(s) to OIL as and when asked for.

GENERAL CONDITIONS OF CONTRACT (GCC)

DESCRIPTION OF WORK/SERVICES: Hiring of services for Comprehensive Annual Maintenance Contract (CAMC) for the new facilities installed post M B Lal Committee recommendations in Moran Tank Farm for a period of 2 (two) years extendable by 1(one) year.

A. DEFINITIONS:

In the contract, the following terms shall be interpreted as indicated:

- (a) **"The Contract"** means agreement entered into between Company and Contractor, as recorded in the contract Form signed by the parties, including all attachments and appendices thereto and all documents incorporated by reference therein;
- (b) **"The Contract Price"** means the price payable to Contractor under the contract for the full and proper performance of its contractual obligations;
- (c) **"The Work"** means each and every activity required for the successful performance of the services described in Section II, the Terms of Reference.
- (d) **"Company"** or **"OIL"** means Oil India Limited;
- (e) **"Contractor"** means the Contractor performing the work under this Contract.
- (f) **"Contractor's Personnel"** means the personnel to be provided by the Contractor to provide services as per the contract.
- (g) **"Company's Personnel"** means the personnel to be provided by OIL or OIL's Contractor (other than the Contractor executing the Contract). The Company representatives of OIL are also included in the Company's personnel.
- (h) **"Gross Negligence"** means any act or failure to act (whether sole, joint or concurrent) by a person or entity which was intended to cause, or which was in reckless disregard of or wanton indifference to, avoidable and harmful consequences such person or entity knew, or should have known, would result from such act or failure to act. Notwithstanding the foregoing, Gross negligence shall not include any action taken in good faith for the safeguard of life or property.
- (i) **"Willful Misconduct"** means intentional disregard of good and prudent standards of performance or proper conduct under the Contract with knowledge that it is likely to result in any injury to any person or persons or loss or damage of property.

WITNESSETH:

1.0 a) The contractor hereby agrees to carry out the work set down in the Schedule of work which forms part-II of this Contract in accordance with the 1968 General Conditions of Contract of Oil India Limited and General Specifications read in conjunction with any drawings and Particular Specifications & instructions which forms Part-III of the contract

utilizing any materials/services as offered by the Company as per Part-IV of the contract in **Moran Tank Farm.**

b) In this Contract all words and expressions shall have the same meaning as are respectively assigned to them in the 1968 General Conditions of Contract of Oil India Limited which the Contractor has perused and is fully conversant with before entering into this Contract.

c) The clauses of this contract and of the specifications set out hereunder shall be paramount and in the event of anything herein contained being inconsistent with any term or terms of the 1968 General Conditions of Contract of Oil India Limited, the said term or terms of the 1968 General conditions of Contract to the extent of such inconsistency, and no further, shall not be binding on the parties hereto.

2.0 The contractor shall provide all labour, supervision and transport and such specified materials described in part-II of the Contract including tools and plants as necessary for the work and shall be responsible for all royalties and other levies and his rates shall include for these. The work executed and materials supplied shall be to the satisfaction of the Company's Engineer and Contractor's rates shall include for all incidental and contingent work which although not specifically mentioned in this contract are necessary for its completion in a sound and workman like manner.

3.0 The Company's Engineer shall have power to:

a) Reduce the rates at which payments shall be made if the quality of work although acceptable is not up to the required standard set forth in the OIL Standard Specifications which have been perused and fully understood by the Contractor.

b) Order the Contractor to remove any inferior material from the site and to demolish or rectify any work of inferior workmanship, failing which the Company's Engineer may arrange for any such work to be demolished or rectified by any other means at the Contractor's expenses.

c) Order the Contractor to remove or replace any workman who he (The Engineer) considers incompetent or unsuitable; the Engineer's opinion as to the competence and suitability of any workman engaged by the Contractor shall be final and binding on the Contractor.

d) Issue to the Contractor from time to time during the progress of the work such further drawings and instructions as shall be necessary for the purpose of proper and adequate execution and maintenance of the works and the Contractor shall carry out and be bound by the same.

e) Order deviations in Part II and III of this Contract. All such deviation orders shall be in writing and shall show the financial effect, if any, of such deviation and whether any extra time is to be allowed.

4.0 The Contractor shall have no claim against the company in respect of any work which may be withdrawn but only for work actually completed under this contract. The contractor shall have no objection to carry out work in excess of the quantities stipulated in Part-II if so ordered by the company at the same rates, terms and conditions.

5.0 The Company reserves the right to cancel this Contract at any time upon full payment of work done and the value of the materials collected by the contractor for permanent incorporation in the work under this contract particularly for execution of this

contract up to the date of cancellation of the Contract. The valuation of the work done and the materials collected shall be estimated by the company's Engineer in presence of the contractor. The Contractor shall have no claim to any further payment whatsoever. The valuation would be carried out exparte if Contractor fails to turn up despite reasonable notice which will be binding on the Contractor.

6.0 The Contractor hereby undertakes to indemnify the Company against all claims which may arise under the under noted Acts:

- i) The Mines Act.
- ii) The Minimum Wages Act, 1948.
- iii) The Workman's Compensation Act, 1923.
- iv) The Payment of wages Act, 1936.
- v) The Payment of Bonus Act, 1965.
- vi) The Contract Labour (Regulation & Abolition) Act, 1970 and the rules framed there under.
- vii) Employees' Pension Scheme, 1995.
- viii) Inter-State Migrant (Regulation of Employment and Condition of Service) Act. 1979.
- ix) The Employees Provident Fund and Miscellaneous Provisions Act, 1952.
- x) GST Act.

or any other Acts or Statute not here in above specifically mentioned having bearing over engagement of workers directly or indirectly for execution of work. The Contractor shall not make the Company liable to reimburse the Contractor for the statutory increase in the wage rates of the Contract Labour appointed by the Contractor. Such Statutory increase in the wage rates of Contract Labour shall be borne by the contractor.

7.0 The Contractor shall clear away all rubbish and surplus material from the site on completion of work and shall leave the site clean and tidy.

8.0 The duration of the contract shall be initially for a period of **2 (Two) Years** from the commencement of the same i.e. after completion of mobilization with a provision for extension by another **01 (One) year** as per Company's requirement. The Contractor must complete the work as mentioned in PART – III (SPECIAL CONDITIONS OF CONTRACT: SCC) within the contract period. In the event of there being undue delay in execution of the Contract, the Company reserves the right to cancel the Contract and/or levy such additional damages as it deems fit based on the actual loss suffered by the company attributable to such delay. The company's decision in this regard shall be final.

9.0 In order to promote, safeguard and facilitate the general operational economic in the interest of the Company during the continuance of this contract the Contractor hereby agrees and undertakes not to take any direct or indirect interest and or support, assist, maintain or help any person or persons engaged in antisocial activities, demonstration, riots, or in any agitation prejudicial to the Company's interest and any such even taking shape or form at any place of the Company's works or and its neighborhood.

10.0 The tendered price inclusive of all liabilities and GST (i.e. the Contract price) is Rs. _____ ***(Not to be filled up by bidder while submitting the offer in Technical Attachments Folder. This figure will be filled up by OIL at the time of award of the contract to the successful bidder)*** (_____ only) but the Company shall pay the Contract or only for actual

work done at the all-inclusive rates set down in the Schedule of work Part II of this Contract.

On account payment may be made, not often than monthly, up to the amount of **100%** of the value of work done. Final payment will be made only after satisfactory completion of the work. Such final payment shall be based on the work actually done allowing for deviations and any deductions and the measurement shall be checked and certified correct by the Company's Engineer before any such final payment is made.

Note: All Invoices are to be sent to the following address:

Chief General Manager - PSS
Oil India Limited,
P.O. Duliajan-786602
Dist. Dibrugarh, Assam.

11.0 The contractor employing **20 (twenty)** or more workmen on any day preceding 12 months shall be required to obtain requisite license at his cost from the appropriate Licensing Officer before undertaking any Contract work. The Contractor shall also observe the rules & regulations framed under the Contract Labour (Regulation & Abolition) Act.

12.0 The Contractor will not be allowed to construct any structure (for storage/housing purpose) with thatch, bamboo or any other inflammable materials within any company's fenced area.

13.0 The Contractor shall ensure that all men engaged by him/her are provided with appropriate protective clothing and safety wear in accordance with regulation 89(a) and 89(b) in the Oil Mines Regulations 1984. The Company's representative shall not allow/accept those men who are not provided with the same.

14.0 The Contractor shall deploy local persons in all works.

15.0 The Contractor shall not engage minor labour below 18 (eighteen) years of age under any circumstances.

16.0 The Contractor and his/her workmen shall strictly observe the rules and regulations as per Mines Act (Latest editions).

17.0 GENERAL OBLIGATIONS OF COMPANY:

COMPANY shall, in accordance with and subject to the terms and conditions of this contract:

- i) Pay the Contractors in accordance with terms and conditions of the contract.
- ii) Allow access to Contractors and their personnel, subject to normal security and safety procedures, to all areas as required for orderly performance of the work.

18.0 SPECIAL CONDITIONS:

- a) ~~The amount of retention money shall be released after 6 (six) months from the date of issue of completion certificate from concerned department.~~

- b) The contractor will be required to allow OIL Officials to inspect the work site and documents in respect of the workers' payment.
- c) Contractor(s) whosoever is liable to be covered under the P.F. Act and contract cost is inclusive of P.F., must ensure strict compliance of provisions of Provident Fund and Miscellaneous Provisions Act, 1952 in addition to the various Acts mentioned elsewhere in this contract. Any contractor found violating these provisions will render themselves disqualified from any future tendering. As per terms of the contract, if applicable, the Contractor must deposit Provident Fund Contribution (covering Employee's & Employer's share) with the competent authority monthly under their direct code. The Contractor shall be required to submit documentary evidence of deposit of P.F. Contribution to the Company. In case of failure to provide such documentary evidence, the Company reserves the right to withhold the amount equivalent to applicable P.F. Contribution.

19.0 ARBITRATION:

19.1 ARBITRATION (APPLICABLE FOR SUPPLIERS/CONTRACTORS OTHER THAN PSU)

Except as otherwise provided elsewhere in the contract, if any dispute, difference, question or disagreement arises between the parties hereto or their respective representatives or assignees, in connection with construction, meaning, operation, effect, interpretation of the contract or breach thereof which parties are unable to settle mutually, the same shall be referred to Arbitration as provided hereunder:

- a) A party wishing to commence arbitration proceeding shall invoke Arbitration Clause by giving 30 days' notice to the other party. The notice invoking arbitration shall specify all the points of dispute with details of the amount claimed to be referred to arbitration at the time of invocation of arbitration and not thereafter. If the claim is in foreign currency, the claimant shall indicate its value in Indian Rupee for the purpose of constitution of the arbitral tribunal.

- b) The number of arbitrators and the appointing authority will be as under:

Claim amount (excluding claim for interest and counter claim, if any)	Number of Arbitrator	Appointing Authority
Up to Rs. 5 Crore	Sole Arbitrator	OIL
Above Rs. 5 Crore	3 Arbitrators	One Arbitrator by each party and the 3 rd Arbitrator, who shall be the presiding Arbitrator, by the two Arbitrators.

- c) The parties agree that they shall appoint only those persons as arbitrators who accept the conditions of the arbitration clause. No person shall be appointed as Arbitrator or Presiding Arbitrator who does not accept the conditions of the arbitration clause.

- d) Parties agree that there will be no objection if the Arbitrator appointed holds equity shares of OIL and/or is a retired officer of OIL/any PSU. However, neither party shall appoint its serving employees as arbitrator.
- e) If any of the Arbitrators so appointed dies, resigns, becomes incapacitated or withdraws for any reason from the proceedings, it shall be lawful for the concerned party/arbitrators to appoint another person in his place in the same manner as aforesaid. Such person shall proceed with the reference from the stage where his predecessor had left if both parties consent for the same; otherwise, he shall proceed de novo.
- f) Parties agree that neither shall be entitled for any pre-reference or pendente-lite interest on its claims. Parties agree that any claim for such interest made by any party shall be void.
- g) The arbitral tribunal shall make and publish the award within time stipulated as under:

Amount of Claims and counter claims(excluding interest)	Period for making and publishing of the award (counted from the date of first meeting of the Arbitrators)
Up to Rs. 5 Crore	Within 8 months
Above Rs. 5 Crore	Within 12 months

The above time limit can be extended by Arbitrator, for reasons to be recorded in writing, with the consent of the other parties.

- h) If after commencement of the arbitration proceedings, the parties agree to settle the dispute mutually or refer the dispute to conciliation, the arbitrators shall put the proceedings in abeyance until such period as requested by the parties.
- i) Each party shall be responsible to make arrangements for the travel and stay etc. of the arbitrator pointed by it. Claimant shall also be responsible for making arrangements for travel/stay arrangements of the Presiding Arbitrator and the expenses incurred shall be shared equally by the parties.
- In case of sole arbitrator, OIL shall make all necessary arrangements for his travel, stay and the expenses incurred shall be shared equally by the parties.
- j) The Arbitration shall be held at **Duliajan, Assam**. However, parties to the contract can agree for a different place for the convenience of all concerned.
- k) The Arbitrator(s) shall give reasoned and speaking award and it shall be final and binding on the parties.
- l) Subject to aforesaid, provisions of the Arbitration and Conciliation Act, 1996 and any statutory modifications or re-enactment thereof shall apply to the arbitration proceedings under this clause.

19.2 ARBITRATION (APPLICABLE IN CASE OF CONTRACT AWARDED ON PUBLIC SECTOR ENTERPRISE):

In the event of any dispute or difference relating to, arising from or connected with the Contract, such dispute or difference shall be referred by either party to the arbitration of one of the Arbitrators in the Department of Public Enterprises, to be nominated by the Secretary to the Government of India, In-Charge of the Bureau of Public Enterprises. The Arbitration and Conciliation Act 1996 shall not be applicable to the Arbitration under this clause. The award of the Arbitrator shall be binding upon the parties to the dispute, provided however; any party aggrieved by such award may make a further reference for setting aside or revision of the award to the Law Secretary, Deptt. of Legal Affairs, Ministry of Law and Justice, Government of India. Upon such reference, the dispute shall be decided by the Law Secretary or the Special Secretary/Additional Secretary, whose decision shall bind the parties finally and conclusively. The parties in the dispute will share equally the cost of the arbitration as intimated by the Arbitrator.

The venue of all arbitrations under both 19.1 & 19.2 will be **Duliajan, Assam**. The award made in pursuance thereof shall be binding on the parties.

20.0 FORCE MAJEURE:

20.1 In the event of either party being rendered unable by 'Force majeure' to perform any obligations required to be performed by them under the contract the relative obligations of the party affected by such 'Force Majeure' shall upon notification to the other party be suspended for the period during which force majeure event lasts. The cost and loss sustained by the either party shall be borne by the respective parties.

The term 'Force Majeure' as employed herein shall mean acts of God, earthquake, war (declared/undeclared) revolts, riots, fires, floods, rebellions, explosions, hurricane, sabotage, civil commotions, and acts and regulations of respective Govt. of the two parties, namely the Company and the contractor.

20.2 Upon the occurrence of such cause(s) and upon its termination, the party alleging that it has been rendered unable as aforesaid thereby, shall notify the other party in writing immediately but not later than 72 (Seventy-two) hours of the alleged beginning and ending thereof giving full particulars and satisfactory evidence in support of its claim.

Time for performance of the relative obligations suspended by the force majeure shall then extended by the period for which such cause lasts.

20.3 Should 'force majeure' condition as stated above occurs and should the same be notified within Seventy-Two (72) hours after its occurrence the 'force majeure' rate shall apply for the first fifteen days. Parties will have the right to terminate the Contract if such 'force majeure' conditions continue beyond fifteen (15) days with prior written notice. Should either party decide not to terminate the Contract even under such condition, no payment would apply after expiry of fifteen (15) days force majeure period unless otherwise agreed to.

21.0 TERMINATION:

21.1 TERMINATION ON EXPIRY OF THE TERMS (DURATION): The contract shall be deemed to have been automatically terminated on the expiry of duration of the Contract or the extension period, if exercised by Company under the provision of the Contract.

21.2 TERMINATION ON ACCOUNT OF FORCE MAJEURE: Either party shall have the right to terminate this Contract on account of Force Majeure as set forth in Article 20.0 above.

21.3 TERMINATION ON ACCOUNT OF INSOLVENCY: In the event that the Contractor or its collaborator at any time during the term of the Contract, becomes insolvent or makes a voluntary assignment of its assets for the benefit of creditors or is adjudged bankrupt, then the Company shall, by a notice in writing have the right to terminate the Contract and all the Contractor's rights and privileges hereunder, shall stand terminated forthwith.

21.4 TERMINATION FOR UNSATISFACTORY PERFORMANCE: If the Company considers that, the performance of the Contractor is unsatisfactory, or not up to the expected standard, the Company shall notify the Contractor in writing and specify in details the cause of the dissatisfaction. The Company shall have the option to terminate the Contract by giving 15 days' notice in writing to the Contractor, if Contractor fails to comply with the requisitions contained in the said written notice issued by the Company.

21.5 TERMINATION DUE TO CHANGE OF OWNERSHIP & ASSIGNMENT: In case the Contractor's rights and/or obligations under this Contract and/or the Contractor's rights, title and interest to the equipment/material, are transferred or assigned without the Company's consent, the Company may at its absolute discretion, terminate this Contract.

21.6 If at any time during the term of this Contract, breakdown of Contractor's equipment results in Contractors being unable to perform their obligations hereunder for a period of 15 successive days, Company at its option, may terminate this Contract in its entirety without any further right or obligation on the part of the Company, except for the payment of money then due. No notice shall be served by the Company under the condition stated above.

21.7 Notwithstanding any provisions herein to the contrary, the Contract may be terminated at any time by the Company on giving 30 (thirty) days written notice to the Contractor due to any other reason not covered under the above clause from 21.1 to 21.6 and in the event of such termination the Company shall not be liable to pay any cost or damage to the Contractor except for payment for services as per the Contract upto the date of termination including the De-mob cost, if any.

22.0 CONSEQUENCES OF TERMINATION: In all cases of termination herein set forth, the relative obligations of the parties to the Contract shall be limited to the period up to the date of termination. Notwithstanding the termination of this Contract, the parties shall continue to be bound by the provisions of this Contract that reasonably require some action or forbearance after such termination.

22.1 Upon termination of this Contract, Contractor shall return to Company all of Company's items, which are at the time in Contractor's possession.

22.2 In the event of termination of contract, Company will issue Notice of termination of the contract with date or event after which the contract will be terminated. The contract shall then stand terminated and the Contractor shall demobilize their personnel & materials.

23.0 I.B. VERIFICATION REPORT AND SECURITY REVIEW: Contractor will be required to submit the verification report to ascertain character and antecedents from the Civil Administration towards the persons engaged under this contract to the Head of the user Department before engagement.

24.0 In case of any doubt or dispute as to the interpretation of any clause herein contained, the decision of the Company's Engineer shall be final and binding on the contractor.

25.0 SET OFF CLAUSE: "Any sum of money due and payable to the contractor (including Security Deposit refundable to them) under this or any other contract may be appropriated by Oil India Limited and set off against any claim of Oil India Limited (or such other person or persons contracting through Oil India Limited) for payment of a sum of money arising out of this contract or under any other contract made by the contractor with Oil India Limited (or such other person or persons contracting through Oil India Limited)."

26.0 FURNISHING FRAUDULENT INFORMATION/DOCUMENT: The information and documents furnished by the bidder/contractor in respect of the subject tender/contract are expected to be true and genuine. However, if it is detected during technical scrutiny or after award of the contract or after expiry of the contract, that the bidder had submitted any fake/fraudulent document or furnished false statement, the offer/contract shall be rejected/cancelled, as the case may be and the bidder (if fake document/false statement pertains to such bidder) shall be dealt as per the Banning Policy (available in OIL's website) of Company.

27.0 PROVISION FOR ACTION IN CASE OF ERRING/DEFAULTING AGENCIES: Action against erring and defaulting agencies like bidder, contractor, supplier, vendor, service provider will be as per OIL's Banning Policy dated 6th January, 2017 available in OIL's website www.oil-india.com.

28.0 LIQUIDATED DAMAGES FOR DELAY IN MOBILIZATION/COMPLETION OF WORKS AND SERVICES: In the event of the Contractor's default in timely mobilization/completion within the stipulated period, the Contractor shall be liable to pay liquidated damages @ 0.5% of contract value, per week or part thereof of delay subject to maximum ceiling of 7.5% of contract value.

29.0 SUBCONTRACTING: Contractor shall not subcontract, transfer or assign the contract, in full or any part under this contract, to any third party. Except for the main services under this contract, Contractor may sub-contract the petty support services subject to Company's prior approval. However, Contractor shall be fully responsible for complete execution and performance of the services under the Contract.

30.0 MISCELLANEOUS PROVISIONS: Contractors shall conform in all respects with the provisions of any Statute, Ordinance of Law and the regulations or bye-law of any local or other duly constituted authority which may be applicable to the services and with such rules and regulation public bodies and Companies as aforesaid and shall keep OIL indemnified against all penalties and liability of every kind for breach of any such Statute, Ordinance or Law, regulation or byelaw.

31.0 LIABILITY:

31.1 Except as otherwise expressly provided, neither Company nor its servants, agents, nominees, Contractors, or sub-contractors shall have any liability or responsibility whatsoever to whomsoever for loss of or damage to the equipment and/or loss of or damage to the property of the Contractor and/or their Contractors or sub-contractors, irrespective of how such loss or damage is caused and even if caused by the negligence of Company and/or its servants, agent, nominees, assignees, contractors and sub-contractors. The Contractor shall protect, defend, indemnify and hold harmless Company from and against such loss or damage and any suit, claim or expense resulting there from.

31.2 Neither Company nor its servants, agents, nominees, assignees, Contractors, sub-contractors shall have any liability or responsibility whatsoever for injury to, illness, or death of any employee of the Contractor and/or of its contractors or sub-contractor irrespective of how such injury, illness or death is caused and even if caused by the negligence of Company and/or its servants, agents nominees, assignees, Contractors and sub-contractors. Contractor shall protect, defend, indemnify and hold harmless Company from and against such liabilities and any suit, claim or expense resulting there from.

31.3 The Contractor hereby agrees to waive its right to recourse and further agrees to cause their underwriters to waive their right of subrogation against Company and/or its underwrites, servants, agents, nominees, assignees, Contractors and sub-contractors for loss or damage to the equipment of the Contractor and/or its sub-contractors when such loss or damage or liabilities arises out of or in connection with the performance of the contract.

31.4 The Contractor hereby further agrees to waive its right of recourse and agrees to cause its underwriters to waive their right of subrogation against Company and/or its underwriters, servants, agents, nominees, assignees, Contractors and sub-contractors for injury to, illness or death of any employee of the Contractor and of its contractors, sub-contractors and/or their employees when such injury, illness or death arises out of or in connection with the performance of the contract.

31.5 Except as otherwise expressly provided, neither Contractor nor its servants, agents, nominees, Contractors or sub-contractors shall have any liability or responsibility whatsoever to whomsoever for loss of or damage to the equipment and/or loss or damage to the property of the Company and/or their Contractors or sub-contractors, irrespective of how such loss or damage is caused and even if caused by the negligence of Contractor and/or its servants, agents, nominees, assignees, Contractors and sub-contractors. The Company shall protect, defend, indemnify and hold harmless Contractor from and against such loss or damage and any suit, claim or expense resulting therefrom.

31.6 Neither Contractor nor its servants, agents, nominees, assignees, Contractors, sub-contractors shall have any liability or responsibility whatsoever to whomsoever or injury or illness, or death of any employee of the Company and/or of its contractors or sub-contractors irrespective of how such injury, illness or death is caused and even if caused by the negligence of Contractor and/or its servants, agents, nominees, assignees, contractors and sub-contractors. Company shall protect, defend indemnify and hold harmless Contractor from and against such liabilities and any suit, claim or expense resulting there from.

31.7 The Company agrees to waive its right of recourse and further agrees to cause its underwriters to waive their right of subrogation against Contractor and/or its underwriters, servants, agents, nominees, assignees, Contractors and sub-contractors for loss or damage to the equipment of Company and/or its contractors or sub-contractors when such loss or damage or liabilities arises out of or in connection with the performance of the contract.

31.8 The Company hereby further agrees to waive its right of recourse and agrees to cause it underwriters to waive their right of subrogation against Contractor and/or its underwriters, servants, agents, nominees, assignees, Contractors and sub-contractors for injury to, illness or death of any employee of the Company and of its Contractors, sub-contractors and/or their employees when such injury, illness or death arises out of or in connection with the performance of the Contract.

31.9 LIMITATION OF LIABILITY: Notwithstanding any other provisions except only in cases of willful misconduct and/or criminal acts,

(a) Neither the Contractor nor the Company (OIL) shall be liable to the other, whether in Contract, tort, or otherwise, for any consequential loss or damage, loss of use, loss of production, or loss of profits or interest costs.

(b) Notwithstanding any other provisions incorporated elsewhere in the contract, the aggregate liability of the Contractor in respect of this contract, whether under Contract, in tort or otherwise, shall not exceed 100% of the Contract price, provided however that this limitation shall not apply to the cost of repairing or replacing defective equipment by the Contractor, or to any obligation of the Contractor to indemnify the Company with respect to Intellectual Property Rights.

Company shall indemnify and keep indemnified Contractor harmless from and against any and all claims, costs, losses and liabilities in excess of the aggregate liability amount in terms of clause (b) above.

32.0 CONSEQUENTIAL DAMAGE: Except as otherwise expressly provided, neither party shall be liable to the other for special, indirect or consequential damages resulting from or arising out of the contract, including but without limitation, to loss or profit or business interruptions, howsoever caused and regardless of whether such loss or damage was caused by the negligence (either sole or concurrent) of either party, its employees, agents or sub-contractors.

33.0 INDEMNITY AGREEMENT:

33.1 Except as provided hereof Contractor agrees to protect, defend, indemnify and hold Company harmless from and against all claims, suits, demands and causes of action, liabilities, expenses, cost, liens and judgments of every kind and character, without limit, which may arise in favour of Contractor's employees, agents, Contractors and subcontractors or their employees on account of bodily injury or death, or damage to personnel/property as a result of the operations contemplated hereby, regardless of whether or not said claims, demands or causes of action arise out of the negligence or otherwise, in whole or in part or other faults.

33.2 Except as provided hereof Company agrees to protect, defend, indemnify and hold Contractor harmless from and against all claims, suits, demands and causes of action, liabilities, expenses, cost, liens and judgments of every kind and character, without limit, which may arise in favour of Company's employees, agents, Contractor and subcontractors or their employees on account of bodily injury or death, or damage to personnel/property as a result of the operations contemplated hereby, regardless of whether or not said claims, demands or causes of action arise out of the negligence or otherwise, in whole or in part or other faults.

34.0 APPLICABLE LAW:

34.1 This Contract shall be deemed to be a Contract made under, governed by and construed in accordance with the laws of India for the time being in force and shall be subject to the exclusive jurisdiction of Courts situated at Dibrugarh in Assam.

34.2 The Bidders shall ensure full compliance of various Indian Laws and Statutory Regulations, to the extent applicable for performing under this Contract.

35.0 TAXES: Tax levied as per the provisions of Indian Income Tax Act and any other enactment/rules on income derived/payments received under the contract will be on Contractor's account.

36.0 SUBSEQUENTLY ENACTED LAWS:

36.1 In the event of introduction of any new legislation or any change or amendment or enforcement of any Act or Law, rules or regulations of Government of India or State Government(s) or Public Body which becomes effective after the date of submission of Price Bid or revised price bid, if any, for this CONTRACT and which results in increased/decreased cost of the works under the CONTRACT through increased/decreased liability of taxes, (other than personnel and Corporate taxes), duties, the Parties shall agree to a revision in pricing to reflect such change subject to the production of documentary proof to the satisfaction of the COMPANY/CONTRACTOR as applicable to the extent which directly is attributable to such introduction of new legislation or change or amendment as mentioned above and adjudication by the competent authority (applicable when disputed by COMPANY) & the courts wherever levy of such taxes/duties are disputed by COMPANY/CONTRACTOR.

36.2 Any increase in net amount of the duties and taxes (i.e. the amount of taxes/duties payable minus eligible credit of taxes/duties paid on input services/inputs) after the contractual completion/mobilization date during the extended period will be to the contractor's account, where delay in completion/mobilization period is attributable to

the CONTRACTOR. However, any decrease in net amount of the duties and taxes (i.e. the amount of taxes/duties payable minus eligible credit of taxes/duties paid on input services/inputs) after the contractual completion/mobilization date will be to COMPANY's account.

36.3 The Contract Price and other prices given in the Schedule of Prices are based on the applicable tariff as indicated by the CONTRACTOR in the Schedule of Prices. In case this information subsequently proves to be wrong, incorrect or misleading, COMPANY will have no liability to reimburse/pay to the CONTRACTOR the excess duties, taxes, fees, if any finally levied/imposed by the concerned authorities. However, in such an event, COMPANY will have the right to recover the difference in case the rate of duty/tax finally assessed is on the lower side.

36.4 Notwithstanding the provision contained in clause 36.1 to 36.2 above, the COMPANY shall not bear any liability in respect of:

- i. Personal taxes on the personnel deployed by CONTRACTOR, his sub-contractor/sub-sub-contractors and Agents etc.
- ii. Corporate taxes and Fringe benefit tax in respect of contractor and all of their sub-contractors, agents etc.
- iii. Other taxes & duties including Customs Duty, Excise Duty and Service Tax in addition to new taxes etc. in respect of sub-contractors, vendors, agents etc. of the CONTRACTOR.

36.5 In order to ascertain the net impact of the revisions/enactment of various provisions of taxes/duties, the CONTRACTOR is liable to provide following disclosure to COMPANY:

- i. Details of each of the input services used in relation to providing service to COMPANY including estimated monthly value of input service and service tax amount.
- ii. Details of Inputs (material/consumable) used/required for providing service to Company including estimated monthly value of input and excise duty/CVD paid/payable on purchase of inputs.

37.0 GOODS AND SERVICES TAX:

37.1 GENERAL REMARKS ON TAXES & DUTIES:

In view of **GST** Implementation from 1st July 2017, all taxes and duties including Excise Duty, CST/VAT, Service tax, Entry Tax and other indirect taxes and duties have been submerged in **GST**. Accordingly reference of Excise Duty, Service Tax, VAT, Sales Tax, Entry Tax or any other form of indirect tax except of **GST** mentioned in the bidding document shall be ignored.

37.2 Bidders are required to submit copy of the GST Registration Certificate while submitting the bids wherever **GST** (CGST & SGST/UTGST or IGST) is applicable.

37.3 “GST” shall mean Goods and Services Tax charged on the supply of material(s) and services. The term **“GST”** shall be construed to include the Integrated Goods and Services Tax (hereinafter referred to as “IGST”) or Central Goods and Services Tax (hereinafter referred to as “CGST”) or State Goods and Services Tax (hereinafter referred to as “SGST”) or Union Territory Goods and Services Tax (hereinafter referred to as “UTGST”) depending upon the import/interstate or intrastate supplies, as the case may be. It shall also mean GST compensation Cess, if applicable.

37.4 Quoted price/rate(s) should be inclusive of all taxes and duties, except **GST (i.e. IGST or CGST and SGST/UTGST applicable in case of interstate supply or intra state supply respectively and cess on GST if applicable) on the final service**. However, GST rate (including cess) to be provided in the respective places in the Price Bid. Please note that the responsibility of payment of GST (CGST & SGST or IGST or UTGST) lies with the Supplier of Goods/Services (Service Provider) only. Supplier of Goods/Services (Service Provider) providing taxable service shall issue an Invoice/Bill, as the case may be as per rules/regulation of **GST**. Further, returns and details required to be filled under GST laws & rules should be timely filed by Supplier of Goods/Services (Service Provider) with requisite details.

37.4.1 Bidder should also mention the **Harmonized System of Nomenclature (HSN)** and **Service Accounting Codes (SAC)** at the designated place in SOR.

37.5 Where the OIL is entitled to avail the input tax credit of GST:

37.5.1 OIL will reimburse the **GST** to the Supplier of Goods/Services (Service Provider) at actuals against submission of Invoices as per format specified in rules/regulation of GST to enable OIL to claim input tax credit of **GST** paid. In case of any variation in the executed quantities, the amount on which the **GST** is applicable shall be modified in same proportion. Returns and details required to be filled under GST laws & rules should be timely filed by supplier with requisite details.

37.5.2 The input tax credit of **GST** quoted shall be considered for evaluation of bids, as per evaluation criteria of tender document.

37.6 Where the OIL is not entitled to avail/take the full Input Tax Credit of GST:

37.6.1 OIL will reimburse **GST** to the Supplier of Goods/Services (Service Provider) at actuals against submission of Invoices as per format specified in rules/regulation of **GST** subject to the ceiling amount of **GST** as quoted by the bidder. In case of any variation in the executed quantities (If directed and/or certified by the In-Charge) the ceiling amount on which **GST** is applicable will be modified on pro-rata basis.

37.6.2 The bids will be evaluated based on total price including **GST**.

37.7 Payments to Service Provider for claiming **GST** amount will be made provided the above formalities are fulfilled. Further, OIL may seek copies of challan and certificate from Chartered Accountant for deposit of **GST** collected from OIL.

37.8 Contractor/vendor shall be required to issue tax invoice in accordance with GST Act and/or Rules so that input credit can be availed by OIL. In the event that the

contractor/vendor fails to provide the invoice in the form and manner prescribed under the GST Act read with GST Invoicing Rules thereunder, OIL shall not be liable to make any payment on account of **GST** against such invoice.

37.9 GST shall be paid against receipt of tax invoice and proof of payment of **GST** to government. In case of non-receipt of tax invoice or non-payment of **GST** by the contractor/vendor, OIL shall withhold the payment of **GST**.

37.10 GST payable under reverse charge mechanism for specified services or goods under GST act or rules, if any, shall not be paid to the contractor/vendor but will be directly deposited to the government by OIL.

37.11 Where OIL has the obligation to discharge **GST** liability under reverse charge mechanism and OIL has paid or is/liable to pay **GST** to the Government on which interest or penalties becomes payable as per GST laws for any reason which is not attributable to OIL or ITC with respect to such payments is not available to OIL for any reason which is not attributable to OIL, then OIL shall be entitled to deduct/setoff/recover such amounts against any amounts paid or payable by OIL to Contractor/Supplier.

37.12 Notwithstanding anything contained anywhere in the Agreement, in the event that the input tax credit of the **GST** charged by the Contractor/Vendor is denied by the tax authorities to OIL for reasons attributable to Contractor/Vendor, OIL shall be entitled to recover such amount from the Contractor/Vendor by way of adjustment from the next invoice. In addition to the amount of **GST**, OIL shall also be entitled to recover interest at the rate prescribed under GST Act and penalty, in case any penalty is imposed by the tax authorities on OIL.

37.13 TDS under GST, if applicable, shall be deducted from contractor's/vendor's bill at applicable rate and a certificate as per rules for tax so deducted shall be provided to the contractor/vendor.

37.14 The Contractor will be under obligation for charging correct rate of tax as prescribed under the respective tax laws. Further the Contractor shall avail and pass on benefits of all exemptions/concessions available under tax laws. Any error of interpretation of applicability of taxes/duties by the contractor shall be to contractor's account.

37.15 It is the responsibility of the bidder to quote the correct GST rate. The classification of goods/services as per GST (Goods & Service Tax) Act should be correctly done by the contractor to ensure that input tax credit on GST (Goods & Service Tax) is not lost to the OIL on account of any error on the part of the contractor.

37.16 In case, the quoted information related to various taxes, duties & levies subsequently proves wrong, incorrect or misleading, OIL will have no liability to reimburse the difference in the duty/tax, if the finally assessed amount is on the higher side and OIL will have to right to recover the difference ~~and~~ in case the rate of duty/taxes finally assessed is on the lower side.

37.17 Notwithstanding anything mentioned elsewhere in the Bidding Document the aggregate liability of OIL towards Payment of GST shall be limited to the volume of GST

declared by the bidder in its bid & nothing shall be payable extra except for the statutory variation in GST.

37.18 Further, it is the responsibility of the bidders to make all possible efforts to make their accounting/IT system GST compliant in order to ensure availability of Input Tax Credit (ITC) to Oil India Ltd.

37.19 GST liability, if any on account of supply of free samples against any tender shall be to bidder's account.

37.20 In case of statutory variation in **GST**, other than due to change in turnover, payable on the contract value during contract period, the Supplier of Goods/Services (Service Provider) shall submit a copy of the 'Government Notification' to substantiate the rate as applicable on the Bid due date and on the date of revision.

Beyond the contract period, in case OIL is not entitled for input tax credit of **GST**, then any increase in the rate of **GST** beyond the contractual delivery period shall be to Service provider's account whereas any decrease in the rate **GST** shall be passed on to the OIL.

Beyond the contract period, in case OIL is entitled for input tax credit of **GST**, then statutory variation in applicable **GST** on supply and on incidental services, shall be to OIL's account.

Claim for payment of **GST**/Statutory variation, should be raised within two [02] months from the date of issue of 'Government Notification' for payment of differential (in %) **GST**, otherwise claim in respect of above shall not be entertained for payment of arrears.

The base date for the purpose of applying statutory variation shall be the Bid Opening Date.

37.21 The contractor will be liable to ensure to have registered with the respective tax authorities, wherever applicable and to submit self-attested copy of such registration certificate(s) and the Contractor will be responsible for procurement of material in its own registration (GSTIN) and also to issue its own Road Permit/E-way Bill, if applicable etc.

37.22 In case the bidder is covered under Composition Scheme under GST laws, then bidder should quote the price inclusive of the GST (CGST & SGST/UTGST or IGST). Further, such bidder should mention "Cover under composition system" in column for GST (CGST & SGST/UTGST or IGST) of price schedule.

37.23 OIL will prefer to deal with registered supplier of goods/services under GST. Therefore, bidders are requested to get themselves registered under GST, if not registered yet. However, in case any unregistered bidder is submitting their bid, their prices will be loaded with applicable GST while evaluation of bid. Where OIL is entitled for input credit of GST, the same will be considered for evaluation of bid as per evaluation methodology of tender document.

37.24 Procurement of Specific Goods: Earlier, there is no tax incidence in case of import of specified goods (i.e. the goods covered under List-34 of Customs Notification no. 12/2012-Cus dated. 17.03.2012 as amended). Customs duty is not payable as per the policy. However, under GST regime, IGST Plus GST compensation cess (if applicable)

would be liveable on such imports. Bidders should quote GST as inclusive considering IGST component for the imported Materials portion while quoting their prices on destination basis. However, GST rate to be specified in the price bid format.

37.25 Documentation requirement for GST:

The vendor will be under the obligation for invoicing correct tax rate of tax/duties as prescribed under the GST law to OIL, and pass on the benefits, if any, after availing input tax credit.

Any invoice issued shall contain the following particulars:

- a) Name, address and GSTIN of the supplier;
- b) Serial number of the invoice;
- c) Date of issue;
- d) Name, address and GSTIN or UIN, if registered of the recipient;
Note: OIL GSTIN numbers are as follows:
Assam :18AAACO2352C1ZW
Arunachal Pradesh :12AAACO2352C1Z8
- e) Name and address of the recipient and the address of the delivery, along with the State and its code,
- f) HSN code of goods or Accounting Code of services[SAC];
- g) Description of goods or services;
- h) Quantity in case of goods and unit or Unique Quantity Code thereof;
- i) Total value of supply of goods or services or both;
- j) Taxable value of supply of goods or services or both taking into discount or abatement if any;
- k) Rate of tax (IGST, CGST, SGST/UTGST, cess);
- l) Amount of tax charged in respect of taxable goods or services (IGST, CGST, SGST/UTGST, cess);
- m) Place of supply along with the name of State, in case of supply in the course of interstate trade or commerce;
- n) Address of the delivery where the same is different from the place of supply and
- o) Signature or digital signature of the supplier or his authorized representative.
GST invoice shall be prepared in triplicate, in case of supply of goods, in the following manner
 - a) The original copy being marked as ORIGINAL FOR RECIPIENT;
 - b) The duplicate copy being marked as DUPLICATE FOR TRANSPORTER and
 - c) The triplicate copy being marked as TRIPLICATE FOR SUPPLIER.

In case of any advance given against any supplies contract, the supplier of the goods shall issue Receipt Voucher containing the details of details of advance taken along with particulars as mentioned in clause no. (a), (b), (c), (d), (g), (k), (l), (m) & (o) above.

37.26 ANTI-PROFITEERING CLAUSE:

As per Clause 171 of GST Act it is mandatory to pass on the benefit due to reduction in rate of tax or from input tax credit to the consumer by way of commensurate reduction in prices. The Supplier of Goods/Services may note the above and quote their prices accordingly.

37.26.1 In case the GST rating of vendor on the GST portal/Govt. official website is negative/black listed, then the bids may be rejected by OIL. Further, in case rating of bidder is negative/black listed after award of work for supply of goods/services, then OIL shall not be obligated or liable to pay or reimburse GST to such vendor and shall also be entitled to deduct/recover such GST along with all penalties/interest, if any, incurred by OIL.

38.0 WITHHOLDING:

Company may withhold or nullify the whole or any part of the amount due to Contractor, after informing the Contractor of the reasons in writing, on account of subsequently discovered evidence in order to protect Company from loss on account of:

- a) For non-completion of jobs.
- b) Contractor's indebtedness arising out of execution of this Contract.
- c) Defective work not remedied by Contractor.
- d) Claims by sub-Contractor of Contractor or others filed or on the basis of reasonable evidence indicating probable filing of such claims against Contractor.
- e) Failure of Contractor to pay or provide for the payment of salaries/wages, contributions, unemployment compensation, taxes or enforced savings with-held from wages etc.
- f) Failure of Contractor to pay the cost of removal of unnecessary debris, materials, tools, or machinery.
- g) Damage to another Contractor of Company.
- h) All claims against Contractor for damages and injuries, and/or for non-payment of bills etc.
- i) Any failure by Contractor to fully reimburse Company under any of the indemnification provisions of this Contract. If, during the progress of the work Contractor shall allow any indebtedness to accrue for which Company, under any circumstances in the opinion of Company may be primarily or contingently liable or ultimately responsible and Contractor shall, within five days after demand is made by Company, fail to pay and discharge such indebtedness, then Company may during the period for which such indebtedness shall remain unpaid, with-hold from the amounts due to Contractor, a sum equal to the amount of such unpaid indebtedness.

Withholding will also be effected on account of the following:

- i) Order issued by a Court of Law in India.
 - ii) Income-tax deductible at source according to law prevalent from time to time in the country.
 - iii) Any obligation of Contractor which by any law prevalent from time to time to be discharged by Company in the event of Contractor's failure to adhere to such laws.
 - iv) Any payment due from Contractor in respect of unauthorized imports.
- When all the above grounds for withholding payments shall be removed, payment shall thereafter be made for amounts so with-hold.

Notwithstanding the foregoing, the right of Company to withhold shall be limited to damages, claims and failure on the part of Contractor, which is directly/indirectly related to some negligent act or omission on the part of Contractor.

39.0 In case any part of the work is sub-contracted to a Micro or Small Enterprise as per contract conditions than the contractor shall provide complete details (i.e. name of the subcontractor, value of sub-contacted work, copy of valid registration certificate etc.) of the sub-contractor to OIL.

40.0 PERFORMANCE SECURITY: The Contractor has furnished to Company a Demand Draft/Bank Guarantee No. _____ dated _____ issued by _____ for _____ (being 10% of annualized contract value) with validity of 03 (Three) months beyond the contract period. The performance security shall be payable to Company as compensation for any loss resulting from Contractor's failure to fulfill their obligations under the Contract. If the performance security is submitted in the form of bank guarantee then in the event of extension of the Contract period, the validity of the bank guarantee shall be suitably extended by the Contractor. The bank guarantee will be discharged by Company not later than 30 days following its expiry.

41.0 NOTICE:

41.1 Any notice given by one party to other, pursuant to this Contract shall be sent in writing or by telex or Fax and confirmed in writing to the applicable address specified below:

Company

a) For contractual matters

CGM (Contracts)
OIL INDIA LIMITED
PO DULIAJAN - 786602
ASSAM, INDIA
Phone No. 91-374-2808650
Email: contracts@oilindia.in

b) For technical matters

CGM-PSS
OIL INDIA LIMITED
PO DULIAJAN - 786602,
ASSAM, INDIA
Phone No. 91-374-2806440
Email: agadhmedhi@oilindia.in

Contractor

Phone No.:

41.2 A notice shall be effective when delivered or on the notice's effective date, whichever is later.

Schedule of Work, Unit and Quantity

DESCRIPTION OF WORK/SERVICE: Hiring of services for Comprehensive Annual Maintenance Contract (CAMC) for the new facilities installed post M B Lal Committee recommendations in Moran Tank Farm for a period of 2 (two) years extendable by 1 (one) year.

Item No.	Description of Services	UOM	Estimated Quantity
10	Comprehensive Annual maintenance charge for 1st year	QTR	4
20	Comprehensive Annual maintenance charge for 2nd year	QTR	4
30	Cost of mandatory spares - Annexure-I (Electrical)	LSM	1
40	Cost of mandatory spares - Annexure-II (Mechanical)	LSM	1
50	Cost of mandatory spares - Annexure-III (Instrumentation)	LSM	1
60	Periodic Maintenance (quarterly) of Rim Seal Fire Protection System for 4 nos. of 24.4 meter diameter floating roof tanks - Annexure-IV	QTR	8
70	Breakdown/Emergency Maintenance of Rim Seal Fire Protection System for 4 nos. of 24.4 meter diameter floating roof tanks - Annexure-IV	NO	4
80	Cost of critical/mandatory/non-mandatory spares – Annexure-IV & Annexure IV(A)	LSM	1

1. Tenure of Agreement: 2 (two) years with a provision of extension by 1 (one) year.

2. Mobilisation Period:

Personnel's & Consumables: 30 (Thirty) days from the date of issue of LOA.

Mandatory Spares: 60 (Sixty) days from the date of issue of LOA.

3. Total quoted price shall be inclusive of Spares, Manpower, Fooding, Accommodation, Transportation, Tools/Tackles and other logistic supports.

4. It is mandatory for the bidder to quote against each spare and each line item of the Annexures I, II, III, IV and IV(A), the rates of which is shall remain valid throughout the tenure of contract.

5. The price of the quoted spares shall remain fixed during the tenure of contract. If OIL decides to buy additional spares apart from mandatory spares as listed below, the contractor is bound to provide the same and the cost of the particular

spare/spares will be paid as per the quoted price only.

Note:

- a. The payment against Sl. Nos. 30, 40, 50 and 80 will be paid once the all the listed spares reaches each installation after inspection and certification by the OIL's Technical Committee Members.
- b. All the spares to be supplied must match with the corresponding make/model/part nos. and/or the already installed items at Moran Tank Farm. If case a prospective bidder(s) wants to visit installation to collect specifications, they may do so at their own cost within two days within the bidding period with due permission from OIL provided the bidder(s) have purchased the bid document before approaching OIL for permission.

SPECIAL CONDITIONS OF THE CONTRACT (SCC)**(PART-1)****1.0 TERMS OF REFERENCE AND SCOPE OF SERVICES FOR COMPREHENSIVE ANNUAL MAINTENANCE CONTRACT (CAMC) FOR MORAN TANK FARM (MTF)**

1.1 General Description of Moran Tank Farm: Moran Tank Farm (MTF) is located within OIL Industrial area at a distance of 6 km from the Moran Railway station. Nearest Airport is Mohanbari (Dibrugarh) Airport about 55 km from the MTF. Moranhat Police Station is located at a distance of 5 km and Fire Service Station of OIL, Moran is just 0.3 km from MTF. The NH-37 is passing nearby at a distance of 2.25 km.

Crude Oil from various field installations (OCSs & EPS) after treatment is pumped to the Moran Tank Farm for further onward process. From here crude oil is then handed over to PIPELINE department for onward transportation to three refineries namely Numaligarh (NRL), Guwahati refinery & Bongaigaon (BRPL) through our trunk pipeline after properly drained out water and getting satisfactory TMB sample result (within 0.5%). The crude oil distribution to the refineries is based on OCC allocation. There are five no. of crude oil tanks out of which four are FLOATING ROOF and one is FIXED ROOF type. There are two no. formation water tanks of capacity 160 KL each tank and one no. skimmed oil tank of capacity 18 KL.

1.1.1 Description of Facilities:**a. OIL Tanks**

- i) Four (04) nos. Floating Roof welded tanks of 5000 KL capacity. The floating roof tanks are enclosed within a dyke of adequate capacity (equal to the capacity of the tank) to arrest crude oil if any leakage appear.
- ii) One (1) no. Fixed Roof welded tank of 2500 KL capacity for storage of crude oil.
- iii) One (1) no. 18KL capacity welded tank for collecting skimmed oil from formation water tanks.

b. Formation Water Tanks: Two (2) no. formation water tanks of capacity 160 kl each to collect formation water from oil storage tanks, which is coming with crude oil.

c. Pumps:

- i) 4 nos. centrifugal pumps (3 no. motor driven & 1 no. engine driven) are installed for Fire Fighting. Capacity of the pumps is 300 kl/Hr.
- ii) 1 no. motor driven centrifugal formation water pump for disposing formation water at 2 no. F/W disposal wells.
- iii) 1 no. reciprocating type oil soluble de-emulsifier pump of capacity 0.5 HP for dozing OSD at crude oil incoming line.
- iv) 2 no. vertical centrifugal pumps for charging (pumping) crude oil from tank to EET.

d. Fire Fighting

- i) 6 (six) number of diesel engine driven Fire water drenching pumps with 616KL/Hr capacity at 105m water Head.
 - ii) 2 (two) nos of motor driven Jockey Pumps for maintaining the ring main pressure with 120 m³/hr capacity and 110 meter head.
 - iii) 2 (two) nos of Foam pumps (1 diesel + 1 motor driven) with 17.70 KL Foam availability.
 - iv) Foam Monitors & Foam Pourers at the tanks. Each storage tank has its own in-situ foam generating arrangement, water drenching system to fight accidental fire. An integrated fire protection and fire-fighting facility are available for the plant in accordance with OISD-STD-117.
 - v) Standby static water storage facility in two (2) nos of over ground tanks of 4050 KL each is available in accordance with OISD norms for catering to bulk fire fighting water requirement during emergencies
 - vi) Ten (10) numbers of Medium Expansion Foam Generators.
 - vii) Differential Pressure Inductor Foam system.
 - viii) Twelve (12) numbers of manual operated High Volume Long Range Monitors
 - ix) Fire Detection & Suppression System. Any other changes to meet OISD-STD-117 and MB Lal committee recommendations
 - x) Clean Agent System for Control Room.
- e. Emulsion Treater:** Emulsion Treater has been installed at Moran Tank Farm to separate oil-water emulsion stored in the crude oil storage tanks and for breaking or resolving emulsified crude oil into water and saleable clean oil components. At present the tank farm receive crude oil from OCS Moran, 2nos OCS's from Shalmari and also from Deroi EPS which is being collected in 4nos tanks. After settling, separated water from crude is disposed and remaining hydrated crude pumped to the Emulsion Treater, where BS&W content is processed down to desirable limit. After that the crude is handed over to Pump Station-2 for onward dispatch to refineries.

2.0 BROAD SCOPE OF WORK: The broad scope of work under this **COMPREHENSIVE ANNUAL MAINTENANCE CONTRACT** is to maintain the following Equipments / Facilities / Systems along with making provision of spares as per terms of this contract for **Moran Tank Farm** (Refer Schedule of Quantities, PART-II of contract).

- a) Safety PLC system & consoles and their associated systems and subsystems
- b) Complete Tank Farm Management system (TFMS) with temperature and water cut measurement.
- c) CCTV systems , subsystems and field installed cameras
- d) clean agent system,
- e) Fire alarm panel & detectors,
- f) Packaged AC system,
- g) UPS system for Power Backup,
- h) Control Room Internal lighting system
- i) SIL certified RADAR and SERVO Level gauges in each tank
- j) ROSOV & MOV systems - for automatic isolation of tank inlet & outlet. ROSOV ARE FAIL SAFE AND FIRE SAFE TYPE.
- k) Rim Seal Fire Protection System
- l) Online Gas Detector System ESD (Emergency shutdown system) from centralized control room & field

- m) HVLRM – High velocity long range monitors – Remote & Manual type - with control panels, MOV etc.
- n) Fire water pumps, Jockey pumps & associated sub-systems inside pump house, related control system, electrical system and equipment/valves installed in the hydrant line
- o) Fire water tanks, sprinkler system and related valves/instruments
- p) Foam system & Piping Network– pumps, tanks, valves and related E&I
- q) Electrical Switch room with PMCC, ELDB, ACDB & MLDB panels, Transformers etc.
- r) Electrical Earthing System of Tank Farm.
- s) All Field Instruments like PT, TT, Solenoid Valve, and Pressure switch, Pressure Gauge etc.
- t) Compressed Instrument Air System – Compressor, dryer, related E&I, valves etc.
- u) High Mast Lighting system and outdoor lighting near ROSOV/MOV panels outside dyke
- v) OWS system
- w) Control Room, Fire pump house, Switch room, all sheds etc. in totality- Civil, AC & Lighting.

3.0 DETAIL SCOPE OF WORKS:

3.1 INSTRUMENTATION:

Comprehensive Annual Maintenance Contract (CAMC) shall include maintenance services for all instrumentation systems of Moran Tank Farm including spares and consumables, tools/tackles as required for regular maintenance/preventative maintenance/breakdown maintenance if any for the following systems during the entire period of the contract and its extension, if any.

3.1.1 PLC (Programmable Logic Controller) based control system: Complete PLC system including barriers, multiplexers, hardware, other device interfaces, PLC Servers, TFTs, PCs& printers, marshalling panels etc. including supply of spares, consumables (Refer Schedule of Quantities, PART-II of contract).

The PLC system is SIL-3 (Safety Manager) and supplied by **M/s Honeywell Automation India Ltd.** with redundant controller along with redundant I/O cards. The each PLC system have two terminal servers, two operator stations, one Engineering Station, One History Note PC with printers, one TFMS server and one TFMS SCADA Server, their subsystems and their interconnections as per system architecture designed and commissioned under MB Lal recommendation Project for Moran Tank Farm.

The Safety Manager PLC user for emergency shutdown for any Fire & Gas. PLC is interfaced with Honeywell SCADA package i.e. Experion Process Knowledge System (EKPS) through 10/100mpbs LAN connectivity.

The PLC has dual redundant processors with hot standby capability and redundant I/O system configuration. PLC has in built feature of self-diagnostics of hardware and program. The application of PLC system is as below.

For communication between processor and I/O, I/O-Extender is placed in I/O rack. Communications between PLC Processor and I/O modules have redundancy.

Honeywell Make Safety Manager PLC system with QPP-2 CPU's are used to executive action & alert plant persons in case of fire detection/Gas leakage. This PLC is mainly

used for fire & Gas detection and alarming of various gas detectors. The operational logic is stored in this PLC. The operator station and Engineering station take the data from the PLC. USI(Universal Safety Interface) modules are installed in the processor racks. All I/O's are connected to the CPU through Daisy Chain topology.

Safety Manager typically consists of the following main components:

- Cabinet enclosure with swing frame
- Power supply consisting of power supply unit(PSUs) generating 24VDC, main switches and power distribution rails
- Controller chassis with 2 Nos. QPPs(Quadruple Processor Packs), 2 Nos of USI(Universal Serial Interface) communication modules, 2 Nos of PSU/s(Power Supply Units-24 V to 5 V supply modules) and 1 No of BKM(Battery and Key switch Module)
- Input/output chassis
- Field Termination assemblies(FTA) and/or terminals

Communication Network comprises of two Westermo switches in redundant state which are connected to the project LAN. TCP/IP is the protocol used for communication between the stations and PLC. Operator station and Engineering Station has one number dual port NIC Card for communication over the redundant LAN. Each node on the network has two TCP/IP addresses except printers.

Power supply to PLC system is through one set of redundant UPS system with battery backup installed in the control room. The PSU-UNI2450U power supply in Safety Manager(SM) is a UL approved switch mode DC power supply which accepts wide range of input voltages to provide 24VDC/28 VDC.

The major field instruments/systems connected to SIL-3 PLC systems are the following:

- 1) Servo Level Transmitter with Tank side indicators - 5 Nos.
- 2) Fire Water Radar Tank Level Transmitter with Tank side indicators-2 Nos.
- 3) Hydrocarbon Gas Detector- 5 Nos.
- 4) Fire Water Flow Transmitter- 2 Nos.
- 5) Fire Water Pressure Transmitter- 2 Nos.
- 6) TFMS Pressure Transmitter- 5 Nos.
- 7) Inlet Line Pressure Transmitter- 2 Nos.
- 8) Air compressor Pressure Transmitter-2 Nos.
- 9) Air Flow transmitter- 1 No.
- 10) Actuators of Remote operated shut off valve (ROSOV) - 10 Nos.
- 11) Actuators of Motor operated Valve (MOV) for Auto/Remote operation from Control Room - 12 Nos.
- 12) Complete ESD(Emergency Shutdown systems) interlocks

Note to Clause No. 3.1.1: The above list is not exhaustive, indicative only. The maintenance of all the PLC I/O Loops along with the field instruments terminated to it shall be in the contractor's scope. The control Room Servers, PCs, Display units and all accessories along with PLC controllers, Power supply units, I/O Cards, all Marshalling Panel Items, their maintenance, repair/ replacement/ upgradation etc. as and when required during the tenure of the contract shall be under contractor's scope. The preventive and breakdown maintenance of field instruments, their connecting junction boxes (JBs), terminal blocks and their accessories including the

interconnecting cables/cable glands from PLC control panel through Junction boxes to field instruments shall be under the scope of this contract.

3.1.2 TFMS system: Total Tank Farm Management System (TFMS) and its sub-systems, TFMS servers including supply of spares, consumables (Refer Schedule of Quantities, PART-II of contract).

Brief Description of TFMS System: The Tank Farm Management System (TFMS) is comprised of the following equipment including their interconnections

(a) Field equipment:

- (i) Radar Tank Level Transmitters - 7 Nos.
- (ii) Multi-element averaging type Temperature elements (VITO) for each Radar Level Transmitter.
- (iii) Tank side Indicator at the tank bottom for each Radar Tank Level Gauges
- (iv) Associated Field mounted Junction boxes and Power isolation switch and their interconnecting signal, power cables and cable glands etc.

b) Control room mounted Equipment:

- (i) Common interface Unit-CIU Prime: 2 Nos.
- (ii) Common interface Unit-CIU PLUS: 2 Nos.
- (iii) TFMS Servers (1 No.) with all required software packages including peripherals such as TFT, Keyboard, Printers.
- (iv) Hand Held configurator/calibrator for programming & configuration of Radar Gauges.

Note to Clause No.3.1.2: The scope of the contractor shall include but not limited to the following:

- 1) The contractor shall carry out routine calibration & Configuration as required as per Original Equipment Manufacturer (OEM) recommendation and shall be included in each preventative maintenance jobs.
- 2) TFMS database software upgradation during the tenure of the contract as and when upgrade is issued by the OEM.
- 3) Calibration report shall be submitted to OIL for record after each calibration.
- 4) The spares as and when required for maintenance during the tenure of the contract including minor/major repair or replacement of a part or whole shall be under the scope of contractor.
- 5) Any decommissioning/ re-commissioning jobs related to TFMS System if required owing to undergo maintenance activities of the crude oil Tanks as planned by the Installation Manager (IM) during the tenure of the contract.

The broad scope of work under the maintenance contract shall include but not limited to Routine/Preventive/Breakdown maintenance, configuration, calibration/checking, software updates, decommissioning/re-commissioning if required for maintenance purpose etc. including repair/replacement of a part or whole as required during the tenure of the contract to keep the system functional.

3.1.3 THE CONTRACTOR MUST INCLUDE THE FOLLOWING IN THE MAINTENANCE PLAN:

(I) PREVENTIVE MAINTENANCE: Contractor shall depute their qualified service engineers as per terms of this contract to installation site (Moran Tank Farm) for regular system check-ups, general healthiness of the system (H/W, S/W, Power

supply, calibration checks, solving of any reported problems etc.) as part of periodic maintenance including consumables required for normal maintenance purpose. Contractor shall also carry out complete overhaul of the system, inspection of HW/SW, major repairs, replacement and reporting. The contractor shall also give any other checks required for preventive maintenance and the same shall be included. Generation and submission of diagnostic reports shall also be done by the contractor. Any other jobs as recommended by OEM or as per statutory requirements during the period of the contract shall be also be included into the preventive maintenance plan.

Such preventive maintenance shall be carried out minimum four times in a year for each and every equipment under this contract (Quarterly).

The regular Routine preventive maintenance also includes Software Maintenance/Support as described below:

(a) The Contractor shall maintain the existing operating & application software to improve upon performance of the system. Software modification and up gradation as & when required shall also be covered under this scope at no extra cost. During the contract period and its extension if any, if the systems require software release up gradation and same is necessarily required then same shall be provided without any additional cost implication to OIL. During the contract period and its extension if any, the system shall be also upgraded to its desired release to meet any requirement of OIL without any additional cost implication to OIL by the Contractor. The modifications required for taking care of statutory requirements shall also be Contractor's responsibility at no extra cost to OIL.

(b) SOFTWARE ENHANCEMENT & SOFTWARE SUPPORT INCLUDING MINOR CHANGES IN GRAPHICS: The Contractor will provide a comprehensive software maintenance and enhancement program for on-going support of the system under this contract. All updates, new releases of the software during the contract period and its extension if any shall be provided without any additional cost. Minor changes in existing graphics including pertaining addition of few equipment / facilities shall be also executed by Contractor at no extra cost.

(c) ANTIVIRUS SOFTWARE SUPPORT: The Contractor will provide necessary antivirus software support if the system software gets affected by any kind of viruses under this contract without any additional cost.

(II) BREAKDOWN MAINTENANCE: The contractor shall keep his maintenance team ready to attend any breakdown maintenance round the clock 365 days in a year. In this regard, the contractor shall maintain an office in Moran to attend any on call breakdown maintenance services 24/7 basis 365 days in a year. The contractor must submit contact details of the persons with office address to the Installation Managers of Moran Tank Farm before commencement of this contract.

(III) The contractor's Instrumentation crew shall visit the site Moran Tank Farm daily during general shift for routine maintenance, inspections, and preventive maintenance adjustments and carry out corrective actions for Systems.

The contractor shall depute their experienced service engineers to installation site to attend the engineering calls round the clock on receipt of the information from operation crew. The engineers deputed to the site shall be well qualified and experienced and as per terms of this contract.

(IV) REGULAR MAINTENANCE: The contractor should keep his maintenance team ready to attend any regular maintenance as on when required as assessed by the contractor or OIL for smooth running of the PLANT.

(V) REGULAR SOFTWARE UPGRADES: Contractor's scope shall include supply of all software upgrades released by OEM for system performance enhancement and system performance improvement at no extra cost. (Refer Schedule of Quantities, PART-II of contract).

Note: Replacement of all spares, consumables as required during preventative or breakdown maintenance shall be in contractor's scope.

3.1.4. To provide the comprehensive maintenance services described under clause Nos 3.1.1, 3.1.2, & 3.1.3 for all the instrumentation Systems and their accessories installed and commissioned under MB Lal Recommendation project for Moran Tank Farm, the contractor shall depute experienced competent instrumentation personnel.

In addition, the contractor shall also obtain a Comprehensive Annual Maintenance Contract with the OEMs or shall have tie up/arrangements with the OEMs for the following two vital instrumentation systems:

- (i) Safety PLC systems make M/s Honeywell,***
- (ii) TFMS system Make Honeywell Enraf and***

For OEM services as required which shall be valid during the period of the contract and its extension if any so as to ensure trouble free maintenance as per terms of this contract.

In case the contractor's service Engineer fails to restore the systems/subsystems and OEM services are required the contractor must obtain services from OEM competent Engineers within 24 hours of reporting of such incident by operation Engineer of Moran Tank Farm, failing which penalty shall be imposed as per contract **clause No.9.0**. In this regard, the contractor must make arrangements with OEMs for AMC/ on-the-call-services as a part of this maintenance contract.

3.1.5 Spares Management:

- (i) The contractor shall store minimum number of spare modules at site for the OIL's usage under normal plant running or used during preventive and breakdown maintenance. The details of activity for any type of maintenance are to be mentioned by the contractor.
- (ii) The contractor shall prepare explicitly a maintenance Plan, the various checks to be carried out by the engineer for the above listed items. Also a standard document consisting of standard procedures and formats for carrying out various activities of this Maintenance Contract shall be furnished for OIL's approval.
- (iii) The contractor service engineer shall maintain a Service Logbook at the site indicating the activities carried out during preventive & breakdown maintenance and also submit service reports based on the maintenance / repairs carried out, modules / parts repaired / replaced along with fault analysis. The contractor shall submit such report on monthly basis.
- (iv) Tools and Tackles: All tools and Tackles including measuring & calibrating equipment as required for carrying out the jobs as per detailed maintenance plans shall be in contractor's scope.

- (v) For supply of spares refer SOQ-Section II of the contract. Apart from that the Contractor shall maintain a stock of necessary spares required. In event of breakdowns, immediate repairing or replacement should be possible without any lead-time for procurement of spares. The contractor shall identify/ access all critical spares in consultation with Installation Manager and keep a readily available stock in Moran Tank Farm to attend breakdown maintenance if any.
- (vi) The contractor shall find a copy of the following documents with the Installation Manager
- (a) Datasheets of the all the instrumentation systems like PLC system, TFMS and their associated systems /subsystems, Field instruments and packaged instruments installed under MB Lal recommendation projects in Moran Tank Farm
 - (b) P& ID of Instrumentation systems
 - (c) Operation & Maintenance Manuals
 - (d) Cable schedules, Cable termination details etc.
- Based on above data, the contractor shall prepare a detail maintenance plan (routine/preventive/breakdown) as per terms of this contract for OIL's approval.

3.1.6 The details of clauses described above are general guideline of the comprehensive maintenance contract and does not limit the scope of work of the contract under Comprehensive Annual Maintenance contract to include any other jobs/services as required for trouble free maintenance of Moran Tank Farm. Any further works/spares required for smooth functioning of PLC/TFMS system along with all its associated systems, subsystems, field instruments etc. shall be executed/arranged by the contractor to minimize the overall breakdown of the system and thereby enabling smooth trouble free operation of the Tank Farms at no extra cost to OIL.

3.1.7: Instrumentation Equipment/Field Instruments list

I. Field Instruments:

Sl No	Instrument Description	Make	Model	Range	Quantity
1	Pressure Transmitter-Water line	Honeywell	STA74L-E1G000-1-C-AHC-11C-B-31A6-F1-000	0-35Kg/cm2	2
2	Pressure Transmitter-TFMS(With Remote Seal Type)	Emerson Rosemount	3051TG2A2B21AI1D4M5Q4S1+1199WDA95ARTW30DAA7	0-10 KG/CM2	3
3	Temperature Gauge	H. Guru	68QSWS3	0-100 Deg C	5
4	PRESSURE TRANSMITTER(TF MS)	EMERSON (ROSEMOUNT)	3051L3AG0MD21AADFKSD4T1Q4M5	(-)2.5 to 2.5 Bar	5

5	FLOW TRANSMITTER with Flow Element 101-FE-1201(PITOT Tube Make Star-Meck)	HoneyWell	STD720-EIHS4AS-1-C-AHC-11C-B-11A0-F1-0000	130-3826 cum/hr	2
6	PRESSURE GAUGE	H.GURU	6PSSWS2	0-25 kg/cm ²	1 1
7	SERVO LEVEL GAUGE with displacer Model No. S0815350	HoneyWell -Enraf	UIAV854C11A2*K *W/Z		5
8	RADAR TANK LEVEL GAUGE with TSI	HoneyWell -Enraf	RHVBVRZ-ASF0830/Z		1
9	RADAR TANK LEVEL GAUGE with TSI	HoneyWell -Enraf	RHVBVRZ-ASS0805/Z		4
10	RADAR TANK LEVEL GAUGE for Fire water Tanks with TSI	HoneyWell -Enraf	RHVBVRZ-ASS0805/Z		2
11	Temperature Sensor (VITO)	Honeywell	UBAN768C11800 950/Z		5
12	ROSOV Pneumatic Actuator	PENTAIR	SL NO:- 14138314P05530 GP		1 0
13	MOV Actuators	AUMA			1 2
14	Gas Detector	CROWCO N	IRmax		5
15	Pressure Switch(Set Point 6 Kg/sq.cm)	SWITZER			2

Note: MRN: Moran

II. Packages Instruments: Air Compressor and Air Dryer Package- both have two instrument air compressor and one air dryer package. All the instrumentation systems of air compressor and air dryer package instruments are in the scope of this maintenance contracts. An indicative list of the instruments are given below:

II.A: Instrument Air Compressor area-Wet & Dry Air Receiver Vessel and Air

Discharge Line

Sl No	Description	Make	Model	Range	Qty
1	Pressure gauge	H.Guru	HGI 370.V.E 016 1666	0 to 16 kg/cm2	1
2	Flow transmitter	Honeywell	STD720E1AC4AS-1-C-AHC-11CB-61A6-F1-0000	-400 to 400 In H2O	1
3	Pressure transmitter	Rosemount	3051CG4A22A1AM5B 4DFE8D424	0 to 16 kg/cm2	2
5	Pressure gauge	H.Guru	HGI.285(R)V.D.015.2 49	0 - 25 kg/cm2	1
6	Temperature gauge	H.Guru	HGI.373 V.F.016.2621	0 - 100 Deg C	1
7	Pressure gauge	H.Guru	HGI.372.V.E.016.167 3	0 - 16 kg/cm2	1
8	Pressure gauge	H.Guru	HGI.285(R)V.D.015.2 45	0 - 25 kg/cm2	1

II.B: Instrument Air Dryer Package Model:SA0200MN Make-Summits

SL NO	Name of Inst.	Model No	Make	Range	Qunatity
1	Pressure gauge	HGI.285(R)V.D.015 .245	H.Guru	0 - 25 kg/cm2	1
2	Pressure Switch	ZDDW	Baumer	0.1 - 1 kg/cm2	2
3	Pressure Gauge	2243PG140030	Baumer	0-16 kg/cm2	8
4	Diff Pressure Gauge	2243PG140035	Baumer	0-1 kg/cm2	2
5	Temperature gauge	2243TG140007	Baumer	0-100 Deg C	7

6	Temperature gauge	HGL.2851(R).V.F01 5.2195	H.Guru	0-100 Deg C	1
7	Pneumatic Actuator	ECF80	Rotex	Max Pressure = 8 Bar	3
8	Limit Switch	DXLW1A2-4R	Rotex	Contact Rating =5 amp.	3
9	Solenoid Valve	M45H,24 V	Avcon	2 -10 Bar	3
10	Solenoid Valve	M50H,24 V	Avcon	0-7 Bar	5
11	Auto Drain Valve	---	Summits	Max Pressure = 10 Kg/cm2	1
12	Air Filter Regulator	---	Janatics	Max Pressure = 10 Bar	
13	Lubricator	---	Janatics	Max Pressure = 10 Bar	

III. SERVERS/WORKSTATIONS/PRINTERS:

Sr. No	Description	Make	Model	Quantity
1	TERMINAL SERVER	MOXA	CN2650I-8	2
2	HISTORY NOTE PC with 22" Colour TFT Monitor	DELL	DELL Optiplex 3020	1
3	PLC ENGG STATION with 22" Colour TFT Monitor	DELL	DELL Optiplex 3020	1
4	PLC OPERATOR STATION with 22" Colour TFT Monitor	DELL	DELL Optiplex 3020	1
5	PLC OPERATOR STATION with 22" Colour TFT Monitor	DELL	DELL Optiplex 3020	1
6	CCTV PROGRAMMING PC with 52" LED TV	DELL	DELL Optiplex 3020	1
7	TFMS PC with 22" Colour TFT	DELL	DELL Optiplex	1

	Monitor		3020	
8	TFMS SCADA with 22" Colour TFT Monitor	DELL	DELL Optiplex 3020	1
9	LASER PRINTER-A3(Connected to History Note PC)	CANO N	LBP3500	1
10	LASER PRINTER A-4	HP	LaserJet Pro P1108	2

IV. CIU & CIU Software:

Sr. No	Description	Make	Model	Quantity
1	CIU PRIME with TFMS Software	Honeywell-Enraf	U**T8808BZZZZZ	2
2	CIU PLUS with TFMS Software	Honeywell-Enraf	U*SP8808RRZZZZ	2
3	Portable Enraf terminal	Honeywell	U**847AA	1
4	HART Calibrator	Honeywell	MCT404-XI-00-UM	1

V. Components of PLC systems:**A. PLC Panel 103-SC#01**

Sr. No	Description	Make	Model Code	Qty.
	CABINET SECTION			
1	Swing Frame Rittal2342.200, RAL 7035	RITTAL	SRTL10002342.35	1
2	Swing Frame MTG kit SR1997.200	RITTAL	SRTL10001997.35	1
3	Swing Fame Locking Bracket 135 mm	RITTAL	PS4808009-AVP-DH35	1
4	Cabinet Fan Assembly	Honeywell	SMOD3611001	1
	SYSTEM-CP			
1	Chassis for Control processor	Honeywell	FS-CPCHAS-	1

			001	
2	Enhanced Performance Quad Processor Pack	Honeywell	FC-QPP-0002	2
3	Universal Safety Interface	Honeywell	FC-USI-0002	2
4	Power Supply Unit 24/5 VDC, 16 A	Honeywell	FC-PSU-240516	2
5	Battery and Keyswitch Module	Honeywell	FC-BKM-0001	1
	SYSTEM-IO			
1	Chassis for redundant I/O Modules	Honeywell	FC-IOCHAS-0001R	4
2	FC-HD Analog I/P Module(24VDC,16 CH)	Honeywell	FC-SAI-1620m	4
3	FC-Digital I/P Module(24 VDC,16CH)	Honeywell	FC-SDI-1624	24
4	FC-Digital O/P Module	Honeywell	FC-SDO-0824	28
5	Coverplate for I/O Chassis(FS-BLIND-CHAS1HE)	Honeywell	FS-BLIND-CHAS1HE	1
6	Coverplate for I/O Chassis(FS-BLIND-CHAS3HE)	Honeywell	FS-BLIND-CHAS3HE	1
7	Coverplate for I/O Chassis(FS-BLIND-CHAS4HE)	Honeywell	FS-BLIND-CHAS4HE	4
8	Blind Module for NOT USED Slots in CPCHAS	Honeywell	FS-BLIND-COM	2
9	Blind FRNT for unused slots IOCHAS, Wide 4TE	Honeywell	FS-BLIND-IO	20
10	IO Extender	Honeywell	FC-IO-0001	8
	COMMUNICATION BUS			
1	Communication Cable Internal between DCOM-CPCHAS	Honeywell	4217015	2
2	Set Ethernet Cable Internal SFTP, 1Y/1G	Honeywell	FS-CCI-HSE-02	2
3	Power Distribution Cable	Honeywell	FS-PDC-MB24-2	1

4	Power Distribution Cable CPCHAS24VDC(PDC-CPSET)	Honeywell	FS-PDC-CPSET	1
5	Power Distribution cable Set IOCHAS-001 24 VDC INT PWR+EXT PWR	Honeywell	FS-PDC-IOSET	4
6	I/O BUS from CPCHAS to IOCHAS	Honeywell	FS-IOBUS-CPIO	2
7	Power Distribution Cable IOCHAS-0001R 5VDC WD	Honeywell	FS-PDC-IOR05	4
8	Bus Terminator for Redundant I/O	Honeywell	FC-TERM-0002	1
9	System Interconnection Cable term. On PIN (SIC interface Cable)	Honeywell	FS-SICC-0001/L8	28
	NETWORK			
1	Communication Interface FTA for RS232 and RS 485	Honeywell	FC-DCOM-232/485	1
2	WESTERMO Ethernet Switch-5 Port	WESTERMO	SDW-550EC	2
	OTHERS			
1	System PS I/P 115/230VAC, O/P 24VDC,50A.....230VAC input from UPS	Honeywell	FC-PSU-UNI2450U	2
2	Earth Leakage Detector	Honeywell	10310/3/IC C	1
3	Power Busbar Max. 200A 24/48/110VDC, 150CM	Honeywell	FS-MB-001	1
4	10A DP MCB for 240V AC system Power Supply(M1, M2)	SIEMENS		2
5	6A DP MCBfor 230V AC NON UPS Fan Supply(Q1)	SIEMENS		1
6	UK5 HESI Terminals for ELD Power + Terminal Server+ Westermo Switch(IPT)	PHOENIX		16
7	UK10N-E(GREY) for 240 AC UPS Power Supply to PS01(ICB1, ICB2)	PHOENIX		12
8	UKION-E Terminal for 230V AC Non UPS Power Supply(UT1)GREY	PHOENIX		3

9	UK2.5B-E GREY Terminals for Alarm wiring(ATB-1)	PHOENIX		16
10	DFBK#12 Type Bus Terminal for 24VDC Power distribution(BT-4)	PHOENIX		1 SET
11	Door Switch(DS-1)			1
12	Tubelight(TL-1)	PARISHRAM		1
13	Fan assembly 230 V	PARISHRAM		1
14	Utility Board(UTB)	UL		1
15	Thermostat			1
	SOFTWARE			
1	SAFETY BUILDER R151 Software BASIC +KB140	Honeywell	FS-SMSB-ST-151	1

B. PLC Panel 103-MC#01

Sr. No	Description	Make	Model Code	Qty.
1	Rittal Cabinet	RITTAL		1
2	DI FTA for DI Module -24VDC,16 CH(A01-A16)	HONEYWELL	FC-TSDI-1624	10
3	DO FTA for DO Module-24VDC, 08CH(B01-B06)	HONEYWELL	FC-TSDO-0824	6
4	DI RTP(RA04-RA09)	UL	UL24D16DIFI-2C-TB MY2-VF	6
5	DO RTP((RB01-RB06)	UL	UL24D08(OFI)-2CMY2N(24DC)	6
6	Utility Board	UL		1
7	230V Tubelight(TL1, TL2)	PARISHRAM		2
8	230V Fan Assembly	PARISHRAM		2
9	Door Switch			2
10	Terminals for Non-UPS 230V AC	PHOENIX	UK10N	3
11	DP MCB of 6A for 230V AC	SIEMENS		1

12	DFBK-12 Power Terminals for 24 VDC Distribution	ELMEX	DBFK-12	1 Set
13	Grey Terminals for Alarm wiring	PHOENIX	UK2.5B-E	4
14	Field Terminals for Signals(Non-Fused)-TB A01-A03& TB A10	PHOENIX	UK2.5B-E	58
15	Field Terminals for Signals(Fused)-TB A01-A00& TB A10	PHOENIX	UK5 HESI(500mA)	58

C. PLC Panel 103-MC#02

Sr. No	Description	Make	Model Code	Qty.
1	Rittal Cabinet	RITTAL		1
2	AI FTA for AI Module(24VDC,16 CH)-C01	HONEYWELL	FC-TSAI-1620M	1
3	AI FTA for AI Module(24VDC,16 CH)-C02	HONEYWELL	FC-TSGAS-1624	1
4	DO FTA Safe Digital Module(24VDC,08 Channels)-B07-B14	HONEYWELL	FC-TSDO-0824	8
5	DI FTA for DI Module(24VDC,16CH)	HONEYWELL	FC-TSDI-1624	2
6	DO RTP(RB 07-RB08)	UL	UL24D08(OFI)-2CMY2N(24VDC)	2
7	Relay(RB09- RB11)	P&F	KSDO-RSH-1.4S.PS2	24
8	Barrier(ZA11-ZA12)	P&F	KFD2-SR2-Ex1.W.LB	28
9	Barrier(ZB12-ZB14)	P&F	KFD2-SL2-Ex1.LK	24
10	Barrier(ZC02)	P&F	KFD2-STC4-Ex1	11
11	Utility Board	UL		1
12	230V Tubelight(TL1, TL2)	PARISHRAM		2
13	DFBK-12 Power Terminals for 24 VDC Distribution	ELMEX	DBFK-12	1 Set

14	230V Fan Assembly	PARISHRAM		2
15	Door Switch			2
16	Terminals for Non-UPS 230V AC	PHOENIX	UK10N	3
17	DP MCB of 6A for 230V AC	SIEMENS		1
18	Grey Terminals for Alarm wiring	PHOENIX	UK2.5B-E	4
19	Field Terminals for Signals(Non-Fused)-TB A11-TB A12	PHOENIX	UK2.5B-E	28
20	Field Terminals for Signals(Fused)-TB A11-A12	PHOENIX	UK5 HESI(500mA)	28
21	Field Terminals for Signals(Non-Fused)-TB C01& C02	PHOENIX	UK2.5B-E	26
22	Field Terminals for signals (Fused)-TB C01& C02	PHOENIX	UK5 HESI(500mA)	26
23	Field Terminals for signals (Fused)-TB C01	PHOENIX	UK5 HESI(100mA)	8
24	Field Terminals for Signals(Non-Fused)-TB B09-TB B14	PHOENIX	UK2.5B-E	48
25	Field Terminals for signals (Fused)-TB B09-TB B14	PHOENIX	UK5 HESI(500mA)	48

D. PLC Power Distribution Panel 103-PDB#01

Sr. No	Description	Make	Model Code	Qty.
1	Rittal Cabinet	RITTAL		1
2	Cabinet Fan assembly with alarm	Honeywell	SMOD3611 001-01	2
3	Digital Current Meter			2
4	Digital Voltage meter			1
5	Indicator			2
6	Current Transformer			2

7	MCCB	SEIMENS		2
8	4A 2P MCB	SEIMENS		2
9	2A 2P MCB	SEIMENS		38
10	10A 2P MCB	SEIMENS		3
11	Bus Bar for 240 VAC			2
12	Door Switch			2
13	HRC Fuse			1
14	Terminals	ELMEX		86
15	Short Link			2

E. Networking Panels 103-NW#01

Sr. No	Description	Make	Model Code	Qty.
1	Rittal Cabinet	RITTAL		1
2	Cabinet Fan assembly with alarm	Honeywell	SMOD3611 001-01	2
3	1U Blanking Plate	RITTAL		7
4	1U Cable Management	RITTAL		5
5	19" Mounting	RITTAL		7
6	Ethernet Switch	D-Link	D-Link- DES-3200- 18	3
7	Terminal Server	MOXA	CN2650I-8	2
8	CIU Prime	Honeywell- Enraf	U**T880BB BBZZZ	2
9	CIU Plus	Honeywell- Enraf	U**SP880R RZZZZZ	2
10	DVR	Honeywell	HD-DVR- 7016	1

11	Utility Socket			10
12	Terminals for UPS 110VAC	PHOENIX	UK10N	30
13	Terminals for Non-UPS 230VAC	PHOENIX	UK10N	6
14	Alarm Terminals	PHOENIX	UK2.5B-E	8
15	Utility Board	UL		1
16	Door Switch			2

3.1.8 Mandatory Spare list:

The contractor must maintain mandatory spares as per the following list for the Tank Farm However the contractor shall assess the requirement and add more spares to this list as required as per maintenance plan.

SL NO.	Field Instruments	Make	Description	Quantity
1.0	Field Instruments			
1.1	Gas Detectors	Crowcon	Model – Irmix	1
1.2	Pressure Transmitter – density measurement	Emerson	Model:- 3051L3AGOMD21AADFK 5D4T1Q4M5	1
1.3	Pressure Transmitter – fire water hydrant line	Honeywell	Model:- STG170E1G0000HCSMZ SA6LPCCTGMBF1CA	1
1.4	Flow Transmitter	Honeywell	Model:- STD720E1HS4AS1CAHC 11CB11AOF10000	1
1.5	Level Gauge	----	-----	1
1.6	Pressure Gauge	H.GURU	Model:- 6PSSWS2	2
1.7	Temperature Gauge	H.GURU	Model:- 68QSWS3	1
2.0	Pressure Relief Valve			
2.1	Disc Spring	-----	-----	2
2.2	Bellows Gasket Set	-----	-----	2
3.0	Local Control Panels			
3.1	All items like push bottom, hand	-----	-----	1 lot(5 nos of each

	switches, MCB, lamps, holder, selector switch, Indicator etc. mounted in the local panel			item)
4.0	PLC Based Systems			
4.1	Each type of module used like I/O cards, all type of processor card, all type of power supply cards, communication cards, interface cards, controller cards, etc. as required for the system.			
4.1a	Analog Input Card	Honeywell	-----	1
4.1b	Digital output Cards	Honeywell	-----	2
4.1c	Digital Input Cards	Honeywell	-----	2
4.1d	Controller – safety PLC	Honeywell	-----	1
4.1e	Power Supply Unit- Safety PLC	Honeywell	-----	1
4.1f	Bulk & Key switch module (BKM)	Honeywell	-----	1
4.1g	Field Termination Assemblies(FTA)			
	FTA (Field Termination Assembly) - DO	Honeywell	-----	2
	FTA (Field Termination Assembly) - DI	Honeywell	-----	1
	FTA (Field Termination Assembly) - AI	Honeywell	-----	1
	FTA (Field Termination Assembly) – Gas detector input	Honeywell	-----	1
4.1i	IS Isolator Barriers			
	a) Analog Input (IS isolator barriers)	Pepperl + Fuchs	Model:- KFD2-STC4-EX1	1

	b) Analog Output (IS isolator barriers)	-----	-----	1
	c) Digital Input (IS isolator barriers)	Pepperl + Fuchs	Model:- KFD2-SR2-EX1.WLB	2
	d) Thermocouple	-----	-----	-----
	e) Digital Output (IS isolator barriers)	Pepperl + Fuchs	Model:- KFD2-SL2-EX1LK	2
4.2	Isolator/ Signal multipliers	-----	-----	1 lot
4.3	Lamps, Selector switches, switches	-----	-----	1 lot
4.4	Annunciators, Lamps, fuses			1 lot
5.0	Tank Farm Management System(TFMS)			
5.1	Power Supply Module	Honeywell (Enraf)	1 no's of all types of radar ,servo, TSI etc.to be kept as spares	1 no's of each type
5.2	Communication module			
5.3	Bearing			
5.4	TSI			
5.5	Prefabricated Cable			
5.6	Fuses			
5.7	Electronic Cards for level instruments			
5.8	Field interface unit (FIU)			
5.9	Antenna	Honeywell (Enraf	-----	1 – free space 1- Still well
5.10	Multi element Temperature Sensor	Honeywell (Enraf	UBAN768C11800970	1
5.11	Power switch	-----	-----	1 lot
6.0	MCT Blocks	-----	-----	1 lot
7.0	Instrumentation valves/fittings/tubes/			1 lot

	cables			
7.1	Instrument globe valves	Champ instruments	-----	5nos
7.2	Instruments manifold	Champ instruments	-----	2nos
7.3	Tube fittings – Male connector		-----	11nos
7.4	Tube fittings – female connector		-----	3nos
7.5	Tube fittings – union		-----	3nos
7.6	Tube - cap		-----	2nos
7.7	Tubes		-----	11 metre(m)
8	Cables			
8a	3C X 2.5 Sq mm – Black	Thermocable	-----	300m
8b	12C X 2.5 Sq mm – Black		-----	290m
8c	24c X 1.5 Sq mm – Black		-----	550m
8d	4C X 1.5 Sq mm – Orange		-----	90m
8e	8C X 1.5 Sq mm – Black		-----	450m
8f	12C X 1.5 Sq.mm – Black		-----	70m
8g	1P X 1.5 Sq mm – Black	Thermocable	-----	90m
8h	1P X 1.5 Sq mm - Blue		-----	530m
8i	2P X 1.5 sq mm – Black		-----	70m
8j	6P X 1.5 Sq mm - Black		-----	160m
8k	6P X 1.5 sq mm – Blue		-----	62m

8l	2C X 2.5 sq mm – Orange		-----	210m
8m	24C X 1.5 sq mm – Orange		-----	390m
8n	1T X 2.5 Sq mm		-----	90m
8o	8T X 2.5 sq mm		-----	90m
9	Junction Boxes	Flexpro	Minimum 1 Nos of each type	4
10	Cable glands			
10a	¾ “ ET – Control room	Flexpro	Minimum 1 no of each type or higher	1
10b	1” ET			2
10c	1.1/4” ET			3
10d	1.1/2” ET			1
10e	½” NPT			14
10f	¾” NPT			4
10g	1” NPT			1
10h	1.1/4” NPT			2
10i	¾”ET - Radar			8

3.1.9: Failure to maintain the Instrumentation System in smooth operational condition along with carrying out the scheduled maintenance and breakdown maintenance **penalty will be imposed as per SL no. 5 of Penalty Clause no. 9.0.**

3.2 INFORMATION TECHNOLOGY:

3.2.1 CCTV system: CCTV System, sub-systems including supply of spares, consumables (if any) (Refer Schedule of Quantities, PART-II of contract).

CCTV package of Moran Tank Farm consists of the following along with interconnecting cables and accessories

- (i) High speed Explosion proof cameras(3nos. for Moran)
- (ii) Video Converter Transmitter & Receivers(One set for each camera)
- (iii) One digital video recorder(DVR) – 1 No.
- (iv) Joystick control – 1 No.
- (v) One 55inch LED Monitor – 1 No.
- (vi) Network Switch - 1 No.
- (vii) Programming PC - 1 No.

In addition, the contractor shall also obtain a Comprehensive Annual Maintenance Contract with the OEMs or shall have tie up/arrangements

with the OEMs for the CCTV systems Make Honeywell, for OEM services which shall be valid during the period of the contract and its extension if any so as to ensure trouble free maintenance as per terms of this contract.

In case the contractor's service Engineer fails to restore the systems/subsystems and OEM services are required the contractor must obtain services from OEM competent Engineers within 24 hours of reporting of such incident by operation Engineer of Moran Tank Farm. In this regard, the contractor must make arrangements with OEMs for AMC/ on-the-call-services as a part of this maintenance contract.

3.2.2: Information Technology Equipment/Field Instruments list of CCTV SYSTEMS:

Sr. No	Description	Make	Model	Quantity
1	HD-DVR(High Definition Digital Video Recorder)	Honeywel 1	HD-DVR 7016	1
2	55" LED MONITOR	Samsung	DB55D	1
3	Joystick	Honeywel 1	HD-JC- 010	1
4	Data Link Network Switch	D-Link	D-Link DES-105	1
5	CCTV Camera	Honeywel 1	NEXPTZ23 64PA	3
6	CCTV Fibre optic Cable -6 core(As per EIA/TIA 492)IEC 60793,IEC 60794, ITU-T, G.652. (Single mode multi fibre carrier armoured).-as required			1ot

The contractor shall assess the requirement and add more spares to their list as required as per maintenance plan.

3.2.3: Failure to maintain the Information Technology System in smooth operational condition along with carrying out the scheduled maintenance and breakdown maintenance **penalty will be imposed as per SL no. 8 of Penalty Clause no. 9.0.**

3.3 ELECTRICAL SYSTEMS:

3.3.1. Electricals and Illumination:

Electrical power shall be made available by OIL. Electrical power to all electric drives & area illumination for the tanks and process areas will be provided from the same source of power.

All the electrical jobs shall be carried out under direct supervision of competent and experienced Electrical Engineer. The Electrical Engineers & technicians engaged in the jobs should possess valid requisite Electrical licenses/certificates and permits

issued by State Govt. Electrical Licensing Board.

The Electrical scope of work shall be as follows:

- i) The operator's electrical works cover all that is required for maintenance of all electrical drives/ items & illumination of the proposed project including area/street lighting.
- ii) All earthing on panels, HVLRM system, High Mast must be checked and recorded regularly.
- iii) Clamping / supports / fixing to rack or hanger / straps etc for exposed cable laying must regularly be checked for looseness / excessive tightness damaging to insulations.
- iv) Earthing system needs to be maintained and measured as per Central Electricity Authority Regulations, 2010 and National Electricity Codes – 1985. The operator shall regularly measure the respective earth resistance value of all earth pits and indicate the same with date. The earth pit numbers shall be maintained in a prominent way.
- v) Inside illumination of all the sheds/ buildings shall be maintained.
- vi) Road lighting & Periphery / boundary lighting shall be maintained.
- vii) High mast lighting for entire area of the plant shall be maintained.
- viii) OIL approved Maintenance Schedule for Electrical Equipments shall be provided to contractor.

Comprehensive Annual Maintenance Contract (CAMC) shall include Routine, breakdown & schedule maintenance and repairing, servicing of all electrical equipment of Moran Tank Farm including spares and consumables, tools/tackles as required for regular maintenance as well as breakdown maintenance if any for the following systems during the entire period of the contract and its extension if any.

3.3.2 Electrical Maintenance scope of work shall include:

Carrying out preventive, predictive as well as breakdown maintenance of equipment such as Packaged AC systems, UPS system for power Backup, HVLRM remote and manual type with control panels, MOV, Fire Water Pumps, Jockey pumps, Electrical switch room with PMCC, ELDB, ACDB & MLDB panels, Transformers, Electrical earthing systems, High Mast lighting Systems, outdoor lighting, Street & peripheral lighting etc. as per indicative list of equipment enclosed, as well as per instruction of OIL's engineers from time to time. All maintenance jobs are to be carried out under the supervision of an engineer employed by the contractor for the purpose of monitoring the Tank Farm facility's maintenance. The contractor should ensure that all the maintenance jobs are carried out as per Maintenance Schedule of OEM's recommendations.

3.3.2.1. High Mast Lighting

Each mast is complete with suitable winch & steel rope, lantern carriage, aviation obstruction lights, heavy duty lightening arrestor, earthing terminals, junction box(es), feeder pillar and Luminaries. Luminaries are fitted with suitable lamp housing and control gears for 2 X 400 W HPSV lamps in total 12 (twelve) nos. of fittings. Regular maintenance to be undertaken.

3.3.2.2. HVLRM System: HVLRM system consists of motors for Left/Right movement; up/down movement; Jet/Spray.

Regular maintenance of HVLRM motors, control & power circuit cables. Maintenance of starter panels to be undertaken.

3.3.2.3 UPS Panels & Battery Banks: The system provides back-up power to control system: Regular maintenance of battery & panels to be undertaken.

3.3.2.4 Switch Room Panels: Regular maintenance of switch room panels to be undertaken.

3.3.2.5: Failure to maintain the Electrical System in smooth operational condition along with carrying out the scheduled maintenance and breakdown maintenance **penalty will be imposed as per SL no. 4 of Penalty Clause no. 9.0.**

3.3.2.6: Indicative list of Electrical Equipment for maintenance:

A. For Panel Equipment:

Location: Switch Room						
List of Electrical Component Spares						
S1 No	Component	Model	Make	Rating	Specification	Quantity
1	Soft Starter	PSTX72-600-70	ABB Ltd.	37KW	415V, Control Voltage 240V	1
2	Soft Starter	PSTX142-600-70	ABB Ltd.	75KW	415V, Control Voltage 240V	1
3	Motor Protection Relay	REM 610	ABB Ltd.			2
4	Fedder Protection Relay	REF 615	ABB Ltd.			1
5	Air Circuit Breaker	3P E00, MS Type	ABB Ltd.	800 A	MS Type	1
6	MCCB with Rotary handle add on	T4S 320 PR221D5-LS/1	ABB Ltd.	320A	415V	1
		T4S 250 PR221DS-LS/1	ABB Ltd.	250A	415V	2
		T4S 250 PR221LS/1 R160A	ABB Ltd.	160A	415V	1
		T2S160 PR221DS-1	ABB Ltd.	100A	415V	1

		T2S 160 PR221DS-1	ABB Ltd.	63A	415V	2
		T2S 160 PR221DS-1	ABB Ltd.	25A	415V	1
		T2S160FF 3P PR221- LS/1R10	ABB Ltd.	16A	415V	4
7	Potential Transformer(P T)				415/√3/110/√3 cl-1, 110VA	1
8	Control Transformer				415/240V, INSULATION CLASS B, 2KVA	1
9	Current Transformer			100/1A, 5VA	Cl 1.0	1
				150/1A, 15VA	Cl 1.0	1
				100/5A, 15VA	Cl 1.0, 5P10	1
				50/1A, 15VA	Cl 1.0	1
				30/1A 15VA	Cl 1.0	2
				150/5A, 15VA	Cl 1.0, 5P10	1
				250/1A, 15VA	Cl 1.0	2
				800/5A, 15VA	Cl 5P10	1
				300/1A, 15VA	Cl 1.0	2
				60/1A, 15VA	Cl 1.0	1
				400/1A, 15VA	Cl 1.0	1
10	MCB		ABB Ltd.	2A	TPN	2

		S202M	ABB Ltd.	6A	DP	10
			ABB Ltd.	63A	TP	3
			ABB Ltd.	32A	TP	1
			ABB Ltd.	63A	DP	2
			ABB Ltd.	10A	DP	4
			ABB Ltd.	32A	DP	2
			ABB Ltd.	16A	DP	1
			ABB Ltd.	125A	DP	1
11	Fuse			25A	415Vac	2
12	Switch Disconnecter	OT16F3	ABB Ltd.	16A	415Vac, 3phase	1
		OT400E03P	ABB Ltd.	400A	415Vac, 3phase	1
13	ELR with CBCT	EL-02	Prok Device Pvt Ltd.	30- 300mA	85-275Vac	5
14	Ammeter			0-250A		1
				0-300A		1
				0-400A		1
15	Voltmeter			0-500V		1
16	Selector Switch	4S39AP	KAYCEE	240V Ac		5
17	OLR	E16DU18.9	ABB Ltd.		415Vac	1
		E45DU45	ABB Ltd.		415Vac	1
		E80DU80	ABB Ltd.		415Vac	1
18	TP Contactor		ABB Ltd.	50A	220-240V COIL VOLTAGE 3P	3
			ABB Ltd.	16A	220-240V COIL VOLTAGE 3P	10
			ABB Ltd.	75A	220-240V COIL VOLTAGE 3P	1
			ABB Ltd.	145A	220-240V COIL	1

					VOLTAGE 3P	
			ABB Ltd.	95A	220-240V COIL VOLTAGE 3P	2
			ABB Ltd.	185A	220-240V COIL VOLTAGE 3P	2
			ABB Ltd.	260A	220-240V COIL VOLTAGE 3P	1
19	Multi Function Meter	Rish EM 3490 SS	<u>Rishabh Instrument</u> <u>s</u>			1
20	LED indicator Lamp	SPLBRL	TEKNIC	240V Ac		10 each of Red, Yellow, Green
21	Push Button Switch			415V ac		10

B. HVLRM System Spares:**Motor Spares**

Sl No	Description	Make	Ratings	Specification	Required Qty
1	Jet/ Spray movement Motor	Laxmi Hydraulic Ltd	0.18 KW, 415V±6%, 50Hz	3 Ph FLP Induction Motor, Ex-d IIA, IIB, T6, IP-65, S3 duty cycle, rpm: 1350, Frame: 71, Insulation Class F	3
2	Right Left Movement Motor	Laxmi Hydraulic Ltd	0.37KW, 415V±6%, 50Hz		3
3	Up/Down movement Motor	Laxmi Hydraulic Ltd	0.37KW, 415V±6%, 50Hz		3
4	MOV Motor	Laxmi Hydraulic Ltd	0.75KW, 415V, 50Hz	3 Ph induction motor, 415V, Duty:S2,IP: 67, Insulation class: F	3

Spares for HVLRM panel

S1 No	Component	Model	Make	Rating	Quantity
1	MCB	S202M C2	ABB	2A	5
2	OLR	SIRIUS	SIEMENS	240V, 50/60HZ	5
3	SMPS		Trio Power	240Vac/24VDdc	3
4	Switch Amplifier	KFD2 SR2-Ex.2w	<u>Pepperl+Fuchs</u>	24Vdc	3
5	Selector Switch	N2U3920	KAYCEE	16A/440Vac, 50Hz	5
6	Push Button	ZB2-BE102			5
7	LED indicator lamp, Red, Yellow, Blue, green			110Vdc	5

C.Lighting Equipments:

Sl. No.	Item	Description	QtyReqd per Year
1	HPMV Ballast	400 W HPMV Ballast, Make : Bajaj	12
2	HPSV Ballast	400W HPSV Ballast, Make : Bajaj	8
3	Metal Halide	Type : BS/MH-400, Make : Bajaj	10
4	Choke	220V, Tube light chock, 36/40W, Make : Bajaj, Copper	20
4	Starter	220V, Tube light starter, Make : Phillips	30
5	Capacitor	20 MFD	10
6	Capacitor	33 MFD + - 5%, 250V	20

D.UPS Spares**List of Spares for the UPS**

S1 No.	Item Description	Make	Rating	Quantity
---------------	-------------------------	-------------	---------------	-----------------

1	Sysytem Manager Card	HITACHI HiREL		1
2	System Control Card	HITACHI HiREL		1
3	Rectifier Control Card	HITACHI HiREL		1
4	SMPS	HITACHI HiREL		1
5	IGBT gate drive card	HITACHI HiREL		4
6	Heat Sink Cooling Fan	REXNORD/NAD/ NISIKI		1
7	Inverter IGBT	SEMIKRON/EUP EC	400A/1200 V	4
8	Thyristor Module	SEMIKRON/EUP EC		3
9	Fuse	BUSSMANN	200A	5
			250A	3
			160A	3
10	DC Filter Capacitor	EPCOS/ELECTR OCION		4
11	AC Filter Capacitor	EPCOS/ALCON/ BHC-RIPA		4
12	Metal Oxide Varistor			3

E. Lighting Spares

S1 No	Location	Model	Required Qty (Nos)	Manufacture/Type	REMARKS
Outdoor Flood Light					
1	Control Room / FWPH / Switch Room	FD1 (1 X250 w) HPMV	3	Philips SNF-14/250 Bajaj BJEf - 14CAT Crompton FAD-1314	Complete fitting with controlgear box and lamp- 3 nos. Additionally lamp-6 Nos; Ballast-4 Nos.
2	Street lighting	ST- 10 with 1 X 125w HPMV	6		HPMV Lamp- 6 Nos.

Indoor Lighting					
3	Control Room / FWPB Switch Room	IND1 (1X40W)	4	Philips-TMC501/136 Crompton -IGP13-24HSB Bajaj - BJIR-136,140	Fluorescent tube
		IND2 (2X40W)	3	Philips-TMC501/236 Crompton -IGP13-24HSB Baja-BJIR-236	Fluorescent tube
		RSD6 (2X40W)	15	Philips-HDK-225HPL250 Darklite. Crompton-CRFD24HSB Bajaj BJDL 236	Fluorescent tube
		CFL3 (2X11W)	2	Crompton TLE211 Philips FCS-518/211 Bajaj BJMS 211	CFL
		CFL4 (2X11W)	4	Crompton TLD211 Philips FBS-518/211 Bajaj BJMR 212	CFL
		HB1 (1X250W)	4	Philips HDK-225HPL250 Crompton IMB1325IH Bajaj BJHBI-250	HPMV
		LB2 (1X125W)	3		HPMV
		IND4 (2X40W)	3	Philips-TKC 203/236 Crompton -IGE1324/RSE24 Baja-BJIV-236	Fluorescent tube
		BK1 (1X100W)	1		GLS LAMP
High Mast					
4	High Mast Light	RPV302 2 X SON-T 400W	4		Complete fitting with controlgear box and lamp- 4 nos. Additionally lamp- 10Nos;

					Ballast-4 Nos., Ignitor- 10 nos.
Power Plug/Switch Socket					
5	Control Room / FWPH / Switch Room	5A,240V, RECEPTACLE	12		
		5A,240V, PIANO TYPE	20		
		5A/15A, 240V, RECEPTACLE WITH SWITCH	12		
MCB					
6	Control Room / FWPH / Switch Room	40A MCB TP	5	Legrand DX3	
		10A MCB DP	10	Legrand DX4	
		20A MCB DP	10	Legrand DX5	

F. Spares for High Mast Panel.

Sl. No.	Item	Make	Model No.	Ratings	Quantity
1.	TP Contactor	L&T	MNX45	85A	2
		Havels		63A	2
2	DP Contactor	L&T	MNXA2	4A	4
3.	Fuse	Bussmann	FA	32A, 3W	14
			HF 14X	16A, 3pole	6
4.	Timer	GIC			2
5.	3P MCB			6A,	4
6.	Selector Switch	Recom		10A/16A	2

3.3.2.7. Day to Day Electrical Maintenance Spares:

Sl. No.	Item	Description	Estimated quantity required per Year per Installation
---------	------	-------------	---

1	HPMV Ballast	400 W HPMV Ballast, Make : Bajaj	12
2	HPSV Ballast	400W HPSV Ballast, Make : Bajaj	8
3	Metal Halide	Type : BS/MH-400, Make : Bajaj	10
4	Choke	215V, Tube light chock, 36/40W, Make : Bajaj, Copper	20
4	Starter	215V, Tube light starter, Make : Phillips	30
5	Capacitor	20 MFD	10
6	Capacitor	33 MFD + - 5%, 250V	20
	LED Lights	LED T/L Fittings	15
		Driver for the LED T/L	20
6	Fuse	HRC, SS type – 4A, 6A, 10A	12
		HRC, E.I.T. Type - 32	10
		HBC Fuse link-125A, Type : TSDS, Make : GE	8
		HBC, 200A, Type : TSF 200, GE	4
7	Bulb	400W, HPSV, Bajaj(HM), Type : BJR	12
		400W, HPSV, Bajaj (Threaded)	8
		400W, HPSV, 220V Bajaj (Threaded), SON-T	8
		20W Fluorescent Lamp, Phillips	20
		400W HPMV Lamp	6
		40W Fluorescent Lamp, Phillips	12
8	Panel Indicator Lamp	Red, Yellow, Blue: LED Type	12
9	MCB	DP-6A, 10A,16A, 25A& 32A, Make : Havells	6
		SP- 32A, Make : Havells	6
10	Clean agents	CRC 2-26/ Equivalent	4

3.3.3 TENTATIVE ROUTINE MAINTENANCE SCHEDULE OF ELECTRICAL EQUIPMENT (EQUIPMENT WISE)

SL. NO.	TYPE OF MAINTENANCE	NATURE OF MAINTENANCE/ INSPECTION	PERIOD						RECORD / DOCUMENT IN	REMARKS
			EVERY SHIFT	DAILY	F/NIGHTLY	MONTHLY	YEARLY	OTHERS		
3	LT AC PANEL PMCC/MLDB/EPDB/High mast panel									
Routine		Operation of emergency lights	✓						Shift log book	
		Overheating of Panels (From outside)	✓						Daily work progress register	
		Cleaning of panels (Outside, including floor mats)		✓					Daily work progress register	
		Check for external damages				✓	✓		Equipment maintenance register	
		Check for effectiveness of ventilation system				✓	✓		Equipment maintenance register	
		Check for corrosion effect (external and internal)				✓	✓		Equipment maintenance register	
Preventive		Testing of RCDs				✓			Equipment maintenance register	
		Cleaning panels (interior)				✓	✓		Shift log book	
		Checking of panels				✓	✓		Shift log book	
		Tightening of all connections including TBs				✓	✓		Shift log book	
		Check cable TBs				✓	✓		Equipment maintenance register	
		Check for overall cleanliness				✓	✓	✓	Equipment maintenance register	As required
		Check breaker handle ok or not				✓		✓	Equipment maintenance register	As required
		Check for accessibility of maintenance/operation				✓			Commissioning report	
		Major overhauling				✓	✓		Equipment maintenance register	
								✓	Equipment maintenance register	

SL NO.	TYPE OF MAINTENANCE	NATURE OF MAINTENANCE/ INSPECTION	PERIOD						RECORD / DOCUMENT IN	REMARKS			
			EVERY SHIFT	DAILY	F/NIIGHTLY	MONTHLY	YEARLY	OTHERS					
4	AIR CONDITIONERS:												
	Routine	Checking for proper operation	✓							Shift log book			
5	EARTHING:												
	Routine	Checking of connections			✓				✓	Equipment maintenance register	• or as required		
		Measurement of earth resistance							✓	Commissioning Report			
6	CABLES: CABLES/CABLE DUCT/TRENCH/SUPPORT												
	Routine	Check for cleanliness							✓	Six monthly*	Equipment maintenance register	• or as required	
		Check for sealing cable trenches/ducts (prevention of foreign materials, vermin, water, chemicals, dirt, reptiles, into trenches/ducts)								✓	Six monthly*	Equipment maintenance register	• or as required
		Checking of IR Value									As required	Equipment maintenance register	
	Preventive	Checking of overheating							✓		Equipment maintenance register		
		Check for damages to cables, conduits, wires, clamps, cable supports; Check for corrosive effects on conduits & junction box							✓		Equipment maintenance register		
7	LIGHT FITTINGS (Including high mast systems)												
	Routine	Checking and cleaning	✓				✓			Six monthly*	Daily work progress register	• operation of lantern carriage of high mast	
		Replacement of bulb, ignitor, ballast etc.								As reqd.	Shift log book		
8	UPS AND BATTERY												
	Routine	Cleaning of cabinet					✓			✓	Equipment maintenance register		
	Preventive	Checking of Battery bank voltage			✓		✓				Equipment maintenance register		

3.4 MECHANICAL SYSTEMS:

3.4.1 Comprehensive Annual Maintenance Contract (CAMC) shall include Routine, preventive/schedule/breakdown maintenance and repairing, servicing of all mechanical equipment of Moran Tank Farm including spares and consumables, tools/tackles as required for regular maintenance as well as breakdown maintenance if any for the following systems during the entire period of the contract and its extension if any.

3.4.2 Mechanical Maintenance scope of work shall include:

Carrying out preventive, predictive as well as breakdown maintenance of equipment such as Diesel Engines, Centrifugal Fire water/Jokey pumps, rotary gear type foam pumps, Submersible water pumps, Air Compressor units, Air drier units, HOT cranes, Static vessels, all Valves in the network etc as per indicative list of equipment enclosed, as well as per instruction of OIL,s

engineers from time to time. All maintenance jobs are to be carried out under the supervision of an engineer employed by the contractor for the purpose of monitoring the Tank Farm facility's maintenance. The contractor should ensure that all the maintenance jobs are carried out as per Maintenance Schedule of OEM's recommendations.

3.4.3 Indicative list of Major Mechanical Equipment for maintenance:

SL. NO	SYSTEM	EQUIPMENT	Qty	MAKE	CAPACITY
1	FIRE WATER SYSTEM	Jockey Pumps	2 nos	Mather & Platt Pumps Ltd. (Wilo), Centrifugal	120 M3/HR (each)
2		Fire Water pump	6 nos	Mather & Platt Pumps Ltd. (Wilo), 8/10DME, Centrifugal	616 M3/Hr(each)
		Make-up Water pump	2 nos		50 M3/Hr(each)
3		FW Diesel Engines	6 nos	Greaves Cotton Ltd, Model: TBD3V8 II	295 KW, 1500 RPM
4		Foam Diesel Engine	1 no	Kirlosker Oil Engines Ltd, Model: HA 494	1500 RPM
5		Fire water tank	2 nos	Fabtech	4050 M3(each)
6		Fuel tank	6 nos	Fabtech	990 ltr.(each)
7	FOAM SYSTEM	Foam Pump (Motor driven)	1 nos	Del Pd Pumps & Gears Pvt Ltd	Pressure 12kg/cm ² , Rated capacity 18m ³ /hr
8		Foam Pump Diesel Engine driven)	1 no	Del Pd Pumps & Gears Pvt Ltd	Pressure 12kg/cm ² , Rated capacity 18m ³ /hr
9		Foam tank	1 nos		17700 ltr
10	HOT crane	Overhead crane	1 no.	Brady & Morris Engg.Co.Ltd	5 tonnes
11	AIR COMPRESSOR SYSTEM	Screw Type Air Compressor	2 nos	Kirloskar Pneumatic Pvt. Ltd. Model: KES 18-10 C	Discharge =3.06 m ³ /min Max. working pressure= 10 bar

12		Air dryer	1 no	Summit Hygronics	140nm3/hrW. Pressure 8.5Kgf/cm2
13		Plant Air receiver	1 no	Fabtech Projects & Engineers Ltd.	5.5 to 7 kg/cm ²
14		Instrument Air receiver	1 no	Fabtech Projects & Engineers Ltd.	5.5 to 7 kg/cm ²

3.4.4 General CHECK LIST FOR MECHANICAL MAINTENANCE PERSONNEL:**EQUIPMENT: Diesel Engine (Fire water & Foam)****FREQUENCY: As per OEM recommendations and****Daily:****ACTIVITY:**

- 1.0 Check the operator's daily reports
- 2.0 Investigate and correct reported cases of
 - Low engine oil pressure
 - Low power
 - Abnormal water or oil temperature
 - Excessive smoke
 - Misfiring
 - Unusual engine noise / vibration
 - Excessive consumption of engine oil
 - Contamination of engine oil
 - Leakage of coolant, fuel, water, engine oil or air
 - Coupling wear / damage
 - Loose foundation bolting
 - Dirty / clogged air cleaner element
 - Adjust Clutch
 - Any other reportable condition

Every 500 hours

1. Repeat daily checks
2. Check and adjust belt tension - replace belts if necessary
3. Check engine coolant and corrosion resistor / de-scaling additives, replace if necessary.
4. Clean air filter elements and filter housing with compressed air
5. Check all wires for frayed / damaged insulation - replace if necessary
6. Check all connections to ensure that they are proper
7. Check all gauges for proper operation- replace defective gauges
8. Check throttles linkages for looseness of lock nuts / bolts.
9. Lubricate actuator control linkage rod and bearings
10. Clean crankcase breather
11. Check clutch & adjust if required
12. Externally clean engine and surroundings with water & detergent

Every 1000 hours

1. Repeat daily and 500 hr checks
2. Drain engine oil, clean crankcase and refill fresh engine oil
3. Replace hydraulic governor oil
4. Replace oil filter elements after cleaning the filter housing
5. Replace belts if necessary
6. Clean / replace air filter elements
7. Check and adjust valve tappet clearances
8. Grease bearings
9. Check / adjust ignition timing
10. Service air starter
11. Replace spark plugs
12. Check ignition transformers - replace if necessary
13. Check functioning of safety system & safety devices
14. Check and tighten all foundation bolting
15. Check clutch & adjust if required

EQUIPMENT : Fire Water, Jockey & Foam Pumps

FREQUENCY : As per OEM recommendations

EQUIPMENT : Air Compressor

FREQUENCY : As per OEM recommendations and

Daily**ACTIVITY:**

- Check the operator's daily records
- Investigate and correct reported cases of
- Abnormal noise or vibration of compressor
- Abnormal noise or vibration of the prime mover (motor / engine)
- Low discharge air pressure
- Leakage of air in air lines, valves and intercooler
- Malfunction of un-loader assembly
- Reports related to the engine's starting system, fuel system etc.
- Any other occurrence needing attention of maintenance personnel.

250 hours or 6 months (whichever is earlier)

- Repeat daily checks
- Replace air cleaner element
- Check un-loader for proper functioning
- Check proper tightness of all bolting
- Check tension / wear of v-belts - replace if necessary
- Carry out preventive maintenance (Periodic Inspection) of prime mover

EQUIPMENT : HOT Crane

FREQUENCY : As per OEM recommendations and statutory safety guidelines for load testing, calibration & certification from the appropriate/authorized certification agency

- 3.4.5** Supply, provisioning of spares, consumables and execution of all types of maintenance jobs shall be entirely under the scope of the contractor (Refer Schedule of Quantities, PART-II of contract).
- 3.4.6** Contractor shall be provided with schedules of all scheduled maintenances of units / facilities / equipment stated above. The Contractor can put forward additional / modified list of maintenance schedules of the above based on OEM recommendations or other technical justifications etc. Such additional / modified list of maintenance schedules shall be reviewed by OIL and incorporated if found justified.
- 3.4.7** Contractor cannot and shall not claim the maintenance-schedules given by OIL to be improper at a later time. Likewise the Contractor cannot attribute any fault (malfunction / breakdown / under- performance etc) of any unit that may take place at a later time on the ground of OIL's improper maintenance-schedules.
- 3.4.8** Contractor shall be responsible for supplying, provisioning and inventorying of all replacements and/or capital nature units / parts / components etc. Replacements of these categories of items shall come under major repair and do not come under regular day-to-day routine maintenances (as per attached check lists / log sheets / maintenance schedule etc).
- 3.4.9** The Contractor shall have to take certification from OIL on the quality of items purchased by them prior to use / inventorisation as and when advised by OIL for the same.
- 3.4.10** The spares, consumables & replacements which are required for regular day to day processes, for safe, trouble-free & uninterrupted plant operations, regular &/or day-to-day routine maintenance-jobs (as per attached check lists / log sheets / maintenance schedule etc) and running repair-jobs are completely under the scope of the contractor.

The shortage or lack of the above items may lead to malfunction, underperformance & breakdown of any unit / facility / equipment of the plant which in turn may affect / hamper the safe, trouble-free & uninterrupted operation of the plant. (eg. bearing, seals, gland packing and various regular spares of Jockey pumps, fire fighting water & foam pumps, engines, Air compressors, submersible water pumps etc)

To eliminate any likelihood of such a situation, the following points are necessary:

- a. The contractor shall make themselves ready with a comprehensive list of spares & consumables falling under the scope of contractor. Contractor shall compile the initial list from description of equipment / facilities in this document and from routine maintenance check lists / log sheets etc. Contractor can also visit the Tank Farm for having better insight before taking over of Maintenance services of Moran Tank Farm.

- b. A Indicative list of **some such items is given below** for facilitating the contractor in creating an initial inventory,
- c. Looking at the usage of spares, OIL and/or the contractor - after consultation & consent from OIL - may include any additional spares, consumables & replacement-items under the scope the contractor at any point in time during the currency of the contract.
- d. The inventory of such items shall be with contractor & IM of the installations. OIL will check the items to be replaced prior to its replacement on normal working hours &/or take-over the replaced item at an earliest working time after the replacement. The contractor shall keep daily record of consumption & stock position and report the same to OIL on a daily basis &/or as & when sought by OIL. OIL may however keep some of the critical spares &/or replacement-items under the custody of OIL.
- e. The operator must analyse the necessity and maintain enough stock of each item in the inventory in their base office/or feasible location of contractor. Projection of replenishment-requirement of these spares & consumables and initiation of procurement process shall be the responsibility of the contractor.

Shortage / lack of any such item(s) shall be on contractor's account; penalty on contractor shall be imposed as per **Penalty Clause 9.0 against SL No. 9.**

3.4.11 On some special circumstances / emergency situations for the purpose of trouble free, uninterrupted, safe and sound-industry-standard of plant operation, OIL may advice the contractor to procure any of the items which are not included in the indicative list of items provided.

3.4.12 On some occasions, OIL may ask the contractor for providing quotations from OEMs/ their franchisees / concerned vendors or any new vendors for items coming under their scope of supply. Contractor shall provide such quotation(s) or respond otherwise in writing within 7 days from OIL's written request for the same.

3.4.13 The contractor cannot and shall not decline to carry out the procurement process on behalf and on advice of OIL. Should the contractor fail to carry out the jobs under this clause and/or should there be any shortage / lack of spares, consumables and replacements etc falling under the scope of the contractor to do the purchasing process and should there be any consequences thereof like shutdown / malfunctioning / underperforming of Moran Tank Farm, **Penalty as per Sl No. 3 of Penalty Clause no. 9.0** shall be imposed on contractor.

3.4.14 Apart from the above, the spares required for all mechanical items which are not covered in the indicative list of equipment and spares like piping repair, valves, flanges, bolts, nuts, washers and other pipe fittings, gaskets for smooth operation of the installation are also under the scope of the contractor.

3.4.15 OIL shall supply the POL items viz engine oil, gear oil, coolants and HSD for normal day to day routine maintenance jobs. Contractor shall have to

provide all the other consumables for routine/scheduled maintenance jobs carried out at Daily/Weekly/monthly/as per OEM recommendation intervals. Also consumables for battery maintenances like distilled water, petroleum jelly, sand papers etc shall have to be provided by the contractor.

HSD is primarily required for running Fire Fighting engines during mock drills / exercises / testing etc. and the same is not in the scope of the contractor.

3.4.16 The contractor shall bear the cost on consumables required while carrying out day-to-day Maintenance jobs which includes but not limited to materials like nuts & bolts of different sizes / gasket /asbestos ropes/ jute/grease/bearing-lubricants/fasteners etc.

Shortage / lack of any item(s) as stated above shall be on contractor's account; penalty on operator shall be imposed as per **Penalty Clause 9.0 against SL No. 9.**

3.4.17 MINIMUM INDICATIVE LIST OF SPARES TO BE MAINTAINED BY THE CONTRACTOR AT MORAN TANK FARM:

(a) Centrifugal FW Pumps:

PUMP MODEL : 8 / 10 DME					
SERIAL NO 81240173 / 550 / 1-6, 81240173 / 590 / 1-5, 81240173 / 630 / 1-6					
Sl No	Description	M.O.C	Qty	UOM	Remarks
1	O RING FOR CASING, P.N. 4250	EPDM	2	NOS	
2	SHAFT WITH KEYS, P.N. 1800, 3200, 3250	SS 410	1	NOS	
3	SHAFT SLEEVE, P.N. 2100	SS 410	2	NOS	
4	SLLEVE NUT (R.H.) P.N. 3032	SS 410	2	NOS	
5	SLLEVE NUT (L.H.) P.N. 3031	SS 410	2	NOS	
6	WATER THROWER, P.N. 2070	EPDM	2	NOS	
7	BEARING, P.N. 2600	SKF/FAG	2	NOS	
8	IMPELLER, P.N. 1500	CFB	1	NOS	
9	NECK RING, P.N. 1181	CFBM	2	NOS	
10	LOGGING RING, P.N. 2300	GFN	2	NOS	
11	GLAND, P.N. 2310	CI	2	NOS	

12	STUFFING BOX BUSH, P.N. 2402	CI	2	NOS	
13	GLAND PACKING, P.N. 2410	G.C. COTTON	1	SET	
14	LOCK NUT, P.N. 3010	STEEL	1	NO	
15	LOCK WASHER, P.N. 3020	STEEL	1	NO	
16	THRUST COLLAR, P.N. 2884	EN8	1	NO	

PUMP MODEL : 8 / 8 DME – TA					
SERIAL NO 81240173 / 700 / 1-4					
Sl No	Description	M.O.C	Qty	UOM	Remarks
1	O RING FOR CASING, P.N. 4250	EPDM	2	NOS	
2	SHAFT WITH KEYS, P.N. 1800, 3200, 3250	SS 410	1	NOS	
3	SHAFT SLEEVE, P.N. 2100	SS 410	2	NOS	
4	SLLEVE NUT (R.H.) P.N. 3032	SS 410	2	NOS	
5	SLLEVE NUT (L.H.) P.N. 3031	SS 410	2	NOS	
6	WATER THROWER, P.N. 2070	EPDM	2	NOS	
7	BEARING, P.N. 2600	SKF/FAG	2	NOS	
8	IMPELLER, P.N. 1500	CFB	1	NOS	
9	NECK RING, P.N. 1181	CFBM	2	NOS	
10	LOGGING RING, P.N. 2300	GFN	2	NOS	
11	GLAND, P.N. 2310	CI	2	NOS	
12	STUFFING BOX BUSH, P.N. 2402	CI	2	NOS	
13	GLAND PACKING, P.N. 2410	G.C. COTTON	1	SET	

14	LOCK NUT, P.N. 3010	STEEL	1	NO	
15	LOCK WASHER, P.N. 3020	STEEL	1	NO	
16	THRUST COLLAR, P.N. 2884	EN8	1	NO	

PUMP MODEL : ET – ISO 17H					
SERIAL NO 81240173 / 950 / 1 – 2, 81240173 / 1000 / 1 – 2, 81240173 / 1050 / 1 – 2					
Sl No	Description	M.O.C	Qty	UOM	Remarks
1	O RING FOR CASING, P.N. 775 – 1	NITRILE RUBBER	1	NOS	
2	O RING FOR SLEEVE, P.N. 775	NITRILE RUBBER	1	NOS	
3	WATER DEFLECTOR, P.N. 729	EN8	2	NOS	
4	LIP SEAL, P.N. 584	RUBBER	2	NOS	
5	GLAND, P.N. 026	C.I.	1	NOS	
6	LOGGING RING, P.N. 044	GFN	1	NOS	
7	GLAND PACKING, P.N. 057	G.R. COTTON	1	SET	
8	BEARING(IMP END), P.N. 464 – 1	SKF/FAG	1	NOS	
9	BEARING(IMP END), P.N. 464	SKF/FAG	1	NOS	
10	EXTERNAL CIRCLIP[, P.N. 454	STEEL	1	NOS	
11	IMPELLER NUT, P.N. 442	CF8	1	NOS	
12	SPACER SLEEVE, P.N. 287	SS 316	1	NOS	
13	SHAFT SLEEVE, P.N. 286	SS 410	1	NOS	
14	KEY IMPELLER, P.N. 084	SS 410	1	NOS	

15	KEY COUPLING, P.N. 054	SS 410	1	NOS	
16	SHAFT, P.N. 049	SS 410	1	NOS	
17	NECK RING, P.N. 032	CF8M	1	NOS	
18	IMPELLER, P.N. 031	CF8	1	NOS	

(b) Fire Water Engine Spares:

SI No	PART NO	DESCRIPTION	QTY	UOM	Remarks
1	605411880009	Lub oil filter v6/v8	4	NOS	
2	1200240911/12	Filter element (micro + prime)	2	SET	
3	106900000014/15	Air filter (inner + outer)	1	SET	
4	123200198518	Coolant additive 5 ltr pack	1	NO	
5		Injector	10	NO	
6		Gasket set kit	2	SET	
7		Washer set kit	2	SET	
8		"V" Belts set kit	2	SET	
9		Adaptors with 'O' ring & gaskets	2	SET	
10		Exhaust flexible spool	2	NO	
11		Pressure Gauge	2	NO	

(c) Foam Engine Spares:

SI No	PART NO	DESCRIPTION	QTY	UOM	Remarks
1		Lube Oil Filter	2	NO	
2		Fuel Filter	2	NO	
3		Injector	10	NO	
4		Injector line, excess line, support clamp, gasket etc.	6	SET	

5		Pressure gauge line(lube oil)	2	NO	
6		Pressure gauge benzo bolts & washers	4	SET	
7		Blower fan	2		
8		Air filter/cleaner assembly	2	SET	
9		Exhaust flexible spool	2	NO	
10		Exhaust gasket & 'O' rings	2	SET	
11		Tappet cover gasket	2	SET	
12		Gasket kit	2	SET	
13		'V' Belts	4	SET	

(d) Air Compressor:

Sl No	PART NO	DESCRIPTION	QTY	UOM	Remarks
1	271.01.432.50	Oil Filter Element	2	NO	
2	273.03.772.50	Air Filter Element	2	NO	
3	273.01.868.50	Air-Oil separator element with gaskets	1	NO	
4	273.01.044.50	Gasket for Air intake valve	1	NO	
5	273.50.109.50	Gasket for Air end delivery1	1	NO	
6	273.01.491.50	'O' ring ID 56 x 3.55 DIA	3	NO	
7	271.00.532.50	'O' ring 1/4"	1	NO	
8	271.00.534.50	'O' ring 3/8"	7	NO	
9	271.00.536.50	'O' ring 1/2"	3	NO	
10	271.00.538.50	'O' ring 3/4"	3	NO	

11	271.00.540.5 0	‘O’ ring 1”	4	NO	
12	271.00.544.5 0	‘O’ ring 1-1/2”	2	NO	
13	273.01.904.5 0	Service Kit for MPVL-40	1	NO	
14	271.00.283.5 0	Service Kit for BDV 3/8” BSP	1	NO	
15	273.01.453.5 0	Service Kit for intake valve – 4”	1	NO	

(e) Air Dryer:

Sl No	PART NO	DESCRIPTION	QTY	UOM	Remarks
1		Main Valve Spare Kit	2	NO	
2		Exhaust Valve Kit	1	NO	
3		Solenoid Valve	3	NO	
4		Pre-Filter Element	1	NO	
5		After- Filter Element	1	NO	
6		Activated Alumina	1	Pack	

(f) Rotary gear type Foam Pumps:

Sl No	PART NO	DESCRIPTION	QTY	UOM	Remarks
1		DE and NDE bearing	2	NO	
2		Set of wear plates	2	SET	
3		V seal	2	NO	
4		Oil seal / Z pack	2	NO	
5		Paper packing	2	NO	
6		R.V.Spring	2	NO	
7		Coupling Spider	1	NO	

8		Rotor Stator Assembly	1	NO	
9		Relief Valve piston	1	NO	

3.4.18 Execution of Day-to-day Routine/Preventive / Break-down and Schedule maintenance and Corresponding penalties against non-execution of the maintenance jobs

The Contractor shall do all types of maintenance jobs on any type of equipment / instrument / machine / unit / facility of the plant irrespective of scope of provisioning of the spares, consumables and other materials required thereon.

- i) After initial communication and subsequent acknowledgement of the contractor in regards to maintenance, in case of malfunctioning or under-performing or breakdown of any units of the plant that takes place at any time during the currency of this maintenance contract, the contractor needs to immediately report to OIL.

In case the contractor's claims any fault as above to happen at a time just prior to OIL's inspection of the plant on that day, OIL shall investigate the performance history of the unit and all related reports / records / documents as already furnished till that day by the contractor. No new reports etc shall be acceptable to OIL on that day. Contractor's claim as above shall be judged as per findings based on already submitted reports etc by contractor. Penalty shall be imposed on operator if fault is found to start earlier as per **penalty clause no. 9.0.**

- ii) All day-to-day routine maintenance / servicing jobs and schedule / preventive maintenance jobs shall be carried out regularly by the contractor at their cost. The contractor shall carry out all routine maintenance / servicing jobs and schedule / preventive maintenance jobs of the plant in the most regular, meticulous and diligent ways.
- iii) The contractor must be able to identify any problems, wear & tear in parts / components etc of units / equipment etc which if not replaced immediately is likely to cause trouble in the functioning. The contractor shall have to promptly replace such items and follow the clause in regards to items used / replaced. The contractor must eventually be able to avoid breakdown or malfunctioning of any equipment, facilities, and units of plant.
- iv) OIL may decide to go for additional maintenance jobs on any of the units / equipment / facility of the Tank Farms over & above the scheduled ones. The contractor shall have to carry out the same and necessary spare for which shall be supplied by OIL from its inventory.
For all routine maintenances / servicing jobs, schedule / preventive maintenance jobs and also for breakdown maintenances / major repairs etc the contractor shall have to carry out all required workshop jobs like but not

limited to jobs of various machining operations, milling, drilling, boring, reaming, grinding, lapping, press-fitting, shrink-fit assembly, expanded fit assembly, dismantling, assembling-disassembling etc. Further the operator shall have to be equipped with all required tools & tackles and other equipment. These include but not limited to items like wrenches, tongs, hammers, chisel, dies, all tools (non sparking) necessary for attending routine and breakdown maintenance of electrics, instrumentation and control system; temperature guns for machine-temperatures; hydraulic pullers of sufficient ratings, tripods & chain pulleys of required ratings, maintenance tool boxes, tool kit-sets, tube expander etc for all maintenance jobs.

- v) All routine maintenance / servicing jobs and schedule / preventive maintenance jobs shall have to be properly documented / recorded and reported to OIL on real time basis. Absence of records & reporting to OIL, contractor's claim on doing the jobs will not hold good. Reports submitted at a later date shall not be accepted.
- vi) The maintenance history of equipments/units shall have to be maintained for each of the equipment/unit by the contractor and such maintenance history/records should be signed by the contractor and submitted to the IM of Tank Farm for future reference.
- vii) Should the contractor fail to start any jobs as above in professional manner and with full man-power strength due to any reasons including but not limited to the reason of shortage / lack of spares, consumables and replacements falling under the scope of the contractor to do the purchasing process, the contractor shall be fully responsible and accountable. Penalty will be imposed on the operator as per **Penalty Clause numbers-9.0** as the case may be.
- viii) Any one or more of these **penalties listed in clause no. 09** shall be applicable which may lead to malfunctioning, underperforming or shutdown / breakdown of any unit, equipment, facility of the Tank Farm.
- ix) The contractor's performance or the lack of it in doing routine & schedule maintenance jobs shall be determined from reports / records / documents etc regarding all servicing & maintenance jobs and regarding all used spare parts & consumables used on a particular unit or equipment.
- x) In case of breakdown or malfunctioning or under-performing of any equipment, the contractor needs to immediately report the same to OIL.
- xi) Simultaneously, the contractor must immediately start break-down maintenance jobs for restoring the unit at their cost and/or must replace any such break-down unit(s) within the shortest time avoiding interruption or under-performance of the plant.
- xii) Breakdown maintenance job as above shall be done with professional workmanship and continuously in all the shifts in all days without gap with skilled and adequate man-power strength. For that, the contractor shall arrange its maintenance gang. Presence of Key personnel during the maintenance job will be required.

Man power of operator should be competent & sufficient for carrying out such jobs as **per clause no. 6.0**.

- xiii) Requirement of OEM or their authorized dealers for Annual Maintenance Contracts (AMCs) / Warranties of their respective equipment shall be an issue of the contractor of their own. In case, the contractor decides for bringing OEM or their authorized dealers for any job at Tank Farms the same needs to be endorsed by OIL on immediate basis. The responsibility for the maintenance service shall entirely rest with the contractor in case of any failure to do so. Failure of the same shall not be acceptable. OIL's endorsement will only be for allowing the contractor to employ the OEMs / authorized dealer on their behalf.

Contrarily, if the contractor decides to send any equipment / unit etc to OEM's workshop for maintenance, same needs to be endorsed by OIL. In such cases standby arrangement shall have to be provided by the contractor without extra charge.

Contractors failure to return the unit/equipment to OIL after such repair/rectification within 20 days shall attract **Penalty as per clause no. 9.0**. Such rectified unit/equipment shall have to be presented by the contractor to OIL for inspection before placement of the same.

- xiv) If OIL finds the contractor's delay in starting required maintenance job detrimental to the plant or its operation, OIL shall carry out the job on its own but the financial implications in regards to cost of OIL's repair-activities will be recovered from monthly bills/Performance Bank Guarantee. This is deemed as **per Penalty Clause number-9.0**. OIL shall intimate the contractor prior to start of the jobs.

3.4.19 Services of OEM:

The contractor is under the binding to inspect all the equipment/units by the representative of OEM not less than Service Manager or authorized Engineer twice in a year under normal circumstances. Certificates of Inspection shall have to be deposited to OIL after completion of each inspection immediately.

In case of any major breakdown where the contractor's crew are unable to rectify the defects within 48 hours of occurrence of such breakdown, the contractor is liable to provide the services of OEM to repair/rectify such defects.

Should the contractor feels the requirement of OEM's services it may do so at any point of time during the tenure of the contract. No additional charges for availing the above services/certification etc. shall be paid by the OIL to the contractor/OEM/authorized dealer.

Any issues related to OEM/authorized dealer with the contractor shall not be the responsibility of OIL.

Failure to comply the above requirements as stated shall attract **Penalty as per clause no. 9.0**

3.5 FIRE& SAFETY SYSTEMS:

3.5.1 HVLRM (High Volume Long Range Monitor)

OIL has introduced Manual as well as Remote Controlled High Volume Long Range Monitor (RCHVLRM) in crude oil Tank Farms for compliance of MB Lal Committee's recommendations as well as revised OISD-117-2012. The following two types of Portable / fixed type High Volume Long Range Monitors are used in Oil India Ltd.

Manual Operated HVLRM

The monitors are equipped with non-aspirating type nozzles designed to throw high volume of water or foam as per the requirement. These monitors are erected on a structural platform at a desired height at strategic places where there is a potential hazard of fire.

The Manual High Volume Long Range Monitors are available in capacities of 1000 US GPM (3800 LPM). The monitors have excellent horizontal and vertical throw making them effective against fires of any kind. HVLRM are ideally suited for fighting fires of storage tanks, columns, process towers, well fire etc. effectively & safely. The monitor can be rotated 340° horizontally and 120° vertically. The monitor produces various discharge patterns from jet, spray to semi-fog and fog. The conversion from a jet pattern to fog pattern takes place in less than 30 seconds and the fog curtain is as wide as 160°.

Remote Operated HVLRM

These Remote Controlled High Volume Long Range Monitors operate electrically & can be controlled from a safe distance by using a simple operating console. A Fire Fighter can be stationed in a control cabin that can be located away from the monitor. An Installation Personnel life is risk free, even while fighting a very large magnitude of fire. The monitors are equipped with non-aspirating type nozzles designed to throw water or foam as per the requirement from a safe distance of 200–300 meters.

The Remote Controlled Monitors (RCM) are installed in capacities ranging of 1000 US GPM (3800 LPM). The monitors have excellent horizontal and vertical throw making them effective against fires of any kind. HVLRM are ideally suited for fighting fires of storage tanks, process area, well fire etc. effectively & safely. The monitor can be rotated 340° horizontally and +90° & -15° vertically. The monitor produces various discharge patterns from jet, spray to semi-fog and fog. The conversion from a jet pattern to fog pattern takes place in less than 30 seconds and the fog curtain is as wide as 140°.

The foam is inducted to through the balanced foam proportioners the central foam system at the installation.

The Manual & Remote Controlled Monitors have integrated safety through self-arresting gearing units that lock the monitor in all rotational movements thus preventing any chance of uncontrolled movements. Also to meet the safety standards the monitors have a provision to be manually operated in case of an electric failure.

MEFG (Medium Expansion Foam Generator)

Medium Expansion Foam Generator having minimum foam expansion ratio of 1:40 is fitted with 75 mm dia. inlet flange (ANSI B 150 lbs rating). The flow rate MEFG is 600 LPM capacity .Glycerine filled S.S. Pressure Gauge (1-10kg/cm²) is fitted near the inlet flange. Foam Generator is able to produce foam at minimum 3.5 Kg/Cm² to 5Kg/Cm² pressure. Complete foam generator with inlet flange is made of stainless steel (SS-316). The barrel of MEFG is suitably designed to handle 5 Kg/cm² pressure. The barrel is Shield Metal Arc Welded SS-316 compatible electrodes. Minimum Stream Range of foam generator is 3 meters .All stainless steel metal parts of the foam generator are painted with two coats of polyurethane paints in yellow color.

3.5.2 Fire Fighting Equipment in Tank Farm:

Tank	Rim	HVLM	MEF	Emergency	Fire	Fire Water	Foam
------	-----	------	-----	-----------	------	------------	------

Farm	Seal		G	Escape Set	Proximity Suit	Header Size	Header Size
Moran	4	Manual – 10	10	2	1	16 inch	4 inch

Tank Farm	Rim Seal	Fire Water Pumps	Jockey Pump	Foam Pump	Fire Water Tank	Foam (ltrs)
Moran	4	616 m3/hr (6 nos)	120 m3/hr (2 nos)	18 m3/hr	4050 m3 (2 nos)	19470

3.5.3 Spare Parts:**(a) Spare Part list for HVLRM**

Sl. No.	Spare Part	Vendor	MOC	Quantity Moran
1.	Nozzle	M/s NK Fire Safety	SS-316	2
2.	Swivel Joints	M/s NK Fire Safety	SS-316	2
3.	Worm	M/s NK Fire Safety	SS-316	2
4.	Gear	M/s NK Fire Safety	SS-316	2
5.	Spindle for worm	M/s NK Fire Safety	SS-316	2
6.	Hand-wheels for Nozzle, horizontal/vertical movement	M/s NK Fire Safety	SS-316	10
7.	Drain connection	M/s NK Fire Safety	SS-316	4
8.	Drain valve	M/s NK Fire Safety	SS-316	4
9.	Nuts/bolts at Monitor	M/s NK Fire Safety	SS-316	20
10.	Mounting Brackets for Motors/Limit switches	M/s NK Fire Safety	SS-316	4
11.	Deflector Set	M/s NK Fire Safety		4
12.	Pressure gauge	M/s NK Fire Safety	SS-316	4

13.	Push Button	M/s NK Fire Safety		0
14.	Limit Switch	M/s NK Fire Safety		0
15.	Proxy Sensor	M/s NK Fire Safety		0

(b) Spare Part list for MEFG

Sl. No.	Spare Part	Vendor	MOC	Quantity
1.	Glycerine filled S.S. Pressure Gauge(1-10kg/cm2)	M/s NK Fire Safety		2
2.	Flexible tube connected to inline inductor	M/s NK Fire Safety		10

(c)Spare Part list of Hydrant

Sl. No.	Spare Part	Vendor	MOC	Quantity Moran
1.	Lugs	M/s NK Fire Safety		20
2.	Blank Cap with chain	M/s NK Fire Safety		10
3.	Washer	M/s NK Fire Safety		30
4.	Hydrant Wheel	M/s NK Fire Safety	SS-316	10

(d) Spare Part list of Inline Balanced Foam Proportioner

Sl. No.	Spare Part	Vendor	MOC	Quantity Moran
1.	Foam Proportioner	M/s FIRETECH Equipment & Services Pvt. Ltd.	SS-304	2
2.	Pressure balancing Valve	M/s FIRETECH Equipment & Services Pvt. Ltd.	SS-304	4
3.	Pressure Gauge-Water	M/s FIRETECH Equipment & Services Pvt. Ltd.	SS-316	4

4.	Pressure Gauge-Foam	M/s FIRETECH Equipment & Services Pvt. Ltd.	SS-316	4
5.	Gasket	M/s FIRETECH Equipment & Services Pvt. Ltd.	Nitrile	10
6.	Nut, Bolt	M/s FIRETECH Equipment & Services Pvt. Ltd.	SS-304	20
7.	Ferrule Fitting	M/s FIRETECH Equipment & Services Pvt. Ltd.	SS-304	6
8.	Drain Valve	M/s FIRETECH Equipment & Services Pvt. Ltd.	SS-304	6
9.	Flexible Tube	M/s FIRETECH Equipment & Services Pvt. Ltd.		10

3.5.4 Maintenance & Testing Schedule

Sl. No.	Equipment/ System	Periodicity
1	Hydraulic Testing of Fire Extinguishers*	Once in Three Years
2	Foam Pouring System Testing	Six Monthly
3	HVLRMs, Hydrants	Quarterly
4	MEFG	Quarterly
5	Rim Seal Fire Protection System	Quarterly/Six Monthly
6	Balanced foam proportioner (for HVLRMs & MEFGs)	Quarterly
7	Water Spray System	Quarterly

List of Fire Extinguishers:*Quantity at Moran Tank Farm:**

- a. DCP type 6 Kg capacity: 1 No.
- b. DCP type 9 Kg capacity: 21 Nos.

- c. DCP type 25 Kg capacity: 12 Nos.
- d. CO₂ type 4.5 Kg capacity: 4 Nos.
- e. CO₂ type 9 Kg capacity: 4 Nos.

3.5.5 FIRE ALARM SYSTEMS:

Fire Alarm and Detection system of Moran Tank Farm comprises the followings:

- a) COMBINATION DETECTOR:** Auto-adjusting levels: 1 to 2%/ ft. and 2 to 4%/ft. Operating temperature- 0⁰c to 38⁰c (32⁰F to 100⁰F). Voltage range- 15-32 volts peak. Standby current(max avg.-300μA, LED Current-6.5mA @24VDC("ON"))
Model: Notifier-FAPT-851(A), Acclimate® Plus TM Multi-sensor low profile intelligent Detector
Size: 2"(5.3cm) high; base determines diameter. Shipping weight-5.2oz.(147g)
Make: Honeywell; Quantity: 100
- b) MCP (SAFE AREA):** Dual-action (Two motions to activate the station), Operating voltage 24VDC, IP 24, Operating temp. 0-49 C.
Size:89(w)x93(h)x60(d),weight-130g
Model: NOTIFIER F /MCP/GLASS, Make: Honeywell
Quantity: 9
- c) MCP (HAZARDOUS AREA):**Break glass, Cast aluminium alloy LM6,RAL 3000 RED,Zone-1&2,IIA & IIB,T6,IP 65,Earthing- 1 no inside & 2 nos outside brass/SS(M4/M6) screws with 2 nos. plain washers. Upto 3 nos 2.5/4 sq.mm clip on type terminals or open strip type 15ampsx 4 ways.1 No.10A, 415V,1 NO/NC contact element.
Model: SAI/PBS/1050, Make: SAI Industries
Quantity:12
- d) HOOTER:** Outdoor wall and ceiling products. Nominal Voltage-Regulated 12VDC/FWR or regulated 24VDC/FWR. Operating voltage range-8 V to 17.5V (12V nominal) or 16V to 33V (24V nominal).x
Model: NOTIFIER HRA, Make: Honeywell
Quantity: 6
- e) HOOTER ACKNOWLEDGE BOX:** Wall mounting, Operating Voltage-230V/AC, Output freq-200Hz, Acknowledgement switch is provided to acknowledge the alarm.
Model: AL-140A-R; Make: POLMON
Quantity: 1
- f) EXIT SIGN BOARD:** The equipment shall operate with universal 2-wire AC input voltage of 120 to 347 VAC at less than 2.5Watts and universal 2-wire DC input voltage from 6 to 24VDC at less than 1.5Watts for single and double face signs. Power consumption less than 2.5W in AC or DC remote mode.CSA 22.2 No.141-10 standard for pictogram exit signs. Suitable for wall, end or ceiling mount comes standard with the canopy for quick and easy installation.
Quantity: 6
- g) FIRE ALARM JB:**IP 55 to EN 60 529/1091 complies with NEMA 12.Enclosure-Sheet steel 1.25mm,Cover-Sheet steel-1.25mm,width-300mm,height-120mm,weight-2.7kg,Gland Plate(Top Bottom)-
Model: KL 1530.510; Make: RITTAL

Quantity: 2

- h) SIREN:** Electrically operated, audible range-5KM, Mounting-Vertical single mounting three phase, Power supply-400/440v, 2800 rpm, 50Hz, AC. Model: VST-500; Make: KHERAJ

Quantity: 1

- i) ADDRESSABLE MONITOR MODULE FOR FLP MCP:** Powered directly by two-wire SLC Loop. No additional power required. Operating Voltage-15 to 32 VDC. Max. Current draw-5.0 mA. Operating temperature- 0°C to 49°C (32°F to 120°F).

Model: NOTIFIER NMM-100(A); Make: HONEYWELL

Quantity: 12

- j) ADDRESSABLE CONTROL MODULE FOR HOOTER & SIREN:** Internal circuitry and relay power directly by two-wire SLC loop. Normal operating Voltage 15 to 32VDC. External supply voltage regulated 24VDC supply; 2.2mA maximum using 80 VRMS supply. Temperature range- 0°C to 49°C (32°F to 120°F)

Model: NOTIFIER FCM-1(A); Make: HONEYWELL

Quantity: 7

- k) CONTROL FIRE ALARM PANEL (6 LOOPS):** 6 Loops, Input power-AMPS-24E:240VAC, 50/60 Hz, 2.25A maximum, Output power 24V Power, Main 24VDC: Up to 5A, Aux 24 VDC: Up to 5A. Battery charger Range 7AH-200AH batteries. Intelligent Addressable Fire Alarm System/Fire Alarm Control Panel (FACP)

Model: NOTIFIER NFS2-3030; Make: HONEYWELL

Quantity: 1

- l) FAULT ISOLATOR MODULE:** Powered directly by two-wire SLC Loop. No additional power required. High noise (EMF/RFI) immunity. Operating Voltage-15 to 32 VDC (Peak). Current range-5.0 mA. Operating temperature- 0°C to 49°C (32°F to 120°F); 150g (5 oz)

Model: NOTIFIER ISO-X; Make: HONEYWELL

Quantity: 5

3.5.6 Failure to maintain the systems mentioned in **clause no. 3.5.1, 3.5.2, 3.5.3, 3.5.4 & 3.55** in smooth running condition along with carrying out the scheduled maintenance, routine maintenance, preventive maintenance and breakdown maintenance of Moran Tank Farm **penalty will be imposed as per SL no. 2 of Penalty Clause no. 9.0.**

3.6 CLEAN AGENT SYSTEM:

(a) The clean agent system consists of following components:-

1. Control panel- 1 no.
2. Horn – 4 nos.
3. Strobes – 3 nos.
4. Co2 Cylinder- 6 nos.
5. Pilot Nitrogen Cylinder- 2 nos.
6. Main Nitrogen Cylinder:- 38

7. Pressure relief Damper: - 3 nos.
8. Miniature Contact module: - 3 nos.
9. Smoke Detector:- 92 nos.

The intex multi crest S508 is an intelligent addressable fire alarm system, with a simple and compact design concept. The S508 supports up to 508 addressable devices in styles 4, 6 and 7 of the signal line circuit, making it suitable for a range of small to medium sized applications.

The system features intelligent anti tamper protection. The panel front operation is protected against tampering by intelligent methods such as software passwords and a hardware key switch.

The S508 panel is equipped with address setting functionality, which allows users to set the address numbers of addressable devices connected to the panel, thus eliminating the need for a dedicated address setting device.

The S508 panel also has the ability to control fire suppression system. This functionality consists of auto and manual mode .Under the auto mode either multiple fire detector signals or a manual release signal activates the devices in the suppression zone via user configuration .The manual mode accepts only the manual release signals to activates the devices in the suppression zone.

(b) Miniature Contact Modules (MCM):-

The miniature contact module is used to monitor the contact status of an initiating device that contains a normally open contact. The MCM can be programmed in the panel to supervise either a normally open or close contact on the FACP panel.

Specification of MCM:-

No.	Item	Specification
1	Rated voltage range of SLC input power(S+,S-)	22.0 to 24.0 V
2.	Maximum SLC 24 VDC stand by current (S+, S-).	250μA
3.	Maximum SLC 24 VDC alarm current (S+, S-).	250μA
4.	IDC input circuit wiring style	Class B (Style B)
5.	End - of- line resistor for IDC	5.1kΩ,1.2W
6.	Maximum wiring resistance of IDC	100Ω
7.	Maximum wiring capacitance of IDC	1μF
8.	Operating temperature range	0°C to 49°C (32°F to 120°F)
9.	Operating humidity range	0 to 93% (non condensing)

(c) Single Contact Module (SCM):

The single contact module is used to monitor the contact status of a device that contains normally open contact. It can be programmed in the panel to supervise either a normally open or normally closed contact on the fire alarm control panel.

Specification of SCM:-

No.	Item	Specification
1	Rated voltage range of SLC input power(S+,S-)	22.0 to 24.0 V
2.	Maximum SLC 24 VDC stand by current (S+, S-).	250μA

3.	Maximum SLC 24 VDC alarm current (S+, S-).	1mA
4.	IDC input circuit wiring style	Class B (Style B)
5.	End - of- line resistor for IDC	5.1k Ω ,1/2W
6.	Maximum wiring resistance of IDC	100 Ω
7.	Maximum wiring capacitance of IDC	1 μ F
8.	Operating temperature range	0°C to 49°C (32°F to 120°F)
9.	Operating humidity range	0 to 93% (non condensing)

(d) Dual Contact Module (DCM):

It is used to supervise multiple contact points with unique form a single device. It may be configured to monitor a normally open or normally closed contact.

Specification of DCM:-

No.	Item	Specification
1	Rated voltage range of SLC input power(S+,S-)	22.0 to 24.0 V
2.	Maximum SLC 24 VDC stand by current (S+, S-).	250 μ A
3.	Maximum SLC 24 VDC alarm current (S+, S-).	1mA
4.	IDC input circuit wiring style	NFPA class A (Style D)
5.	IDC input circuit wiring style	NFPA class B (Style B)
6.	End - of- line resistor for IDC	5.1k Ω ,1/2W
7.	Maximum wiring resistance of IDC	100 Ω
8.	Maximum wiring capacitance of IDC	1 μ F
9.	Operating temperature range	0°C to 49°C (32°F to 120°F)
10.	Operating humidity range	0 to 93% (non condensing)

(e) MCP Indoor call point Range MCP₃ NO/NC Contact Model (Red Versions)

Product Benefits:

- Unique 'Plug & Play' installation concept.
- Total 'Flex ability' in the choice of operation element.
- Anti-Tamper facility.
- Enhanced aesthetics.
- Fully approved to the latest standards.
- Backward compatibility.
- CPD Approved.

Installation efficiency, flexibility and full compliance with the latest standards are at the heart of the new MCP indoor call point range. These products utilize a special terminal block where all initial installation cabling is terminated. This terminal block is then simply connected to the back of MCP.

The MCP3A product version is supplied with one normally open and one normally closed contact. Selecting either the 'Normally Open' or 'Normally Closed' contact easily achieved by simply connecting the terminal block to the required connection in the back of the MCP3 Product. Single pole changeover switching can be achieved with the use of two terminal blocks.

Ordering information:

Model	Electrical Configuration	Mounting	Operating	Markings
MCP3A-R000SF-K013-01	N/O & N/C contacts 30VDC	Surface	Flexi	EN54-11

MCP Indoor call point Range MCP₃ NO/NC Contact Model (Yellow Versions)

Model	Electrical Configuration	Colour	Mounting Element	Operating	Marking
MCP3A-R000SF-K013-01	N/O & N/C contacts 30VDC	Yellow	Surface	Flexi	Plain

(f) System Sensor: Indoor selectable – Output Horns, Strobes and Horn Strobes for wall application.

The Spectra Alert Advance series offers the most versatile and easy to use line of horns, strobes, and horn strobes in the industry. With white and red plastic housings.

Physical/Electrical Specifications

Standard Operating Temperature	32° to 120°F (0°C to 49°C)
Humidity Range	10 to 93% non-condensing
Strobe flash rate	1 flash per second
Nominal Voltage	Regulated 12DC/FWR or regulated 24 DC/FWR
Operating Voltage Range	8 to 17.5 V (12 V nominal) or 16 to 33 V (24 V nominal)
Input Terminal Wire Gauge	12 to 18 AWG
Wall-Mount Dimension.	5.6" L x 4.7" W x 2.5" D
Horn Dimension	5.6" L x 4.7" W x 1.3" D
Wall-Mount Back Box Skirt Dimensions (BBS-2,BBSW-2)	5.9" L x 5.0" W x 2.2" D

Wall-Mount Trim Ring Dimension (Sold as a 5 pack) (TR-HS,TRW-HS)	5.7" L x 4.8" W x 0.35" D
--	---------------------------

(g) The spares for Clean Agent system:

Sl No	Item details	Part no.	Model	Specification	Qty
1	N2 storage cylinder (Capacity-20.3 cum)	U4011	NN83CU-E	50 Mpa (HYDROSTATIC)	40 nos
2	Cylinder valve(For N2 storage cylinder)	U2101	PC30BU	27.9 Mpa (operating)	40 nos
3	N2 pilot cylinder (Capacity -8.2 cum)	U4002	NN82.5CU	24.5 Mpa (HYDROSTATIC)	2 nos
4	Cylinder valve(For N2 pilot cylinder)	U2201	PH10NU	10 Mpa (opearting)	2 nos
5	Pressure Gauge 0-400 bar(For N2 storage cylinder)	...	PGS21	38 nos
6	Pressure Gauge 0-250 bar (For pilot cylinder)	PGS21	...	2 nos
7	Connecting Device (For PH10NU)	2 nos
8	Releaser(For cylinder valve Model PH10NU)	U2501	PH10-N3	10 Mpa (operating)	2 nos
9	LOOP PIPE (Pipe Dia- 18.4Xt 2.2 mm . Nut- G 3/4)	U2901	14QSU	38 nos
10	NON RETURN VALVE	U3101	14SU	10 Mpa (operating)	38 nos
11	CO2 actuating cylinder	U0210	AC2.1U	24.5 Mpa (HYDROSTATIC)	6 nos
12	Cylinder Valve(For CO2 actuating cylinders)	U0015	PH5CU	5.6 Mpa (Operating)	6 nos
13	Cylinder Valve Solenoid(For cylinder valve Model PH5CU)	U0060	R85M14	6 nos

14	Non RETURN VALVE	U0095	4S-B	6 nos
15	Non RETURN VALVE	U3001	LCV4A	10 Mpa (Oprating)	3 nos
16	Relief Valve (Small leakage valve)	U0090	4BLA	0.098 Mpa (Max relief Pr.)	6 nos
17	Safety Vent	U3201	SAV94U	11.9 to 16.2 Mpa (Opearting)	1 nos
18	Selector Valve	U0073	PD 50KU	10.0 Mpa (Operating)	3 nos
19	Pressure Switch		PR79-1MT		3 nos
20	Discharge Nozzle	U3621 U3341	20ZMTU,25 ZMTu	3/4" (20A)-- 12 nos 1"(25A)--9 nos	21 Nos
21	Resetting Tool		TCR65B		1 SET
22	Spanner(For PH type cylinder valve releaser)		PH14D		1 SET
23	Fire alarm control panel (which is an intelligent addressable fire alarm system)		S508	S508 fire alarm control panel.	1 no
24	Miniature contact module		FRRU004-MCM		3 nos
25	Single contact Module		FRRU004-SCM4		3 nos
26	Dual Contact Module		FRRU004-DCM4		3 nos
27	Monitored Output Module		FRRU004-MOM4		3 nos
28	MCP Indoor call point range MCP3 NO/NC Contact Model (Red Version)		MCP3A-R00SF-K013-01		3 nos
29	MCP Indoor call point range MCP3 NO/NC Contact Model (Yellow)		MCP3A-Y000SF-K013-11		3 nos
30	System Sensor (SPECTR Alart)			2-Wire Horn Strove,standardcd,red	1 no

31	Pressure relief Damper (500x415 mm)		UL. KUL		3 nos
----	---	--	---------	--	-------

- (h) Failure to maintain the Clean Agent in smooth running condition along with carrying out the scheduled maintenance and breakdown maintenance **penalty will be imposed as per SL no. 6 of Penalty Clause no. 9.0.**

3.7 AIR CONDITIONER SYSTEM:

Make : **Bluestar**

Model No. : DPAP1983R1 – I

Capacity : 16.56TR (3 compressor of 5.5TR capacity) Air Cooled

Total No. of units : 6 nos.

3.7.1 Scope of Work:

The comprehensive Annual Maintenance Contract of the Air Conditioners shall inter-alia include:

- Monthly checking and servicing the air conditioning plant/unit. The Service Report Card has to be handed over to the Installation Manager of the Tank Farm.
- Attending to the plant for repair/maintenance as and when called for.
- Cleaning the evaporator and condenser.
- Repair/overhaul of components of equipment at site/in our service installation, including replacement of worn out parts when found necessary.
- Replenishing of refrigerant required as a result of a leak in the system arising out of wear and tear.
- Lubricating the bearings of motor and fans, when found necessary.
- Inspection of belts, adjusting of tension and replacement of worn out belts as and when required.
- Repair of microprocessor controls and motors and starters.
- Checking motors and starters, checking the operation of controls.
- Painting of equipment and platform of the outdoor AC units during the contract period.

3.7.2 Failure to maintain the air-conditioner system in smooth operational condition along with carrying out the scheduled maintenance and breakdown maintenance **penalty will be imposed as per SL no. 7 of Penalty Clause no. 9.0.**

3.7.3 Spares:

Indicative list of spares and approximate quantity to be maintained by the contractor for two years AMC given below:

Sl. No.	Component	Model	Make	Rating	Quantity

1.	Compressor Specifications : 5.25KW, 2900rpm motor, Hermitically sealed	DPAN (BLUESTA R)	Emersen	5.5TR	3 nos
2	Blower Motor Specification : 415V, 3 phase IM, Duty S1, Encl TE, rpm 1430, Frame:100L		Hindustan Electric Motor	3KW	1no
3	Air Filter : 1255X688mm2	Blue Star	Blue Star		18 nos
4 (a)	V Belt (Wet Grinder Belt)	A28	Ecodrive		10 nos
4 (b)		A199L LP/A77	Flexer		10 nos
5	Refrigerant Filter Drier		Danfoss		4 nos
6	MCCB	DL100	L&T	63A	4 nos
7	MCB		L&T	6A	6 nos
8	CT – 60/1A 5VA, Class -1		Kappa Electrical	60/1 A	4 nos
9	Controlling PCB				2 nos
10	Running capacitor				6 nos
11	HPLP switch (8nos HP + 8nos LP switch)				16 nos
12	Expansion valve				2 nos
13	Outdoor fan blade				4 set
14	Condenser fan motor				6 nos
15	R22 refrigerant, 61 kg (per cylinder)				1 cylinder
16	Leak Test (detector) N2 cylinder				4 nos.
17	Contactor 3phase				10 nos.

3.8 MAINTENANCE OF STORAGE GODOWN:**3.8.0. DETAILS OF STORAGE GODOWN FOR MAINTENANCE :****3.8.1. PRINCIPAL DIMENSIONS:**

Overall length	:	9000 mm
Overall length including skid	:	9600 mm
Overall width	:	2700 mm
Overall height with skid and lifting lug	:	2800mm

3.8.2 GENERAL DESIGN AND CONSTRUCTION (COMPONENTS OF STORAGE GODOWN):**1. SHELL:**

The shell structure comprising of sidewalls, end walls and self draining roof. SKID:

The Bunk House mounted on a skid arrangement made of two build-up I sections (200x100x8 mm thick) having 3 Nos. cross members of formed C section (150x75x8mm thick). At the end of skid, suitable formed section made of steel conforming to IS: 2062 connected.

Materials of structural steel members conform to IS: 2062 Grade A

2. BASE FRAME / FLOOR SYSTEM:

The main structural elements of the under frame 125x50 with C section from minimum 3.15 mm thick sheets conforming to IS: 1079 Grade O/ IS: 2062 Grade A. This under frame supports the floorboard of min. 35 mm thick MDF board (weather & borer proof) duly fixed by self-tapping screws to 16 G thick steel sheets welded to the base and steel runners. PVC Sheet tiles of 2 mm thickness of size 300x300 mm of reputed make laid over the MDF board and Bitumen preservative paint is to be applied on the lower side of the board.

3. SIDE & END WALLS:

The sidewalls made of wall posts, corrugated panels and top cant rails. The cladding panels made of min. 1.6 mm thick steel sheet conforming to IS: 1079 Gr. O and be vertically corrugated by means of press forming, continuously welded to top side and base structure. The wall post -cold formed Z-section made out of min. 3.15 mm thick mild steel sheets conforming to IS: 1079 Grade O. The top cant rails made of formed (C) section of size of 200x50x3.15(min.) mm thick, materials conforming to IS: 1079 Grade O/ IS: 2062 Grade A.

4. ROOF:

Self draining roof made of 1.6 mm thick steel sheets conforming to IS: 1079 Grade O, adequately stiffened by roof bows of pressed channel sections of thickness 2.5/3.15 mm with same material specification with positive camber allowing water to drain away under static conditions.

5. SURFACE TREATMENT AND PAINTING:

The surface preparation of all fabricated steel components to achieve SA-2 quality finish, followed by one coat of zinc based primer and two coats of epoxy paint by air

spray method. The under frame and skid painted with bituminous / red lead paint of reputed make. Necessary marking/ logos provided as per the instruction of OIL

6. INSULATION:

Average 75 mm thick thermal insulation with resin bonded fiber glass wool having density of 16 kg/m³ and conforming to IS: 8183 on the side walls, end walls and roof, with proper fixing arrangement.

7. INNER PANELLING:

The panelling of side walls and end walls of min. 1 mm thick resin bonded plastic decorative laminate sheets fixed on min. 8 mm thick commercial quality plywood. The roof panels are min. 4 mm thick commercial quality plywood of same specification covered with min. 1 mm thick resin bonded plastic decorative laminate of same quality and design as in the case of inner panels. All wall and roof panels supported by suitable M.S. Frame work.

8. DOORS:

One steel door at the main entry of the bunk house. The overall dimension of the main entry door -1981 x 800 mm (H x W). The steel doors comprises of a framework of min. 3.15 mm thickness(material conforming to IS: 1079 Grade O / IS: 2062 Grade A), on which outside cladding of 2mm thick steel sheets (conforming to IS 1079 Grade O)with two vertical corrugations are fixed. Doors with 40 mm thick resin bonded fiber glass wool insulation.

The peripheral edges of the door provided with rubber seal to prevent ingress of water and dust. The door panel be outward opening type with single leaf closing panel provided with manually operating type locking arrangements from both internal and external side and steel rain-shed made from 2 mm thick sheet (IS:1079 Gr. O) from outside.

9. WINDOWS:

The windows -horizontal sliding type having overall dimensions 585x800 mm (H x W), decorated by anodized aluminium extruded section fitted with sliding shutter-proof safety glass sheets of clear vision and min. 4 mm thickness. Iron grills made of 20 mm M.S. flats provided in the windows for safety purpose. Stainless Steel fly-proof mesh in suitable framework provided in the windows, provided with steel rain-shed made from min. 2 mm thick sheet (IS:1079 Gr.O) from outside.

10. STEPS/STAIRS:

Fabricated steel steps of detachable type having three treads provided in each bunk house for getting inside at main entry door, made of checkered plates and formed channel sections.

11. ELECTRICALS:

PVC insulated copper wire of ISI mark used for the wiring done in PVC conduits. As a measure of safety, continuous copper earth wire provided as necessary. For lighting circuits, 3/1.09 cable and for heavy-duty circuits, such as air conditioners, heating circuits, 7/1.22 cable used. DOL switches of capacity 250V/15 Amps provided for air conditioners. Concealed type (2x36) roof hanging florescent light, four nos. each of 15 Amps and 5 Amps 3 pin sockets.

All the lamps, fans, exhaust fans; plug points etc. with independent slash/piano type switches. Ceiling fans of Crompton, or equivalent of reputed make. All electrical points

& switches of Anchor or equivalent make with necessary circuit breakers i.e. MCB & ELCB. Supply to refrigerator and heating unit through metal clad MCB of adequate rating. Junction Box outside on the bunk house for telephone connections with suitable connecting points inside the bunk house.

12. HANDLING AND TRANSPORTATION:

Necessary arrangement at top four corners for safe and easy lifting and transportation of the bunkhouse.

13 TARFELTING:

The roof surface painted with one coat of "Bitumen Primer" before laying Hessian based finished tar felt as per IS:1322, Type-3, Gr.-1 in two layers as basic waterproofing material. Blown Grade Bitumen 85/25 as per IS: 702 in three layers 1.5 Kg/M2 used as the bonding materials. Fine sand finally sprinkled over the last layer of bitumen.

4.0 MAINTENANCE OF RIM SEAL FIRE PROTECTION SYSTEM:

Comprehensive Annual Maintenance Contract (CAMC) shall include maintenance services for Rim Seal Fire Protection System of floating roof crude oil storage tanks of CTF, Moran including spares and consumables, tools/tackles as required for regular maintenance/preventative maintenance/breakdown maintenance under the said services during the entire period of the contract and its extension, if any.

Rim Seal Fire Protection shall be utilized for following 4 (Four) number of tanks of diameter 24.4 Meter.

A. RIM SEAL FIRE PROTECTION SYSTEM:

The overall purpose of the system is to detect and extinguish the Rim Seal fire over external floating roof tanks storing class "A" Petroleum Products at the incipient stage and simultaneously alert the personnel at the facility so that they can respond to the incident.

The installed Automatic Rim Seal Fire Detection and Extinguishing System specially designed for extremely fast detection and effective suppression of fires. The system is designed as per OISD guidelines.

The extinguishing media is AFFF (3% Low expansion) Premix foam solution, which has excellent film formation & cooling properties to prevent re-ignition after suppression.

The system is mainly categorized in the following sub systems:

1. The linear heat detection system comprising of the detection evaluation unit & sensor tube which detects the fire and automatically actuates the extinguishing system
2. Foam (UL Listed) based extinguishing system.
3. The power and signal hook up between the detector and extinguishing system on the roof, junction boxes outside the dykes & PLC based fire alarm annunciation panel and detection system Interfacing/Communication.

Major components details for the above sub systems are given below:

Sr.	Sub-System/ Component	Manufacturer/supplier
-----	-----------------------	-----------------------

No.		
1.	LINEAR HEAT DETECTION SYSTEM	
a	Metallic Tube Linear Heat Detection Junction Box	Enclosure: M/s Flexpro Detector Unit: M/s Securiton
b	SS Sensor Tube	M/s Vimal Fire Control Pvt. Ltd.
c	RS 232 to RS 485 (2 wire) Interfacing Units	M/s. Abacus Electronics Pvt. Ltd.
2.	FOAM BASED EXTINGUISHING SYSTEM	
	Foam Module/Vessel	M/s. Praj Industries
	Foam Discharging Nozzles	M/s Vimal Fire Control Pvt. Ltd.
	Pressure Switch	M/s. Indfos Industries Pvt. Ltd.
	Level Switch	M/s. Chemtrol Samil Pvt. Ltd.
	Level Gauge	M/s. Pune Techtrol Pvt. Ltd.
	Flame Proof Solenoid Valve	M/s. Rotex Automation
	Auto Actuation Discharge Valve Pneumatic Actuator Ball Valve	M/s. EL-O-Matic (I) Pvt. Ltd.
	Pressure Gauge	M/s. Baumer Technologies Pvt. Ltd.
	Safety Valve	M/s. Bliss Anand
3.	PLC BASED FIRE ALARM PANEL & INTERFACING/COMMUNICATION/HOOK UP WITH DETECTION/EXTINGUISHING SYSTEM ON TANK TOP	
a	Alarm Annunciator Window	M/s. EAPL
b	Programmable logic Controller with Graphic Console	M/s. Allen Bradley
c	Fiber to Ethernet Switch (ETAP)	M/s. Allen Bradley
d	RS 232-485- USB (2 wire) Interfacing Units	M/s. Abacus Electronics Pvt. Ltd.
e	Safety Barriers	M/s. Pepper + Fuchs (I) Pvt. Ltd.
f	Flame Proof Field Junction Boxes	M/s. Flexpro Electricals Pvt. Ltd.

	(Power, Signal Junction Box)	
g	Redundant Uninterrupted Power Supply	M/s. Hi-Rel

B. SCOPE OF WORK:

The contractor has to carry out Preventive/Periodic Maintenance and Breakdown maintenance as per recommendations and guidelines of the respective equipment OEMs or periodic maintenance schedule provided by OIL including supply of spares (Refer Schedule of Quantities, PART-II of contract). Following are the minimum activities to be taken up during Preventive maintenance but not limited to:

I. Basis Checks of the system -: To be done by contractor

1. Check and record the foam module pressure for all tanks. If pressure reading of foam module found out below 14.5 kg/cm² (threshold limit) then it is under the contractors scope of work to find out the cause through which pressure level dropped and take necessary remedial measures to rectify the same.
2. Ensure foam module pressure at a level of 14.5 Kg/cm² for all foam modules.
3. Perform foam discharge valve activation test.
4. Simulate the system through selector switch on Dyke JB's of individual tanks.
5. Check the system by Closing by Manual valve with the help of MCP installed at Dyke JB's of individual tanks.
6. Ensure the alarm system in healthy operational condition on daily/ regular basis.
7. Check communication between Control Room panels, Dyke Panel, ADW panel at Tank roof Control Room and ensure all communications free from any kind of defects.
8. Check/maintain the power in all JB's (Dyke, Roof, and Control Room).
9. Generate Healthiness data of Rim seal System by Downloading the ADW data of individual tanks on Quarterly basis.
10. Perform leak test of individual foam modules of tanks checked by foam spray and rectifies the same (if any) and submit the consolidated report to OIL.
11. Also submit consolidate report of checks and maintenance job.

Note:

- i) Laptop and allied arrangement shall be available with service engineer for data downloading/data checking/Site acceptance test of system.
- ii) The contractor's Instrumentation crew shall visit the Tanks daily during general shift for routine maintenance, inspections, and preventive maintenance adjustments for the Rim Seal Fire Protection Systems and carry out corrective actions for Systems.

II. The contractor shall have a tie up agreement with Original Equipment Manufacturer (OEM) and such agreement shall be submitted to OIL before

start of any Preventative/Breakdown maintenance jobs pertaining to Rim Seal system.

For OEM services as required which shall be valid during the period of the contract and its extension, if any, so as to ensure trouble free maintenance as per terms of this contract.


In case the contractor's service Engineer fails to restore the systems/subsystems and OEM services are required the contractor must obtain services from OEM competent Engineers within 24 hours of reporting of such incident by operation Engineer of Moran Tank Farm, failing which penalty shall be imposed as per contract **clause No.9.0**. In this regard, the contractor must make arrangements with OEMs for AMC/ on-the-call-services as a part of the agreement.

Requirement of OEM or their authorized dealers for Annual Maintenance Contracts (AMCs) / Warranties of their respective equipment shall be an issue of the contractor of their own. In case, the contractor decides for bringing OEM or their authorized dealers for any job at Tank Farms the same needs to be endorsed by OIL on immediate basis. The responsibility for the maintenance service shall entirely rest with the contractor in case of any failure to do so. Failure of the same shall not be acceptable. OIL's endorsement will only be for allowing the contractor to employ the OEMs / authorized dealer on their behalf.

C. Instrumentation System:

The Rim Seal Fire Protection System for Floating roof tank is a fully automatic fire detection cum extinguishing system. Specifically designed and manufactured for extremely fast detection and extinction of any type of Rim Seal fires.

The typical system hook up drawing of Moran Central Tank Farm is as follows:

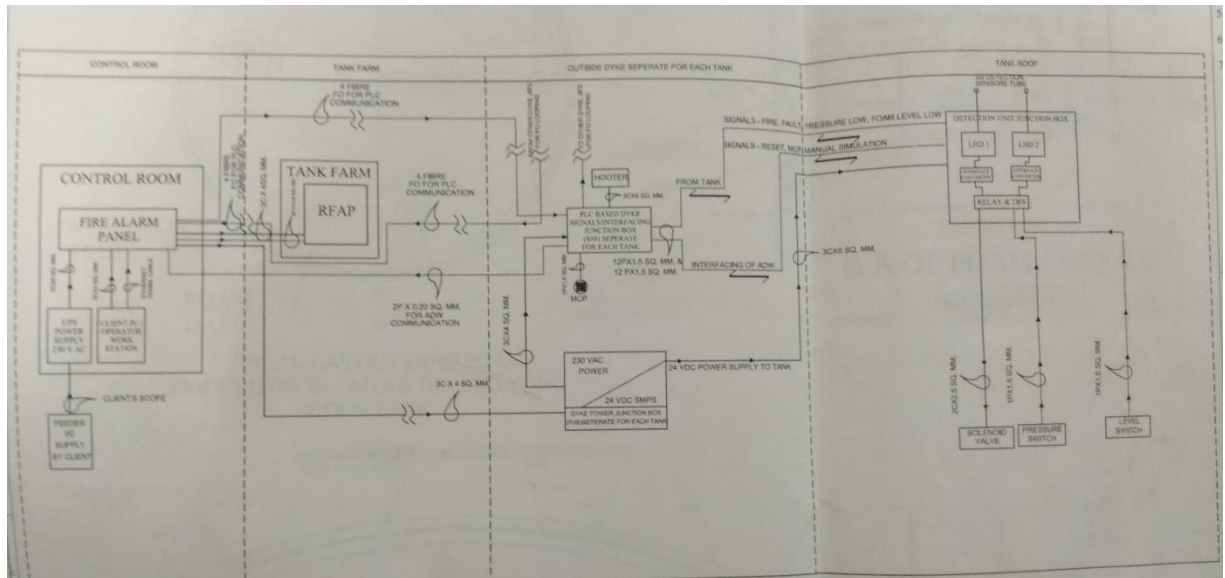

The Tank wise Details of no. of LHD & DUJB are as follows:

Sl. No.	Location	Tank no.	No. of LHD	No. of DUJB
1.	Moran	TK-9	1	1
2.	Moran	TK-10	1	1
3.	Moran	TK-11	1	1
4.	Moran	TK-12	1	1

The basic components of the system are

Sr. No.	Sub-System/ Component	Manufacturer/supplier
---------	-----------------------	-----------------------

1	Metallic Tube Linear Heat Detection Junction Box	Enclosure: M/s Flexpro Detector Unit: M/s Securiton
2	SS Sensor Tube	M/s Vimal Fire Control Pvt. Ltd.
3	RS 232 to RS 485 (2 wire) Interfacing Units	M/s. Abacus Electronics Pvt. Ltd.
4	Pressure Switch	M/s. Indfos Industries Pvt. Ltd.
5	Level Switch	M/s. Chemtrol Samil Pvt. Ltd.
6	Level Gauge	M/s. Pune Techtrol Pvt. Ltd.
7	Flame Proof Solenoid Valve	M/s. Rotex Automation
8	Auto Actuation Discharge Valve Pneumatic Actuator Ball Valve	M/s. EL-O-Matic (I) Pvt. Ltd.
9	Pressure Gauge	M/s. Baumer Technologies Pvt. Ltd.
10	Alarm Annunciator Window	M/s. EAPL
11	Programmable logic Controller with Graphic Console	M/s. Allen Bradley
12	Fiber to Ethernet Switch (ETAP)	M/s. Allen Bradley
13	RS 232-485- USB (2 wire) Interfacing Units	M/s. Abacus Electronics Pvt. Ltd.
14	Safety Barriers	M/s. Pepper + Fuchs (I) Pvt. Ltd.
15	Flame Proof Field Junction Boxes (Power, Signal Junction Box)	M/s. Flexpro Electricals Pvt. Ltd.

The jobs to be carried out are as follows:

1. Carrying out calibration of pressure switch and actuation test for all the pressure switches.
2. Carrying out calibration of Level switch and actuation test for all the pressure switches.
3. Testing/maintenance / repair of solenoid valves.
4. Testing/maintenance/repair of pneumatic actuator of rim seal system.
5. Checking of alarms and rectify the faults (as required) by downloading the ADW data of individual tanks from Dyke panel available at outside the dyke/ Roof Tank JB's/Control Room/ Annunciator Window of Control Room. Generating healthiness Report of individual tanks and same to be submitted to OIL.

6. Checking all power supply units for proper voltage and current.
7. Functional checking of pneumatic operated valve, Solenoid Valve, Detector tube, pressure switch, MCP etc.
8. Inspection of all the components, wiring terminals etc. in the control panel and in the intermediate junction boxes and in the Status of field junction boxes and if any problem like looseness or corrosion in terminals or any other faults is identified, then rectify the same.
9. Checking of annunciation and hooter system and rectify the faults if any.
10. Checking of communication between Control Room panels, Dyke Panel and ADW panel at Tank roof Control Room.
11. Checking of loop wiring from tank Top Junction Box & Dyke Junction Box to Control Room.
12. Functional checking of Linear heat Detection System
13. Checking of events in history of Rim seal SCADA PC.
14. To take Backup of the PLC controller.

Note:

- a. All check-ups and functionality test of complete system of the Rim Seal Fire Protection System is carried out without discharging of AFFF with the help of MCP /Roof JB's/ Field JB outside the Dyke/ Control available at Dyke panel.
- b. The above list of activities/checks are indicative. It is contractor's responsibility to maintain all the Instrument's and the Instrumentation control systems of Rim Seal Fire Protection System in healthy state throughout the Contract period.
- c. Contractor should take sole responsibility to decommissioning & recommissioning of a part of the existing Instrumentation system installed in each tank and control room due to operational, safety and statutory compliance.,
- d. Faults of any kind shall be rectified by repair / replacement of appropriate parts and functionality checks to be carried out after rectification of the fault. Before replacement of faulty parts/ change in system or replacement of any parts, report should be submitted and which should be acknowledge by OIL.

D. Routine Service of Mechanical Systems (Quarterly):

1. Checking/ maintaining the pressure of all foam modules at 15Kg/cm² and re-pressurize the same with AFFF Foam and RO- Water in given format as given by OIL. (Nitrogen gas and allied arrangement/fitting to fill nitrogen in foam module shall be in scope of Contractor)
2. Checking of conditions of mountings, clamps, shelters etc for damage, corrosion, and rectify the same.
3. Filling of AFFF foam in the foam modules and pressurization by N₂ gas in tanks in case of release of Foam due to actual Fire or fault. (AFFF foam shall be provided by OIL).
4. Adequate spares & non-sparking tools as required for system maintenance will be replaced by contractor and reimbursement of such spares shall be done by OIL.

Note: OIL will reimburse the cost of those replaced spares which are consumed for system maintenance and also listed by contractor in their price bid. Cost of non-listed spares which are consumed for system

maintenance shall be borne by contractor. Mobilisation inspection and suitability report of spares is necessary for reimbursement and shall be carried by OILs competent personnel in the presence of Installation Manager and Contractors representative.

5. Cleaning of nozzles including flushing of foam lines, Replacement of old defective nozzles & fitting of new nozzles (if required) prior to approval from OILs competent authority but defective parts are to be submitted.
6. Leak test shall be performed with the help of foam spray in all fittings available at foam modules.

E. Half Yearly Checks of System:

1. Contractor shall submit the original invoice on half yearly basis along with allocated job completion certificate duly certified by the Installation Manager/Engineer In-charge (OIL).
2. Calibration of Pressure gauge, Pressure switch, Solenoid valve, foam Nozzle cleaning of individual tanks to be done on half yearly basis.
3. Hydro testing of foam module by water/pneumatic pump at 25kg/cm² of 5 min once in a year report of same shall be submitted.
4. Checking of loop wiring from tank Top JB & Dyke JB to Control Room.
5. Functional checking of Linear heat Detection System (ADW).
6. Checking of events in history of Rim seal SCADA PC.
7. Thickness test of Foam Module in every six months and report of same shall be given with comparison chart with respect to previous reports.
8. Parameter report of ADW having details of TAU, Alarm max, Alarm diff., pre alarm max (90%), Pre-Alarm diff (90%) and self-test internal of debugging pump.
9. Checking of alarm indication on rim seal system SCADA PC and annunciator panel and screen shot of same may taken and is too attached in invoice.
10. Checking and cleaning of each and every nozzle of all tanks and record of same shall be submitted.
11. Testing and checking of Pressure switch, solenoid valve, pneumatic actuator, Pressure Gauge, N2 data of each tanks, safety valve is to be in half yearly basis/OEM guidelines.
12. Checking of all tanks by closing the manual valve for 03 tanks and 02 tank with full discharge of foam in presence of OIL competent authority. So, that each tank shall be check with full discharge once in a year.
13. A details format may be prepared by contractor and filled in each (quarterly as well as half yearly) for each tanks -:
 - i. Parameter of Power supply of each unit e. UPS, FAP, RFAP, PJB etc.
 - ii. Status of Foam Modules accessories i.e. Manual ball valve, level switch, actuator valve, Solenoid valve, Pressure switch Pressure gauge with Snubber –isolation valve Manifold pipes, rubber grommets, Manifold pipes, Safety valve with isolation valve and allied equipments.
 - iii. Test nozzles Sensor tube and fittings, DUJB, signal JB, Power JB, Cable glands, Pneumatic tubes, Main fire alarm panel.
 - iv. Power/control/signal, cable from tank top to dyke panel and control room.
 - v. Communication checking from tank top to dyke panel and control room.
 - vi. Module pressure Data of each tanks
 - vii. Pressure switch data of each tanks

- viii.** Checking of system of each tank by manual/Automatic data simulation by MCP/JBs/Control Room/Tank JB's /Solenoid /actuator actuation.

Spare: Supply of spare/ consumables is in contractor's scope. (For list of spares/ consumables refer enclosed SCHEDULE OF QUANTITIES, SOQ, PART-II of the contract)

4.1 PLANT and PLANT BATTERY LIMITS:

- A. "PLANT" shall mean the entire area as mentioned in the CLAUSE No. 2.0 Broad scope of work falling within the existing boundary walls of the Tank Farm on its four sides. PLANT encompasses all facilities, equipment, machinery, civil structures, sheds & buildings within the boundary walls as mentioned in clause no. 3.0 and its sub-clauses 3.1 to 3.8
- B. Power and duties of Contractor: The Contractor shall take all appropriate steps to maintain in force & execute the Contract in accordance with the terms of the Contract. All maintenance jobs will be carried out by the Contractor in accordance with policies, work program within the plant in accordance of the provisions of contract and the directions of the Mines Manager, Installation Manager or his authorized representative and in accordance with standard and safe industry practice within the purview of all statutory norms applicable in upstream oil industry.

5.0 HSE (HEALTH, SAFETY AND ENVIRONMENT):

- i) Contractor shall maintain the plant in a diligent, safe and efficient manner strictly in accordance with provisions stipulated obligations imposed upon by applicable laws of India, Indian Mines Act, Oil Mines Regulations, Indian Explosives Act and Indian Electricity Rules, Petroleum Rules etc. in force and OISD norms in vogue.

Contractor shall also comply with guidelines of the Statutory bodies like DGMS, OISD, IBR, State and Central Pollution Control Board(s), PESO, Legal Metrology Department, OIL's HSE policy and other relevant statutory body in existence or likely to come into existence. The contract should submit DGMS returns Quarterly before 10th of April, July, October & January as it is a mandatory DGMS guidelines.

For any HSE matters not specified or without any stipulated provision in the contract document, the Contractor will abide the relevant and prevailing acts / rules / regulations & sound industry practices pertaining to Health, Safety and Environment.

- ii) It will be solely the Contractor's responsibility to fulfil all legal formalities with respect to the Health, Safety and Environmental aspects of entire "MAINTENANCE" job under the contract (namely formalities related to the person & the equipment employed by the Contractor and the environment etc.) under the jurisdiction of Dibrugarh district, Assam.

Further, during carrying out all the "MAINTENANCE" jobs at Moran Tank Farm, it will be entirely the responsibility of the Contractor to ensure strict adherence to all HSE measures, statutory rules and to ensure safety of all workers of the Contractor.

- iii) The Contractor has to update and timely submit all HSE related paper-works including but not limited to reporting, record keeping etc. to external agencies and/or to OIL. The report-formats will be as per prevalent ones in OIL and/or as suggested by statutory bodies and as per prevailing laws. Some of such formats include Form-A (MVT), Form-B (employee register), Form-E (daily attendance) and Form-J, K (accident-report), Form-O (IME/PME), Training Matrix etc. as per Mines Rules 1955.

In case of employee's daily attendance in Form-E, the Contractor shall regularly take and maintain attendance of all its employees coming to work. As stated in man power clause, the Contractor shall promptly report to Installation Manager if deviation in attendance from already submitted man power roster happens on a day.

Contractor shall have to report all incidents including near miss to Installation Manager / departmental representative of the concerned department of OIL. The Contractor has to arrange daily tool box meeting and regular site safety meetings and maintain records.

- iv) The Contractor within 30 days from LOA of the contract - shall prepare written Site Specific Maintenance Plan (SMP) along with Safe operating Procedures (SOP) for the work to be carried out, including an assessment of risk, wherever possible and safe methods to deal with them. The SMP/SOP should clearly state all the risks that may arise to men, machineries & material during execution of any maintenance jobs to be done by the Contractor and how it is to be managed. In case the Contractor is found non-compliant of HSE laws as required, OIL will have the right for directing the Contractor to take prompt action to comply with the requirements or to cease work until the noncompliance is corrected.
- v) In case of accident causing injury, loss of life or property inside the Plant, the Contractor shall:
- a) Immediately report the same to OIL.
 - b) Provide necessary first aid/medical assistance without any delay.
 - c) Report the same in the prescribed format as per statutory norms.
 - d) Investigate the matter & submit investigation report within 3 days.
 - e) Providing reliever crew in place of any injured person immediately.

Contractor shall be responsible for any pollution, accident (causing injury to man, damage to machinery) and clean-up operation due to pollution caused by the Contractor as a fall out of non-compliance of HSE rules & regulations. OIL's technical team shall investigate cause(s) of pollutions, accidents and/or any other non-compliance of HSE rules & regulations by the Contractor and the findings thereof shall be final. In this context, plant battery limit will not be applicable if the pollution caused by the Contractor inside the plant spills out of the plant boundary.

- vi) The Contractor shall be responsible for any unplanned circumstances / events in the plant within the Battery Limit that may take place due to material failure resulting from Contractor maintenance jobs. The Contractor shall also be responsible for failure of any equipment or any abnormality leading to subsequent unplanned circumstances / events due to lack of pro-active

maintenance. The cause(s) of such circumstances / events shall be investigated by OIL's technical team and finding thereof shall be final.

- vii) Mines Manager, Production (Oil) Mines may appoint one or more of the Contractor's personnel as competent person(s) for carrying out specific job(s) coming under the contract within a certain domain of authority. Contractor shall have to abide by the same. The authority of such competent persons shall, under no circumstances, supersede that of the Installation Manager of Moran Tank Farm. Appointment of the competent persons is not a pay-roll appointment-
- viii) All persons deployed at Moran Tank Farm by the Contractor must undergo Mines Vocational Training, Initial Medical Examination, Periodic Medical Examination and other requisite statutory trainings like but not limited to fire fighting training as per OMR & OISD-116/117, First Aid Training, Gas Testing Training etc.

The health check-up of Contractor's personnel is to be done by the Contractor in authorized Health Centres as per OIL's requirement and proof of such test(s) is to be submitted to OIL. The frequency of periodic medical examinations is every three years for all employees of the Contractor.

The Contractor shall submit to DGMS returns indicating – Name of his firm, Registration number, Name and address of person heading the firm, Nature of work, type of deployment of work persons, Number of work persons deployed, how many work persons hold Vocational Training (VT) Certificate, how many work persons undergone IME and type of medical coverage given to the work persons. The return shall be submitted quarterly (by 10th of April, July, October & January).

Contractor may take note of the fact that OIL provides some of the statutory training like MVT / First Aid / Fire Fighting etc. to Contractor's employees engaged by OIL near its Field Headquarter, Duliajan.

If OIL arranges any safety classes / training etc. for the working personnel at site the Contractor must arrange to release its personnel for any such training without hampering normal Operation jobs.

- ix) Every person deployed at the Tank Farm by the Contractor must wear all required safety gadgets / PPE items which are to be provided by the Contractor. No person will be allowed to work at Tank Farms without PPE.

The Contractor shall provide proper Personnel Protective Equipment as per the hazard identified and risk assessed for the job and conforming to statutory requirement and OIL's PPE schedule. Safety appliances like Safety Boots, Safety Helmet and Full Body harness have to be DGMS approved. Necessary supportive documents / approvals shall have to be submitted as proof.

If the Contractor fails to provide the safety items as mentioned above to the working personnel, the Contractor may apply to the Company (OIL) for providing the same. OIL will provide the safety items, if available. But in turn, OIL will recover the actual cost of the items by deducting from Contractor's Bill. However, it will be the Contractor's sole responsibility to ensure that all the persons engaged by him in the mines use the proper PPE while at work. All the safety gears mentioned above are to be provided to the working personnel before commencement of the work.

- x) The Contractor shall maintain First Aid Box with all the required and fresh batches of medicines and other items for use of his personnel in Moran Tank Farm. The contractor shall also possess other safety items like safety torches/lamp etc. as required for attending any maintenance jobs during night.
- xi) Contractor personnel shall also attend Fire Mock drills at both the Tank Farms as and when conducted by the operation team.
- xii) Contractor will provide all necessary support & co-operation if OIL decides to obtain HSE related certifications including but not limited to ISRS, ISO, and OHSAS at Moran Tank Farm.

All Contractor's employees must, while at work, cooperate with OIL so far as is necessary to enable compliance with any requirement under the act or the regulations that is imposed in the interest of employee's health, safety and welfare.

Any of the employees of the Contractor shall not refuse to follow any instruction given by OIL's Installation Manager or any competent person engaged by him for ensuring best maintenance practise.

- xiii) The Contractor must carry out all maintenance activities of any new equipment / facilities / instruments installed for compliance of any recommendation(s) of any statutory bodies or audits etc. during the currency of the contract. However any spares/consumable if required due to statutory addition shall be paid to the contractor at actuals.
- xvi) Contractor must carry out all maintenance activities in clean, safe and environmentally friendly ways; must avoid all sorts of pollution & contamination of the surrounding areas & environment.
- xiv) Contractor shall make available PPE for all of their employees to be deployed for maintenance jobs at Tank Farms. The list of PPE shall include following minimum types of items: a) SAFETY SHOE h) EYE GOGGLE b) SAFETY HELMET i) MASK c) DANGRI (OVERALL) j) BREATHER d) GUM BOOT k) RAIN COAT e) EAR PLUG l) APRON f) HAND GLOVES (Normal) m) JACKET g) HAND GLOVES (High Temperatures & chemical usage)

OIL will check the brands / qualities of the PPE items at site prior to issue of the PPE items to the Contractor's employees. The quality of the PPE shall have to be as per DGMS guidelines.

In case OIL finds any PPE items to be of inferior quality, torn &/or tattered the same shall not be allowed to be used by the Contractor at the Production Oil Mine of Tank Farm. The persons without PPE shall not be allowed to work at Tank Farm on any time of a day and **corresponding penalty against the SL no. 1 of Penalty Clause No. 9.0 will be applicable against the** inadequacy of contractor maintenance personnel shall be imposed on the Contractor.

OIL will ensure PPE-wearing only at worksites inside Tank Farm. PPE-wearing by Contractor's employees is not required during entering (and so exiting) the gate of Tank Farm.

- xv) Statutory aspects in regards to procurement of items & services: All spares, consumables and materials procured by the Contractor as per scope of this maintenance contract for Moran Tank Farm shall have necessary certification of Govt. approved agencies and approval of such statutory bodies as stipulated

vide provisions of Oil Mines Regulations, Indian Explosives Act, Indian Electricity Rules, Petroleum Rules etc. in force or byelaws / directives promulgated by Govt. circulars from time to time.

6.0 CONTRACTOR PERSONNEL:

i) All personnel to be deployed by the Contractor in different streams of work must have sound health, requisite qualifications, adequate experience in their respective fields as well as requisite competency as stipulated vide Indian Mines Act, Oil Mines Regulations & other byelaws, regulations & norms in force. The Contractor must warrant that all their employees shall perform the work correctly and efficiently and must ensure that such personnel observe all applicable statutory norms and safety requirement of OIL.

ii) Contractor shall submit all documents, Bio-data / Qualification / Experience-details / Credential/ Competence Level / Eligibility Certificates / Police Verifications / IME reports etc. and other relevant data of any prospective deployment at both the Tank Farms. Such personnel must not have any pending case against them in court of law / any pending police case or FIR against them. Any of the employees – officers or work staff – can work at the Tank Farm only after approval of OIL for such employees. If not approved by OIL, Contractor cannot employ any of its employees at Tank Farms. In regards to selection process of the Contractor for their potential employees to be deployed at the Tank Farms, OIL shall not have any role or say.

The cost - if any - on providing all the above initial documents / reports etc. (including but not limited to Initial Medical Examinations, IME) to OIL at the beginning of deployment of each prospective employee shall be responsibility of the Contractor.

The initial documents to be provided to OIL shall be applicable for any new/fresh employee to be deployed at Moran Tank Farm at any time during the currency of the contract.

Further, the Contractor shall be responsible for (carrying out Periodic Medical Examination (PME) and) providing OIL with PME reports of the employees on or before completion of 3 (three) years of working continuously at Moran Tank Farm.

iii) Even after initial deployment if at a later stage OIL finds any personnel of the Contractor to be unsuitable / undesirable to OIL and communicates to the Contractor in writing, the Contractor shall remove such personnel immediately from working at the Tank Farms as mentioned. In this case, the Contractor - entirely on their expense - shall promptly replace such personnel with alternative personnel acceptable to OIL.

iv) If Contractor wants to change any of their personnel deployed at any of the Tank Farm at any time, replacement for such employee(s) will be required in advance. New recruitment shall take over the responsibility after adequate training and familiarization prior to release of concerned persons. For new recruits, clauses 6.0 (i), (ii) & (iii) will be applicable.

v) Contractor shall be solely responsible throughout the period of the Contract for ensuring that all the Contractor's employees have requisite statutory trainings like but not limited to Fire Fighting Training as per OMR /OISD-116, MVT, First Aid, Gas Testing etc.

The Contractor must maintain its training-matrix records of its all employees and keep it updated at all times.

Absence of any requisite statutory trainings including but not limited to the above for any employee shall render that employee un-employable at Moran Tank Farm and clause no 6.0 (iii) above will be applicable.

OIL will provide the above mentioned trainings to all employees of the Contractor free of cost. But such training can be imparted to Contractor's personnel at OIL only during periods when OIL conducts these trainings and subject to availability of seats.

6.1 JOB REQUIREMENT AND QUALIFICATION OF KEY PERSONNEL

Contractor shall have a Maintenance Team comprising the following personnel for Moran Tank Farm:

A. OVERALL INCHARGE – 1 No.

Field Maintenance Managers- Graduate in Mechanical/Instrumentation/Electrical/Chemical Engineering having five years' experience in process industry including oil field experience

B. INSTRUMENTATION

(a) Instrumentation Engineers: 1 no. -Graduate in Instrumentation /Electronics /Electronics & Telecom with 3 years' experience in instrumentation systems including PLC/DCS/SCADA etc. of any process industry or Diploma in Instrumentation/ Electronics/ Electronics & Telecom with 5 years' experience in instrumentation systems including PLC/DCS/SCADA etc. of any process industry.

(b) Instrumentation Technicians: 2 nos. - Diploma with 3 years' experience or ITI with 5 years' experience in process instrumentation.

C. ELECTRICAL

(a) Electrical Engineers: 1 no. -Electrical Engineer must have minimum Degree in Electrical Engineering with minimum 3 years experience in petroleum/chemical /process plants. OR Diploma in Electrical Engineering with minimum 6 years experience in petroleum/chemical /process plants. The incumbent should be dynamic and have managerial skill to plan ahead and lead a team of experienced persons for carrying out day to day maintenance jobs. The person shall have overall responsibilities for safe & environment friendly operation & maintenance of all electrical equipment/items of the plant. He should be confident in independently carrying out fault finding analysis, rectification of fault, operation and routine/planned/breakdown maintenance of all the electrical equipment/ items of the plant including the air conditioners. **He must possess valid Electrical Supervisor's Certificate of Competency [minimum parts I, II, III, IV and preferably Part VIII-Mining Installations] issued by State Licensing Board, Assam or equivalent authority.** The Electrical Manager should be conversant with all statutory rules and regulations such as Indian Oil Mines Regulations (1984), Central Electricity Authority Regulations (2010), Mines Act, Mines Rules, Indian Electricity Act and various directives, rules and regulations of Statutory bodies like DGMS (India), OISD etc.

The Electrical Engineer shall be responsible for overall plant electrics including record keeping. He shall, with the help of his team, shall keep and maintain all statutory electrical records of the plant.

Apart from the electrics of the plant, the person shall be conversant with all the operation and maintenance activities of tank farm related to hazardous oil and gas processing, SCADA operation etc. The person shall be in constant touch with Company electrical engineer/representative. The Electrical Engineer shall normally attend general shift duty but shall be available for 24 hours.

Additionally, he must assist the Field Maintenance Manager in every possible way to run the plant smoothly, including the administrative activities of the plants and establishment.

(b) Electricians / Technicians: 2 nos.

Electricians / technicians shall be deployed to maintain the electrics of the plant as per the direction of Electrical Engineer. The electricians / technician shall be minimum an ITI certificate holder in electrical discipline having minimum 3 yrs. experience in the operation and maintenance of electrical equipment preferably in similar process industry. **The electricians / technician must possess valid Electrical Workman's Permit [minimum parts: 1 (Wiring), 2 (Motor-Generator)] issued by State Licensing Board or equivalent authority.**

The electricians / technician shall have good hands-on skill and experience with all kinds of electrical equipment/ items and if required, shall be able to attend and rectify electrical reports/ problems independently. They shall be at available round the clock for attending any breakdown job apart from the regular maintenance of the installation.

D. MECHANICAL:

(a) Mechanical Engineers: 1 no. -Graduate in Mechanical Engineering with 3 years' experience OR Diploma in Mechanical Engineering with 6 years experience in any process industry handling similar nature of job as mentioned in the clause no. 3.4 of TOR.

(b) Mechanical Fitters: 2 nos. -Diploma with 3 years' experience or ITI with 5 years' experience in maintenance of pumps/ pipe/ Valve fitting jobs in process industry/ Oil fields

(c) Mechanical Technician: 2 nos. -Diploma with 3 years' experience or ITI with 5 years' experience in maintenance of Diesel Engines/pumps/ pipe/ Valve fitting jobs in process industry/ Oil fields

E. SAFETY OFFICER: 1 no. Safety officer should be qualified Engineer with 3yrs experience in petroleum industry (handling similar nature of job as mentioned above) as a Safety Officer, along with Graduate in Mechanical Engg/Electrical/Instrumentation/Electrical/Chemical/Eletronics Engg/Fire& Safety Engg/Fire Tech. /Graduate in Science + 1yr. Diploma in Industrial Safety Engg./Fire & Safety Engg from an Institute recognized by State/Central Govt. The person shall by oneself or with the league of field maintenance manager / other ENGINEERS must carry out all S&E related jobs on priority basis so that the operator's all personnel are sensitized /

aligned to carry out the jobs as primary “MAINTENANCE” jobs. This officer shall ensure that all routine S&E related jobs coming at definite frequencies must be known to all in the morning rake-up / tool-box meeting. The person must be able to develop good file management / record keeping system.

F. HELPERS/CLEANERS: 6 nos.

Equipment/Machine cleaner –Matriculate and able to read and write English and communicate in local language.

Notes:

- 1) As per OMR Clause 16, Contractor shall appoint a number of competent persons including officials and technicians during each of the working shift. Such appointed persons shall be competent to perform the duties assigned to them. The person deployed shall be accorded prior approval from OIL.
- 2) In the absence of candidates with requisite quantum of experience, OIL reserves the right to approve substitute candidates temporarily up to maximum period of three months.

Note to Clause No. 6.1: The contractor must assess the jobs requirement as per scope of this maintenance contract and depute his maintenance team comprising adequate no of personnel accordingly without affecting planned/ unplanned jobs as per terms of this contract. Contractor failure to provide maintenance services because of inadequacy of manpower shall attract **penalty at the rate described under SL no. 14 of clause No. 9.0**

6.2 MISCELENOUS

- (i) Contractor shall plan for all preventive maintenance jobs as per OIL General Shift from 7:00 am to 3:30 pm. But Contractor maintenance personnel shall be available for attending any breakdown maintenance round the clock 365 days in a year.
- (ii) If OIL decides to take up any maintenance jobs beyond the scheduled maintenance jobs then requisite Contractor personnel shall attend those jobs. Here decision of the necessity of the person's presence is solely OIL's and Contractor has to abide by that decision.
- (iii) The Contractor will submit a list of engaged personnel and their deployment pattern including any change in the deployment pattern during the tenure of contract period. Contractor shall provide the Installation Manager, OIL with roster/ deployment pattern/attendance of all its employees on a monthly basis in the first three days of the month Failure to deploy the minimum Contractor personnel for maintenance jobs will attract **penalty at the rate described under SL no. 14 of clause No. 9.0**
- iv) The Contractor, before starting the work shall obtain a license from concerned authorities under the Contract Labour (Abolition and Regulation) Act 1970, and furnish a copy of the same to the Company. Contractor shall also be responsible for its validity and renewal and for complying with provisions of all applicable Act, Rules and Regulation in force at the locations of the site.
- v) The Contractor shall be solely responsible throughout the period of the Contract for providing all requirements of their personnel, including but not limited to their insurance, housing, medical services, messing, transportation

(both air and land transportation), vacation, salaries and all amenities, termination payment and taxes, if any, payable at no charge to the Company. The Contractor's crew personnel's shall arrange for their meal from their own, OIL shall not be responsible for providing any optional canteen facility.

- vi) The Contractor shall be responsible for maintaining the minimum maintenance team personnel as mentioned under clause no. 6.1 irrespective of their leave, sick, absence, retrenchment etc. The Contractor shall maintain his back up personnel with requisite qualification and experience as per this contract terms ready for replenishment the maintenance team for any of the above or any other unforeseen circumstances.

7.0 SPARE MANAGEMENT

- (i) All constituent serviceable parts and components of the equipment / facilities of Moran Tank Farm describes above under various above clauses are the spares required for their maintenances (day-to-day routine, scheduled/preventive and break-down maintenances) as well as for keeping them functional so as to continue their safe, trouble free and uninterrupted operations.
- (ii) Any equipment / part / component without which and/or without the replacement of which for any fault, a larger equipment / facility may become inoperative are also termed spares for this contract.
- (iii) All the components of PLC /TFMS/CCTV systems and their associated subsystems including field instruments are considered as spares under this contract.
- (iv) The total cost of spares for Moran Tank Farm as quoted by the bidder/contractor shall be incorporated in the price Schedule of Quantities (SOQ)-PART-II of this contract. It is presumed that the contractor's quoted price against cost of spares is all inclusive and this quoted price will be valid for the total duration of the contract.
- (v) Payment to the contractor against cost of spares shall be made on **COMPLETE MOBILIZATION OF SPARES** against respective categories (Electrical/Mechanical/Instrumentation/Rim Seal) as per SOQ-Section II of contract. If OIL decides to buy additional spares from the listed spares in the SOQ then the said spares to be provided at the quoted price of the particular along with the bid within 15 days from the date of issuance of Letter for Purchase as a part of this comprehensive maintenance contract. No extra cost will be paid to the Contractor/OEM/Authorized Dealer by OIL.
- (vi) The mandatory spares list mentioned elsewhere in this contract is indicative as per OIL's assessment and is for contractor's reference only. The contractor must manage existing spares, assess and add to his inventory of mandatory spares any other extra spares as required for the entire duration of this contract and can quote additionally along with the bid, which will be not the part of bid evaluation. Additional spares quoted by the Contractor will be purchased by OIL if OIL feels its requirement for a particular maintenance job.

- (vii) The contractor must handover the replaced items (Items/spares replaced by new ones as part of maintenance) to the Installation Manager.
- (viii) Procurement of spares and payment: The contractor shall procure spares preferably from OEM (Original Equipment Manufacturer).
- (ix) In case additional spare not listed in the above mandatory spares list (refer clause no. 3.1 to 4.0) for preventative/breakdown maintenance beyond the contract value of cost of spares, the contractor shall procure at its own cost as a part of comprehensive maintenance contract from OEM/ authorized dealer as desired by OIL based on the maintenance requirement. The contractor shall obtain minimum three quotations from three different vendors as per OIL's prevailing procurement process and purchase from the vendor quoting the lowest price. The contractor shall be paid the invoiced amount including base price of the item, taxes & duties as applicable, transportation charges on FOR Duliajan/Moran basis. Additionally the contractor shall be paid 5% on the base price of the invoiced items as handling & administrative charges.
- (x) Contractor shall obtain approval/permission/certificate from OIL indicating quantities make / brand / manufacturer's name etc. against each item before procurement of additional spares.
- (xi) OIL shall have the right to inspect contractor's inventory of mandatory spares from time to time.
- (xii) For procurement of items coming under petty expenses / local purchases / multi-brand etc., OIL's prevailing procurement process may not be required to be followed and operator can do off-the-shop purchases. But even in these cases also, approval / permission / certification as stated above and specific permission for such type of off-the-shop procurement must be taken from OIL.
- (xiii) Contractor shall maintain inventory of all spares at OIL's premises and stack the same in the Storage Godown as specified in Clause no. 3.8 with proper housekeeping on daily basis. The Contractor shall keep daily record of consumption & stock position and report the same to OIL on monthly basis &/or as & when asked by OIL. Projection of replenishment-requirement of these spares for initiation of procurement process shall be the responsibility of the contractor.
- (xiv) Contractor shall make available additional spares at Moran Tank Farm within maximum 48 hours of reporting of such requirement by OIL **failing which penalty shall be imposed as per SL No. 9 of Clause No.9.0.**
- (xv) The contractor must handover unused spares if any to the Installation Manager of Moran Tank Farm before closure/expiry of this contract.

8.0 Consumables: Necessary consumables required for maintenance of Instrumentation, Mechanical, Electrical, Information Technology, Clean Agent &

Air Conditioner Equipments/Systems except HSD, Lubricants, Gear oil & Coolants shall be under contractor's scope, **failing which penalty shall be imposed as per SL No. 9 of Clause No.9.0**

9.0 IMPOSITION OF PENALTY

Penalty shall be imposed on the operator for failure of the operator to do any job as per detail scope of work stated on different sub-clauses within clause no 2.4 to 2.10 and Clause no 5.1. Penalties are enlisted at serial number column.

Sl No.	Clause no	Reason of Penalty	Basis of penalty amount	Amount
1.	Safety Gadgets	Non availability of all required safety gadgets, tools & equipment.	Penalty equal to "One day Maintenance Charge/Week will be deducted until its compliance from the invoice of the particular month	One day Maintenance Charge/ week
2.	Fire Fighting maintenance	Contractor's Failure to carry out all types of Fire Fighting Eqpts. Maintenance as per Check list/ log-sheet/ maintenance schedules attached in the tender documents &/or to be provided by OIL.	i) Penalty equal to a day's salary of person concerned.	Rs 10,000 / day part thereof
3.	Mechanical maintenance	Contractor's Failure to carry out all types of Mechanical maintenance as per Check list/ log-sheet/ maintenance schedules attached in the tender documents &/or to be provided by OIL.	ii) Penalty equal to a day's salary of person concerned.	Rs 10,000 / day part thereof
4.	Electrical Maintenance	Contractor's Failure to carry out all types of Electrical maintenance as per Check list/ log-sheet/ maintenance schedules attached in the tender documents &/or to be provided by OIL.	i) Penalty equal to a day's salary of person concerned.	Rs 10,000 / day part thereof
5.	Instrumentation Maintenance	Contractor's Failure to carry out all types of Inst maintenance as per Check lists / log-sheets / maintenance schedules attached in tender documents &/or to be provided	i) Penalty equal to a day's salary of person concerned.	Rs 10,000 / day part thereof

		by OIL.		
6.	Clean Agent Maintenance	Contractor's Failure to carry out all types of Clean Agent maintenance as per Check lists / log-sheets / maintenance schedules attached in tender documents &/or to be provided by OIL.	ii) Penalty equal to a day's salary of person concerned.	Rs 10,000 / day part thereof
7.	Air Conditioning System Maintenance	Contractor's Failure to carry out all types of Air Conditioner maintenance as per Check lists / log-sheets / maintenance schedules attached in tender documents &/or to be provided by OIL.	iii) Penalty equal to a day's salary of person concerned.	Rs 10,000 / day part thereof
8.	Information Technology System Maintenance	Contractor's Failure to carry out all types of Information Technology maintenance as per Check lists / log-sheets / maintenance schedules attached in tender documents &/or to be provided by OIL.	iv) Penalty equal to a day's salary of person concerned.	Rs 10,000 / day part thereof
9.	Clause no. 3.0 to 8.0 Shortage of spare parts / consumable	i) Contractor's failure to manage / plan for procuring on behalf of OIL to maintain min inventory as given by OIL. ii) Contractor's failure to supply consumable under operator's scope of O&M	i) Penalty equal to handling charge / price of the item. ii) Subsequent loss to OIL due the shortage / lack of items. iii) Price of item and loss to OIL to be determined by OIL Tech Committee.	
10.	Clause no. 3.0 to 8.0 Improper b/down maintenance	i) Contractor's failure to do immediate & continuous b/down maintenance jobs. ii) Contractor's failure to engage adequate numbers of skilled /competent persons for break down maintenance jobs.	i) Penalty equal to a day's salary of person concerned.	Rs 20,000 /day

11.	Clause no. 3.0 to 8.0 Loss to OIL on a/c poor maintenance	i) OIL may incur loss due to under-performing of the plant resulting from Contractor's lack of routine &/or break down maintenance jobs.	i) Penalty on actual loss to OIL to be determined by OIL Technical Committee	
12.	Clause no. 3.0 to 8.0 Recovery on a/c OIL doing by self	i) OIL cannot wait for the Contractor's delayed start of maintenances and may do jobs on its own.	i) Penalty on actual expenses to be incurred by OIL to be determined by OIL Technical Committee	
13.	New item maintenance	i) Contractor's failure to do Maintenance on minor additional new equipment / unit etc requiring no extra man power burden.	i) To be determined by OIL Technical Committee.	
14.	Shortage of man-power	i) Contractor's failure to deploy minimum numbers of employees on each day. ii) Contractor's failure to submit daily attendance of their employees at the Tank Farm.	i) Penalty lumsum of Rs.15, 000/- will be deducted for each day of failure.	15,000/- INR (failure)
15	Failure of OEM's/Authorized Dealer's Service	Contractor's failure to inspect the equipments as listed in Clause no. 3.1 to 4.0 along with availing service of OEM/ Authorized dealer whenever required for smooth running of PLANT.	Penalty lumsum of Rs.20, 000/- each day will be deducted until it is complied.	Rs 20,000 /day

(PART-II)**1.00 DEFINITIONS AND INTERPRETATION**

- 1.01 "THE COMPANY / OWNER / OIL" means Oil India Limited, a Government of India Undertaking having its registered office at Duliajan, Assam. "THE CONTRACTOR / CONTRACTOR" means the successful bidder of this contract. "Act" means the all applicable laws;
- 1.02 "OMR" means Oil Mines Regulation 1984; and its subsequent ammendment
- 1.03 "Schedule" means a schedule appended to these regulations;
- 1.04 "Regional Inspector" means the inspector of mines in charge of the region or local area or areas in which the mine is situated or the group or class or mines to which the mine belongs, over which he exercises his power under the Act;

- 1.05 “Petroleum” means naturally occurring hydrocarbons in a free state whether in the form of natural gas or in a liquid, viscous or solid form but does not include helium occurring in association with petroleum;
- 1.06 “Gas” means the vapour state of the hydrocarbons occurring in, or derived from petroleum.
- A. “Gas free” means an environment in which the percentage of flammable gas does not exceed 20 percent of lower explosive limit of such gas.
- B. “Machinery means – I. any stationary or portable engine, pump, air or gas compressor, boiler or steam apparatus, or II. any such apparatus, vessels, appliance or combination of appliances intended for developing, processing, storing, transmitting, converting or utilizing energy, or III. any such apparatus, appliances or combination of appliances if any power developed, stored, transmitted, converted or utilized thereby is, under or intended for use in connection with mining operations.
- 1.07 “Toxic dust/gas” means any dust or gas which can cause a reversible or irreversible disturbance of the normal physiological processes of one or more bodily systems;
- 1.08 “Hazardous atmosphere” means an atmosphere containing any flammable gas in a concentration capable of ignition.
- 1.09 “Hazardous area” means an area where hazardous atmosphere exists or is likely to occur.
- 1.10 “zone one” hazardous area” means an area in which a hazardous atmosphere is likely to occur under normal operating conditions;
- 1.11 “zone two” hazardous area” means an area in which hazardous atmosphere is likely to occur only under abnormal conditions;
- 1.12 “Installation” means any fixed installation or part of a fixed installation which is maintained within the mine or is to be established there in connection with exploitation of petroleum or with a view to such exploitation.
- 1.13 The “Mines Manager” means the person appointed in writing by the owner or agent of the mine to be in charge of and responsible for all operations and activities of or in connection to the Mine.
- 1.14 “Installation Manager” means the person appointed in writing by the owner or agent of the mine to be in charge of and responsible for all operations and activities of or in connection to the installation.
- 1.15 “Competent person” means a person who is capable of identifying existing and predictable hazards in the surroundings of working conditions which are unsanitary or dangerous to work-persons and who has authorization to take prompt corrective measures to eliminate them.
- 1.16 “Official” means a person appointed in writing by the owner, agent or manager to perform duties of supervision in a mine or part thereof and includes installation manager, mines safety officer, fire officer, engineer (installation) and surveyor.
- 1.17 The “WORK” means and include all items to be supplied, things to be done and services to be provided and activities to be performed by the CONTRACTOR, pursuant to and in accordance with the CONTRACT, or part thereof, as the

case may be, and shall include all extra, additional, altered or substituted items/things/activities/services as required for purpose of the Operation of the plant at DESIRED PERFORMANCE LEVEL with due authorization from the Mines Manager or Installation Manager.

- 1.18 “CONTRACT” means the contract agreement signed for “Operation of the new facilities Post implementation MB LAI Committee Recommendations in the Central Tank Farm, Moran”.

“MORAN TANK FARM” means Moran tank Farm.

- 1.19 “DAY” means a day of 24 hours starting from morning 6 AM of the particular day to next morning 6 AM, irrespective of the number of hours worked in that day.

- 1.20 “WORKING DAY” means any DAY, which is not declared to be holiday or rest day by the OWNER.

- 1.21 “WEEK” means a period of any consecutive seven days.

- 1.22 “Quarter” means a period of three months ending on the 31st March, 30th June, 30th September or 31st December.

- 1.23 “DESIRED MAINTENANCE PERFORMANCE LEVEL” of the PLANT means trouble-free operation of the PLANT with stipulations explained under article PENALTY.

- 1.24 “Major Accident” means an occurrence including but not limited to, a major emission of fire or explosion from uncontrolled developments in the course of drilling and for production, storage, handling or transportation, processing of petroleum or machinery or owing to natural events leading to serious effects (both immediate and delayed as well as inside or outside the installation) causing or likely to cause substantial loss of life and property.

- 1.25 “District Magistrate” in relation to any mine means the District Magistrate or the Deputy Commissioner as the case may be, who is vested with the executive powers of maintaining law and order in the revenue district in which the mine is situated. In the case of a mine which is situated partly in one district and partly in another, the District Magistrate for the purposes of these regulations shall be the District Magistrate authorized in this behalf by the Central Government.

- 1.26 EMERGENCY means any happening which have immediate harmful affect involving threat to the installation, its surroundings and other installations and Govt/ public properties and/or its people resulting in disaster caused by major accident and/ or uncontrolled release of hydrocarbon from underground reservoir, natural calamities like flood, storm, earthquake etc.

- 1.27 Normal duty hours means from 7:00 AM to 3:00 PM on all working days.

- 1.28 “Standard and Sound Industry Practice” means Clean and safe environment in the entire plant some parameters of which but not limited to are Plant’s drains, OWS pits, office-buildings, sheds, facilities, engines,

machines, equipment, water reservoirs etc, each devoid of Oil spillage, dirt, filth, sludge, rubble, garbage , residue, high growth grass etc.

- 1.29 Effective date and Duration: This Agreement shall be effective from the Effective Date (being the date on which this Agreement is signed) and unless terminated

earlier pursuant to the provisions of this Agreement or the contract, shall continue in effect for the term of contract.

2.0 MOBILIZATION

- 2.1 Personnel's & Consumables:** Mobilization shall be deemed to be completed when the Contractor mobilizes along with its personnel and consumables to Moran Tank Farm along with the manpower ready in all respects to commence the work. The Contractor shall intimate the Company in writing of their readiness to commence work.

Company shall inspect the Contractor's manpower within 7 (Seven) days' of receipt of the Contractor's Notice of Readiness for Inspection

The mobilization is to be carried out within **30 days** from the receipt of Letter of Award (LOA). After inspecting the pre-requisites, Workorder will be issued to the contractor prior to start of job in the Tank Farm. The date of issue of workorder will be the date of commencement of contract.

If the Company fails to inspect the Contractor's Personnel's within 5 (five) days from the receipt of Notice of Readiness for Inspection, it shall be deemed to be mobilized.

- 2.2 Mandatory Spares:** Mobilization of the mandatory spares should completed within **60 days** from the date of issue of LOA.

Once the Contractor's spares have reached the Contractor's base camp at Moran and are ready to commence services, Contractor shall issue a Notice of Readiness for Inspection to the Company.

Company shall inspect the Contractor's spares a within 7 (seven) days' of receipt of the Contractor's Notice of Readiness for Inspection. After final inspection as per specification, the contract shall arrange for mobilization of the spares and godown to Tank Farm.

If the Company fails to inspect the Contractor's Equipment within 7 (Seven) days from the receipt of Notice of Readiness for Inspection, the Contractor's Equipments shall be deemed to be mobilized.

3.0 CONTRACTOR'S PERSONNEL

- 3.1** Except as otherwise hereinafter provided the selection, replacement, and engagement; Contractor shall determine remuneration of Contractor's personnel. Such employees shall be solely of Contractor's employees. Contractor shall ensure that its personnel will be competent and efficient. However, the Contractor shall provide details of experience, qualification and other relevant data of the personnel to be deployed for scrutiny and clearance by the company before the actual deployment. The Contractor shall not deploy its personnel unless cleared by the company.
- 3.2** Contractor shall provide all manpower for necessary supervision and execution of all work under this contract to company's satisfaction except where otherwise stated. The minimum number of key personnel to be deployed is mentioned in this document.
- 3.3** Replacement of Contractor's Personnel: Contractor will immediately remove and replace any Contractor's personnel, who in the opinion of company, is

incompetent, or negligent or of unacceptable behaviour or whose employment is otherwise considered by company to be undesirable.

- 3.4 Contractor shall deploy on regular basis, all category of their employee required for economic and efficient work servicing operations.

4.0 FOOD, ACCOMMODATION, TRANSPORTATION AND MEDICAL FACILITY AT FIELD INSTALLATIONS:

- 4.1 Contractor shall provide food and accommodation services for its Own/OEM's/Authorized Dealer's personnel.
- 4.2 Transportation of Contractor's/OEM's/Authorized Dealer's personnel from base camp to work place and back will be arranged by Contractor at his cost.
- 4.3 Medical Facilities: The Contractor shall arrange for medical facilities for their/OEM's/Authorized Dealer's personnel. However, OIL may provide services of OIL Hospital as far as possible in emergency on payment basis which shall be recovered from the quarterly bill(s) of the contractor.

5.0 CONTRACTOR'S ITEMS

- 5.1 Contractor shall provide equipment and personnel to perform the services under the contract as specified in this document.
- 5.2 Contractor will provide all consumables as specified in this document at Contractor's own cost.

6.0 CONDUCTING FIELD & OFFICE WORKS

- 6.1 The Contractor should have their base camp at Moran within 8 km radius of the tank farm.
- 6.2 The Contractor shall carry out all maintenance jobs mentioned hereunder with due diligence in a safe and workmanlike manner and in accordance with accepted International oilfield practices.
- 6.3 All the equipment and materials required for execution of the works under this contract shall be in good working condition. The company reserves the right to check the relevant certificates of the equipments, certifying the conditions of the equipment.
- 6.4 Contractor shall be solely responsible for the maintenance of the equipments as mentioned.

- 6.5 HEALTH, SAFETY & ENVIRONMENT (HS&E) MANAGEMENT:** The objective of safety management is to evaluate, monitor and communicate about the health, environment and safety of the Contractor workforce for an incident free work environment during operation of the contract. Oil India Limited has already devised a standard Performa (Part-V SM / Safety Measures of the tender document), which Contractor has to undertake regarding compliance of all safety measures while carrying out contractual job. Bidder/Contractor's HSE Policy shall cover all the points listed in Part-V SM / Safety Measures of the tender document and shall have to give undertaking to comply the same. A) OIL has also an HSE policy in place covering different applicable industry standards and regulations. Moreover the policy is guided by the statutory and Government directives.

- i) **HSE Drills, meeting etc:** The Party shall observe such HSE regulations in accordance with acceptable oilfield practice and applicable Indian Laws. The

Party shall take all measures reasonably necessary to provide safe & pollution free working conditions and shall exercise due care and caution in preventing fire, explosion or pollution. Party shall conduct such safety drills, Tool box meetings, etc. as may be required by company at prescribed intervals.

- ii) **Record Keeping, Documentation in connection with HSE :** Documentation, record keeping of all safety practices should be conducted as per international/Indian applicable laws, act, regulations etc, as per standard Oilfield practice and these records should be made available for inspection at any point of time. The H.S.E policy as well as emergency procedure manual / contingency plans for pollution control should be kept at site. Compliance of these shall be the sole responsibility of the Party.
- iii) **First Aid Kit:** An adequate and approved first aid kit shall be provided at work site with all medicines as per Rule 44(1) of Mines Rules 1955.
- iv) **CAMP AND OTHER ESTABLISHMENT:** Suitable camp facilities for Party's personnel including catering services shall be Party's responsibility.
- v) **STAND BY VEHICLE:** A standby vehicle with spark arrestor at the engine exhaust should be made available by the contractor at work site for emergency mobilization of personnel to hospital in case of injury/accident/medical emergency for their personnel's.

Note: The bidder shall submit an undertaking as per Part-V SM / Safety Measures of the tender document.

- 6.6 **Adverse Weather:** Contractor, in consultation with company, shall decide when, in the face of impending adverse weather conditions, to institute precautionary measures in order to safeguard the equipment and personnel to the fullest possible extent.

6.7 **Execution of Day-to-day Routine/Preventive / Break-down and Schedule maintenance and Corresponding penalties against non-execution of the maintenance jobs**

The Contractor shall do all types of maintenance jobs on any type of equipment / instrument / machine / unit / facility of the plant irrespective of scope of provisioning of the spares, consumables and other materials required thereon as described in SCC (Part-I) of the contract.

- i) After initial communication and subsequent acknowledgement of the contractor in regards to maintenance, in case of malfunctioning or under-performing or breakdown of any units of the plant that takes place at any time during the currency of this maintenance contract, the contractor needs to immediately report to OIL.

In case the contractor's claims any fault as above to happen at a time just prior to OIL's inspection of the plant on that day, OIL shall investigate the performance history of the unit and all related reports / records / documents as already furnished till that day by the contractor. No new reports etc shall be acceptable to OIL on that day. Contractor's claim as

above shall be judged as per findings based on already submitted reports etc by contractor. Penalty shall be imposed on operator if fault is found to start earlier as per **penalty clause no. 9.0.**

- ii) All day-to-day routine maintenance / servicing jobs and schedule / preventive maintenance jobs shall be carried out regularly by the contractor at their cost. The contractor shall carry out all routine maintenance / servicing jobs and schedule / preventive maintenance jobs of the plant in the most regular, meticulous and diligent ways.
- iii) The contractor must be able to identify any problems, wear & tear in parts / components etc of units / equipment etc which if not replaced immediately is likely to cause trouble in the functioning. The contractor shall have to promptly replace such items and follow the clause in regards to items used / replaced. The contractor must eventually be able to avoid breakdown or malfunctioning of any equipment, facilities, and units of plant.
- iv) OIL may decide to go for additional maintenance jobs on any of the units / equipment / facility of the Tank Farm over & above the scheduled ones. The contractor shall have to carry out the same and necessary spare for which shall be supplied by OIL from its inventory.
For all routine maintenances / servicing jobs, schedule / preventive maintenance jobs and also for breakdown maintenances / major repairs etc the contractor shall have to carry out all required workshop jobs like but not limited to jobs of various machining operations, milling, drilling, boring, reaming, grinding, lapping, press-fitting, shrink-fit assembly, expanded fit assembly, dismantling, assembling-disassembling etc. Further the operator shall have to be equipped with all required tools & tackles and other equipment. These include but not limited to items like wrenches, tongs, hammers, chisel, dies, all tools (non sparking) necessary for attending routine and breakdown maintenance of electrics, instrumentation and control system; temperature guns for machine-temperatures; hydraulic pullers of sufficient ratings, tripods & chain pulleys of required ratings, maintenance tool boxes, tool kit-sets, tube expander etc for all maintenance jobs.
- v) All routine maintenance / servicing jobs and schedule / preventive maintenance jobs shall have to be properly documented / recorded and reported to OIL on real time basis. Absence of records & reporting to OIL, contractor's claim on doing the jobs will not hold good. Reports submitted at a later date shall not be accepted.
- vi) The maintenance history of equipments/units shall have to be maintained for each of the equipment/unit by the contractor and such maintenance history/records should be signed by the contractor and submitted to the IM of Tank Farm for future reference.
- vii) Should the contractor fail to start any jobs as above in professional manner and with full man-power strength due to any reasons including but not limited to the reason of shortage / lack of spares, consumables and replacements falling under the scope of the contractor to do the purchasing process, the contractor shall be fully responsible and accountable. Penalty will be imposed on the operator as per **Penalty Clause numbers-9.0** as the case may be.

- viii) Any one or more of these **penalties listed in clause no. 09** shall be applicable which may lead to malfunctioning, underperforming or shutdown / breakdown of any unit, equipment, facility of Tank Farm.
- ix) The contractor's performance or the lack of it in doing routine & schedule maintenance jobs shall be determined from reports / records / documents etc regarding all servicing & maintenance jobs and regarding all used spare parts & consumables used on a particular unit or equipment.
- x) In case of breakdown or malfunctioning or under-performing of any equipment, the contractor needs to immediately report the same to OIL.
- xi) Simultaneously, the contractor must immediately start break-down maintenance jobs for restoring the unit at their cost and/or must replace any such break-down unit(s) within the shortest time avoiding interruption or under-performance of the plant.
- xii) Breakdown maintenance job as above shall be done with professional workmanship and continuously in all the shifts in all days without gap with skilled and adequate man-power strength. For that, the contractor shall arrange its maintenance gang. Presence of Key personnel during the maintenance job will be required.

Man power of operator should be competent & sufficient for carrying out such jobs as **per clause no. 6.0.**

- xiii) Requirement of OEM or their authorized dealers for Annual Maintenance Contracts (AMCs) / Warranties of their respective equipment shall be an issue of the contractor of their own. In case, the contractor decides for bringing OEM or their authorized dealers for any job at Tank Farms the same needs to be endorsed by OIL on immediate basis. The responsibility for the maintenance service shall entirely rest with the contractor in case of any failure to do so. Failure of the same shall not be acceptable. OIL's endorsement will only be for allowing the contractor to employ the OEMs / authorized dealer on their behalf.

Contrarily, if the contractor decides to send any equipment / unit etc to OEM's workshop for maintenance, same needs to be endorsed by OIL. In such cases standby arrangement shall have to be provided by the contractor without extra charge.

Contractors failure to return the unit/equipment to OIL after such repair/rectification within 20 days shall attract **Penalty as per clause no. 9.0.** Such rectified unit/equipment shall have to be presented by the contractor to OIL for inspection before placement of the same.

- xiv) If OIL finds the contractor's delay in starting required maintenance job detrimental to the plant or its operation, OIL shall carry out the job on its own but the financial implications in regards to cost of OIL's repair-activities will be recovered from monthly bills/Performance Bank Guarantee. This is deemed as **per Penalty Clause number-9.0.** OIL shall intimate the contractor prior to start of the jobs.
- xv) In case of any maintenance jobs that requires civil/mechanical/electrical/instrumentation assistance, the same will be under the contractor's scope.

- xvi) In case of breakdown of any major equipment and requirement of transferring it to the IC workshop or any workshop for repairing all necessary arrangement viz. Lifting, transportation, packing etc. should be provided by the contractor.

6.8. Services of OEM (For Clause no. 3.0 to 4.0 in SCC (Part-I)):

The contractor is under the binding to inspect all the equipment/units by the representative of OEM not less than Service Manager or authorized Engineer twice in a year under normal circumstances. Certificates of Inspection shall have to be deposited to OIL after completion of each inspection immediately.

In case of any major breakdown where the contractor's crew are unable to rectify the defects within 48 hours of occurrence of such breakdown, the contractor is liable to provide the services of OEM to repair/rectify such defects.

Should the contractor feels the requirement of OEM's services it may do so at any point of time during the tenure of the contract. No additional charges for availing the above services/certification etc. shall be paid by the OIL to the contractor/OEM/authorized dealer.

Any issues related to OEM/authorized dealer with the contractor shall not be the responsibility of OIL.

Failure to comply the above requirements as stated shall attract **Penalty as per clause no. 9.0**

7.0 CONTRACTOR'S SPECIAL OBLIGATIONS

- 7.1 It is expressly understood that Contractor is an independent party/Contractor and that neither it nor its employees are employees or agents of company provided, however, company is authorized to designate its representative, who shall at all times have access to the equipment and materials and all records, for the purposes of observing, inspecting and designating the work to be performed hereunder by Contractor. The Contractor may treat company's representative as being in charge of company's designated personnel. The company's representative may, amongst other duties, observe, test, check and control implementation of equipment and inspect works performed by Contractor or examine records kept by Contractor.
- 7.2 Compliance with Company's Instructions: Contractor shall comply with all instructions of Company consistent with the provision of this Contract, but not limited to work programme, safety instructions, confidential nature of information, etc. Such instructions shall, if Contractor request, be confirmed in writing by company's representative.
- 7.3 Confidentiality of Information: All information obtained by Contractor in the conduct of operations hereunder shall be considered confidential and shall not be divulged by Contractor or its employees to anyone other than company's representative. This obligation of Contractor shall be in force even after the termination of the Contract.
- 7.4 Contractor shall arrange for inland transportation of all equipment, etc. from the port to the place of work and back at the end of the work at their own expense. Arrangement of Road Permits and payment of Assam Entry Tax for bringing equipment/material to Work place shall be Contractor's responsibility.
- 7.5 Contractor must observe all safety and statutory norms applicable to the Company to prevent surface pollution and injury to Contractor's personnel

working in the area and provide medical facilities to Contractor's injured persons if any due to accident / take corrective measures in case of pollution as per the company's instructions.

8.0 Loss or Damage of Contractor's equipment Except as otherwise specifically provided in the contract, any damage to or loss, of tools/equipment regardless of the cause or reason for said loss, shall be the loss of the Contractor, its underwriters or insurers. Contractor indemnifies OIL, its Co-licensees and its and their affiliates Companies, Agents, employees, invitees, servants, their underwriters or insurers (other than Contractor's) and their employees, agent any claim whatsoever or responsibility for any damage to or loss the equipment or property of Contractor furnished or intended for use in the operations herein undertaken.

9.0 Loss or Damage of OIL'S EQUIPMENT/PROPERTY: Contractor shall assume the risk of and shall be solely responsible for, damage to and loss or destruction of materials and equipment or supplies furnished by OIL. In case there is a loss or damage to OIL's equipment/property for causes attributable to Contractor, the Contractor shall compensate OIL adequately.

10.0 Pollution and contamination: Notwithstanding anything to the contrary contained herein, it is agreed that the responsibility and liability for pollution or contamination shall be as follows:

Contractor shall assume all responsibility and liability for cleaning up and removal of pollution or contamination which originates above the surface.

10.0 DISCIPLINE: The Contractor shall maintain strict discipline and good order among their employees and shall abide by and conform to all rules and regulations promulgated by the Company. Should the Company feel with just cause that the conduct of any of the Contractor's personnel is detrimental to Company's interests; the Company shall notify Contractor in writing the reasons for requesting removal of such personnel. The Contractor shall remove and replace such employees at their expense within 7 days from the time of such instruction given by the Company.

11.0 Powers and Duties of OIL In no other circumstances, OIL's obligations cover any other matter(s) not stated below:

- i) OIL shall appoint, as per provisions of the Oil Mines Regulations 1984 (OMR) and its subsequent amendment if any, a Mines Manager, an Installation Manager or his representative, Competent Person(s) for safe operation of the plant as per sound industry practice.
- ii) The Installation Manager, Mines Manager or his representative will be solely responsible for all decisions regarding safe operation and up to date maintenance of the installation. Installation Manger, Mines Manager or his representative will also be responsible for maintenance of water disposal wells connected to the installation.
- iii) Subject to the provisions of the contract, OIL promptly pay and discharge the costs arising out of maintenance of the plant/facilities, reimbursement of other jobs as per provisions of the payment terms of the contract.
- iv) OIL shall deduct penalty amount from bills of the Contractor in case the Contractor fails to carry out any job as mentioned in the Contract document.

- v) The Contractor will be following all the instructions as decided by the Installation Manager, Mines Manager or his representative for safe operation of the plant/facilities, as per the scope of work covered under clause no 3.1 to 3.8 of Section-I under Part-I (SCC). For any decision regarding safe operation of the plant, the decision of Installation Manager, Mines Manager or his representative will be final & binding which must be strictly complied with by the Contractor unless such decisions are contrary to the provisions of the contract.
 - vi) OIL will have to finally give consent to appointment of any work personnel in the capacity of officers or work-staff for working at Tank Farms under the contract. Contractor must hand over all documents about their potential employees to be deployed at Tank Farms regarding personal details, educational background, other credentials etc. before actual appointment. OIL does not have any part or say on the selection procedures of employees of the Contractor. However, on receipt of all documents as above OIL has the right to reject / disallow any such employees to work at Tank Farms. This clause is applicable in conjunction with Man power clause no 6.0 of Section-I under Part-I (SCC).
 - vii) The Installation Manager, Mines Manager or his representative shall have the authority to promptly take action regarding removal of any person working inside the plant from his workplace for negligence of duty, violation of safety norms as per Mines Act or OMR, HSE policy of OIL and wilful insubordination of any legitimate order of the Installation Manager, Mines Manager or his representative regarding operation of the plant. Such decisions will be in consultation with representative(s) of the Contractor and are applicable in conjunction with Man power clause no 6.0 of Section-I under Part-I (SCC).
 - viii) The Installation Manager, as per provisions of the OMR, will visit the installation once in every working day and the authorised representative of the Contractor will be physically present during the regular visit of the Installation Manager to the Installation. In case of any operational emergency when the authorised representative of the Contractor leaves the installation during the visit of the Installation Manager, the prior intimation for the same should be made in advance to the Installation Manager and the name of the authorised in-charge representative(s) shall be made known to the Installation Manager in writing.
 - ix) OIL shall make available Electricity free of cost for “MAINTENANCE” jobs of the plant/facilities from OIL’s captive power plant at a New Switch Room inside the plant boundary.
- 12.0** Contractor should ensure that there is no pollution either of water, air or sound during the operation of the new facilities under the MB Lal project. Contractor should be more careful and checked for any leakage and immediate corrective action to be taken for such leakages to avoid any pollution problems. Contractor should inform such leakages immediately to the Company’s Representative.
- 13.0** The Contractor shall not make Company liable to reimburse the Contractor to the statutory increase in the wage rates of the contract labour appointed by the Contractor. Such statutory or any other increase in the wage rates of the contract labour shall be borne by the Contractor.

14.0 LABOUR LICENSE: The Contractor, before starting the work shall obtain a license from concerned authorities under the Contract Labour (Abolition and Regulation) Act 1970, and furnish a copy of the same to the Company. Contractor shall also be responsible for its validity and for complying with provisions of all applicable Act, Rules and Regulation in force at the locations of the site.

15.0 The Contractor shall not engage labour below 18 (eighteen) years of age under any circumstances. Persons above 60 years age also shall not be deployed. Moreover, the Contractor should obtain and produce in advance before commencement of work, the following certificate / approvals:

- (i) Total manpower list
- (ii) All certificates as per applicable laws including Mines Acts.
- (iii) Regional Labour certificate, if required.

16.0 Additional expenses due to fault of the Contractor: In case additional expenses are incurred due to failure of system / process/ equipment / general infrastructure of the plant/ facilities, pipeline network and disposal wells on account of wrong operation / wrong maintenance / wrong handling/ poor workmanship / use of incompetent manpower/ lack of supervision/ lack of co-ordination/ wilful insubordination of Operating instruction by the person or group of persons engaged by the Contractor, the Contractor will bear all such expenses. The Contractor will commence necessary rectification/ modification required to rectify such failures.

17.0 Additional expenses on OIL for design modification required at the plant:

For any modification in design or addition of new equipment or infrastructure which is required for some additional requirements felt by OIL during the currency of the "MAINATENANCE" contract, the cost will be borne by OIL, unless otherwise the modification/ addition is required to rectify poor workmanship of the Contractor during operation.

18.0 The Bidder/Contractor understands that minimum wages may increase from time to time as notified by statutory authority and undertakes that Contractor shall not make Company liable to reimburse Contractor for such statutory increase in wage rates of the labours/workers appointed by the Contractor during the entire period of the contract, including extension if any. Currently, such increase in the wage rates is twice in a year. Bidder shall bid after considering this increase in wage rates for the entire period of Contract including extension provision. The Contractor further undertakes that he/she/they will pay his/her/their workers the increased wages as notified by Govt. of India under the Minimum Wages Act from time to time and such statutory or any other increase in the wages rates of contract labour deployed by the Contractor shall be borne solely by the Contractor during the entire period of the contract, including extension if any, without any cost implication whatsoever upon the Company.

19.0 CUSTOMS DUTY

19.1 In terms of Sl. No. 404 of the Customs Notification No.50/2017-Cus dated 30.06.2017, imports of the items specified in List 33(CONDITION NO. 48)of the Notification are subject to levy of concessional rate of customs duty @5% (BCD Nil & IGST@5%)subject to conditions specified therein (Condition No.48).

However, this is subject to change as per Government guidelines and the provisions ruling at the time of tender closing will be applicable.

Similarly, the domestic supply of such goods would attract 5% GST (i.e. IGST or CGST & SGST/UTSGT) on submission of EC in terms of GST Notification No.03/2017.

- 19.2 Contractor shall provide the list of items to be imported by them under the Contract in the format specified in Proforma-A along with their bid for issuance of Recommendatory Letter to DGH. Contractor shall make written request to Company immediately after shipment of the goods indicated by them in Proforma-A, along with the Invoices and all shipping documents (with clear 15 working days' notice) requesting Company for issuance of the Recommendatory Letter. OIL shall issue the Recommendatory provided all the documents submitted by the Contractor are found in order as per contract. It shall be however, Contractor's responsibility to obtain EC from DGH and clear the goods through customs. OIL shall not be liable in whatsoever manner for the rejection of their claims for zero customs duty by any of the authorities including DGH arising solely as a result of any default on the part of the Contractor.
- 19.3 All imports and import clearances under the contract shall be done by the contractor and OIL shall not provide any assistance in this regard.
- 19.4 However, in the event customs duty becomes leviable during the course of contract arising out of a change in the policy of the Government, Company shall be liable for payment of the customs duties leviable in India on Contractor's items as provided in Proforma-A or the actual whichever is less (for the first time import) and at actuals (for subsequent imports), provided Contractor furnishes all necessary documents indicating the estimated customs duty at least 10 days in advance. Such payment of Customs Duty shall be arranged by Company and made available to the representatives of Contractor at Kolkata within 3 working days after Contractor submits the undisputed and clear necessary documents / duty assessment papers at Company's office at Kolkata. Contractor would be responsible for passing such payment to customs authorities at the port of entry. Company's obligation for Customs Duty payment shall be limited / restricted to the tariff rates as assessed by the Customs on the day of clearance, or as on the last day of the stipulated mobilization period. In case of clearance thereafter, on the CIF value of items in Proforma-A will be frozen and any increase in Customs Duty on account of increase in value on these will be to the Contractor's account. Furthermore, in case the above CIF value is not acceptable to assessing Customs Officer and as a result if any excess Customs Duty becomes payable, it shall be to Contractor's account. Before filing Bill of lading, Bill of entry, the Contractor must consult the Company to avoid payment of excess Customs Duty.
- 19.4.1. Contractor shall, however, arrange clearance of such items from Customs and port authorities in India and shall pay all requisite demurrages, if any, clearance fees/charges, port fees, clearing and forwarding agent fees/ charges, inland transport charges etc. Company shall provide all assistance by issuance of necessary letter of authority or other relevant documents and necessary help.

- 19.4.2. Notwithstanding what is stated above, the bidders should also consider the position in regard to import of goods as specified in list No. 33 of above notification against concessional rate of 5% Customs Duty. OIL is not liable in whatsoever manner, for the rejection of their claims for concessional rate of 5% Customs Duty by any of the authorities including the DGH.
- 19.4.3. The bidder while quoting would need to consider the duty drawback as per notification No. 23/2008 dated 01.03.2008 available to them upon re-export of the equipment, if any. The bidder should also note that input tax credit would also be available to them on the IGST paid by them excluding duty drawback and this aspect should also be considered by them while quoting their rates.
- 19.4.4. Similarly, such specified goods required for petroleum operations if procured from domestic sources would attract 5% concessional GST (IGST or CGST & SGST/UTGST) as per notification no. 3/2017 dtd. 28.06.2017 against issuance of EC by DGH for which OIL shall issue the recommendatory letter.
- Note: The recommendatory letter will be given only for those items which are either consumed during the execution of work or for those equipment/tools which are undertaken to be re-exported by the bidder. The recommendatory letter will not be issued when the bidder imports the equipment/tools on acquisition basis and does not undertake to re-export the same after the completion of the contract.***
- 19.5 Contractor must ensure that the spares and consumables imported by them for providing the services under Contract are properly used in executing their job under the Contract in the PEL/ML areas of Company for which EC has been obtained. Contractor shall furnish to Company a certificate as and when the spares and consumables are used/consumed certifying that the spares and the consumables imported by them have been consumed in those ML and PEL areas under the contract for which ECs were obtained by them. In order to avoid any misuse of the spares and consumables imported by the Contractor for providing the services under the Contract, Contractor shall furnish an Undertaking similar to that being furnished by Company to Customs of suitable amount before issue of the Recommendatory Letter.

PROFORMA-A**LIST OF ITEMS (Equipment, Tools, Accessories, Spares & consumable)****TO BE IMPORTED INCONNECTION WITH EXECUTION****OF THE CONTRACT SHOWING CIF VALUE**

Srl #	Item Description	Qty /Unit	Rate	Total	Freight & Insurance	CIF Value	Port & other charge	Landed Cost	Is it re-exportable? YES or NO	Year of Mfg.	HSN Code
A	B	C	D	E = C x D	F	G = F + E	H	I = G+H	J	K	L

- (1) The items which are not of consumable in nature and required to be re-exported outside India after completion of the Contract should be indicated as "YES" in column "J".
- (2) The items, which are of consumable in nature should be indicated as "NO" in column "J".
- (3) For estimation of applicable customs duty, the bidders are required to indicate customs tariff code (i.e. HSN Code) of each item in column "L".

Authorised Person's Signature: _____

Name: _____

Seal of the Bidder:

**To,
CGM (CONTRACTS)
OIL INDIA LIMITED
DULIAJAN-786602**

SUB: SAFETY MEASURES

Description of service: Hiring of services for Comprehensive Annual Maintenance Contract (CAMC) for the new facilities installed post M B Lal Committee recommendations in Moran Tank Farm for a period of 2 (two) years extendable by 1 (one) year.

Sir,

We hereby confirm that we have fully understood the safety measures to be adopted during execution of the above contract and that the same have been explained to us by the concerned authorities. We also give the following assurances.

a) Only experienced and competent persons shall be engaged by us for carrying out work under the said contract.

b) The names of the authorized persons who would be supervising the jobs on day to day basis from our end are the following:

i) _____

ii) _____

iii) _____

The above personnel are fully familiar with the nature of jobs assigned and safety precautions required.

c) Due notice would be given for any change of personnel under item (b) above.

d) We hereby accept the responsibility for the safety of all the personnel engaged by us and for the safety of the Company's personnel and property involved during the course of our working under this contract. We would ensure that all the provisions under the Oil Mines Regulations, 1984 and other safety rules related to execution of our work would be strictly followed by our personnel. Any violation pointed out by the Company's Engineers would be rectified forthwith or the work suspended till such time the rectification is completed by us and all expenditure towards this would be on our account.

e) We confirm that all persons engaged by us would be provided with the necessary Safety Gears at our cost.

f) All losses caused due to inadequate safety measures or lack of supervision on our part would be fully compensated by us and the Company will not be responsible for any lapses on our part in this regard.

g) We shall abide by the following HSE (Health, Safety & Environmental) POINTS:

GENERAL HEALTH, SAFETY & ENVIRONMENT (HSE) POINTS:

1. It will be solely the Contractor's responsibility to fulfill all the legal formalities with respect to the Health, Safety and Environmental aspects of the entire job (namely; the person employed by him, the equipment, the environment, etc.) under the jurisdiction of the district of that state where it is operating. Ensure that all sub-contractors hired by him comply with the same requirement as the contractor himself and shall be liable for ensuring compliance all HSE laws by the sub or sub-sub contractors.
2. Every person deployed by the contractor in a mine must wear safety gadgets to be provided by the contractor. The Contractor shall provide proper Personnel Protective Equipment as per the hazard identified and risk assessed for the job and conforming to statutory requirement and company PPE schedule. Safety appliances like protective footwear, Safety Helmet and Full Body harness has to be DGMS approved. Necessary supportive document shall have to be submitted as proof. If the Contractor fails to provide the safety items as mentioned above to the working personnel, the Contractor may apply to the Company (OIL) for providing the same. OIL will provide the safety items, if available. But in turn, OIL will recover the actual cost of the items by deducting from Contractor's Bill. However, it will be the Contractor's sole responsibility to ensure that the persons engaged by him in the mines use the proper PPE while at work. All the safety gears mentioned above are to be provided to the working personnel before commencement of the work.
3. The Contractor shall prepare written Safe Operating Procedure (SOP) for the work to be carried out, including an assessment of risk, wherever possible and safe methods to deal with it/them. The SOP should clearly state the risk arising to men, machineries & material from the mining operation/operations to be done by the contractor and how it is to be managed.
4. The contractor shall provide a copy of the SOP to the person designated by the mine owner who shall be supervising the contractor's work.
5. Keep an up to date SOP and provide a copy of changes to a person designated by the Mine Owner/Agent/Manager.
6. Contractor has to ensure that all work is carried out in accordance with the Statute and SOP and for the purpose he may deploy adequate qualified and competent personnel for the purpose of carrying out the job in a safe manner. For work of a specified scope/nature, he should develop and provide to the mine owner a site specific code of practice in line.
7. All persons deployed by the contractor for working in a mine must undergo Mines Vocational Training, initial medical examination, PME. They should be issued cards stating the name of the contractor and the work and its validity period, indicating status of MVT, IME & PME.
8. The contractor shall submit to DGMS returns indicating - Name of his firm, Registration number, Name and address of person heading the firm, Nature of work, type of deployment of work persons, Number of work persons deployed, how many work persons hold VT Certificate, how many work persons undergone IME and type of medical coverage given to the work persons.

9. The return shall be submitted quarterly (by 10th of April, July, October & January) for contracts of more than one year. However, for contracts of less than one year, returns shall be submitted monthly.
10. It will be entirely the responsibility of the Contractor/his Supervisor/representative to ensure strict adherence to all HSE measures and statutory rules during operation in OIL's installations and safety of workers engaged by him. The crew members will not refuse to follow any instruction given by company's Installation Manager/Safety Officer /Engineer/Official/Supervisor/Junior Engineer for safe operation.
11. Any compensation arising out of the job carried out by the Contractor whether related to pollution, Safety or Health will be paid by the contractor only.
12. Any compensation arising due to accident of the Contractor's personnel while carrying out the job, will be payable by the contractor.
13. The contractor shall have to report all incidents including near miss to Installation Manager/departmental representative of the concerned department of OIL.
14. The contractor has to keep a register of the persons employed by him/her. The contractor's supervisor shall take and maintain attendance of his men every day for the work, punctually.
15. If the company arranges any safety class/training for the working personnel at site (company employee, contractor worker, etc) the contractor will not have any objection to any such training.
16. The health checkup of contractor's personnel is to be done by the contractor in authorized Health Centers as per OIL's requirement & proof of such test(s) is to be submitted to OIL. The frequency of periodic medical examinations should be every five years for the employees below 45 years of age and every three years for employees of 45 years of age and above.
17. To arrange daily tool box meeting and regular site safety meetings and maintain records.
18. Records of daily attendance, accident report etc. are to be maintained in Form B, E, J (as per Mines Rules 1955) by the contractor.
19. A contractor employee must, while at work, take reasonable care for the health and safety of people who are at the employee's place of work and who may be affected by the employee's act or omissions at work.
20. A contractor employee must, while at work, cooperate with his or her employer or other persons so far as is necessary to enable compliance with any requirement under the act or the regulations that is imposed in the interest of health, safety and welfare of the employee or any other person.
21. Contractor's arrangements for health and safety management shall be consistent with those for the mine owner.

22. In case Contractor is found non-compliant of HSE laws as required company will have the right for directing the contractor to take action to comply with the requirements, and for further non-compliance, the contractor will be penalized prevailing relevant Acts/Rules/Regulations.

23. When there is a significant risk to health, environment or safety of a person or place arising because of a non-compliance of HSE Measures Company will have the right to direct the contractor to cease work until the non-compliance is corrected.

24. The contractor should prevent the frequent change of his contractual employees as far as practicable.

25. The contractor should frame a mutually agreed bridging document between OIL & the contractor with roles and responsibilities clearly defined.

26. For any HSE matters not specified in the contract document, the contractor will abide the relevant and prevailing Acts/rules/regulations/pertaining to Health, Safety and Environment.

(Seal)

Yours Faithfully

Date_____

M/s_____

FOR & ON BEHALF OF CONTRACTOR

INTEGRITY PACT

Between

Oil India Limited (OIL) hereinafter referred to as "The Principal"

And

(Name of the bidder).....hereinafter referred to as "The Bidder/Contractor"

Preamble:

The Principal intends to award, under laid down organizational procedures, contract/s for **Hiring of services for Comprehensive Annual Maintenance Contract (CAMC) for the new facilities installed post M B Lal Committee recommendations in Moran Tank Farm for a period of 2 (two) years extendable by 1 (one) year.** The Principal values full compliance with all relevant laws and regulations, and the principles of economic use of resources, and of fairness and transparency in its relations with its Bidder/s and Contractor/s.

In order to achieve these goals, the Principal cooperates with the renowned international Non-Governmental Organization "Transparency International" (TI). Following TI's national and international experience, the Principal will appoint an external independent Monitor who will monitor the tender process and the execution of the contract for compliance with the principles mentioned above.

Section: 1 - Commitments of the Principal

(1) The Principal commits itself to take all measures necessary to prevent corruption and to observe the following principles:

1. No employee of the Principal, personally or through family members, will in connection with the tender for, or the execution of a contract, demand, take a promise for or accept, for him/herself or third person, any material or immaterial benefit which he/she is not legally entitled to.
2. The Principal will, during the tender process treat all Bidders with equity and reason. The Principal will in particular, before and during the tender process, provide to all Bidders the same information and will not provide to any Bidder confidential/additional information through which the Bidder could obtain an advantage in relation to the tender process or the contract execution.
3. The Principal will exclude from the process all known prejudiced persons.

(2) If the Principal obtains information on the conduct of any of its employees which is a criminal offence under the relevant Anti-Corruption Laws of India, or if there be a Page 2 of 6 substantive suspicion in this regard, the Principal will inform its Vigilance Office and in addition can initiate disciplinary actions.

Section: 2 - Commitments of the Bidder/Contractor

(1) The Bidder/Contractor commits itself to take all measures necessary to prevent corruption. He commits himself to observe the following principles during his participation in the tender process and during the contract execution.

1. The Bidder/Contractor will not, directly or through any other person or firm, offer, promise or give to any of the Principal's employees involved in the tender process or the execution of the contract or to any third person any material or immaterial benefit which he/she is not legally entitled to, in order to obtain in exchange any advantage of any kind whatsoever during the tender process or during the execution of the contract.

2. The Bidder/Contractor will not enter with other Bidders into any undisclosed agreement or understanding, whether formal or informal. This applies in particular to prices, specifications, certifications, Subsidiary contracts, submission or non-submission of bids or any other actions to restrict competitiveness or to introduce cartelization in the bidding process.

3. The Bidder/Contractor will not commit any offence under the relevant Anticorruption Laws of India; further the Bidder/Contractor will not use improperly, for purposes of competition or personal gain, or pass on to others, any information or document provided by the Principal as part of the business relationship, regarding plans, technical proposals and business details, including information contained or transmitted electronically.

4. The Bidder/Contractor will, when presenting his bid, disclose any and all payments he has made, is committed to or intends to make to agents, brokers or any other intermediaries in connection with the award of the contract.

(2) The Bidder/Contractor will not instigate third persons to commit offences outlined above or be an accessory to such offences.

(3) The Bidder/Contractor signing Integrity Pact shall not approach the Courts while representing the matters to IEMs and he/she will await their decision in the matter.

Section 3 - Disqualification from tender process and exclusion from future Contracts

If the Bidder, before contract award has committed a transgression through a violation of Section 2 or in any other form such as to put his reliability or credibility as Bidder into question, the Principal is entitled to disqualify the Bidder from the tender process or to terminate the contract, if already signed, for such reason.

1. If the Bidder/Contractor has committed a transgression through a violation of Section 2 such as to put his reliability or credibility into question, the Principal is entitled also to exclude the Bidder/Contractor from future contract award processes. The imposition and duration of the exclusion will be determined by the severity of the transgression. The severity will be determined by the circumstances of the case, in particular the number of transgressions, the position of the transgressions within the company hierarchy of the Bidder and the amount of the damage. The exclusion will be imposed for a minimum of 6 months and maximum of 3 years.

2. The Bidder accepts and undertakes to respect and uphold the Principal's Absolute right to resort to and impose such exclusion and further accepts and undertakes not to challenge or question such exclusion on any ground, including the lack of any hearing before the decision to resort to such exclusion is taken. This undertaking is given freely and after obtaining independent legal advice.

3. If the Bidder/Contractor can prove that he has restored/recouped the Damage caused by him and has installed a suitable corruption prevention system, the Principal may revoke the exclusion prematurely.

4. A transgression is considered to have occurred if in light of available evidence no reasonable doubt is possible.

5. Integrity Pact, in respect of a particular contract, shall be operative from the date Integrity Pact is signed by both the parties till the final completion of the contract **or as mentioned in Section 9 - Pact Duration whichever is later**. Any violation of the same would entail disqualification of the bidders and exclusion from future business dealings

Section 4 - Compensation for Damages

1. If the Principal has disqualified the Bidder from the tender process prior to the award according to Section 3, the Principal is entitled to demand and recover from the Bidder liquidated damages equivalent to Earnest Money Deposit/Bid Security.
2. If the Principal has terminated the contract according to Section 3, or if the Principal is entitled to terminate the contract according to Section 3, the principal shall be entitled to demand and recover from the Contractor liquidated damages equivalent to Security Deposit/Performance Bank Guarantee.
3. The bidder agrees and undertakes to pay the said amounts without protest or demur subject only to condition that if the Bidder/Contractor can prove and establish that the exclusion of the Bidder from the tender process or the termination of the contract after the contract award has caused no damage or less damage than the amount or the liquidated damages, the Bidder/Contractor shall compensate the Principal only to the extent of the damage in the amount proved.

Section 5 - Previous transgression

1. The Bidder declares that no previous transgression occurred in the last 3 years with any other Company in any country conforming to the TI approach or with any other Public Sector Enterprise in India that could justify his exclusion from the tender process.
2. If the Bidder makes incorrect statement on this subject, he can be disqualified from the tender process or the contract, if already awarded, can be terminated for such reason.

Section: 6 - Equal treatment of all Bidders/Contractor/Subcontractors

1. The Principal will enter into Pacts on identical terms with all bidders and contractors.

2. The Bidder/Contractor undertake(s) to procure from all subcontractors a commitment in conformity with this Integrity Pact. The Bidder/Contractor shall be responsible for any violation(s) of the provisions laid down in this agreement/Pact by any of its sub-contractors/sub-vendors.

3. The Principal will disqualify from the tender process all bidders who do not sign this Pact or violate its provisions.

Section: 7 - Criminal charges against violating Bidders/Contractors/Subcontractors

If the Principal obtains knowledge of conduct of a Bidder, Contractor or Subcontractor, or of an employee or a representative or an associate of a Bidder, Contractor or Subcontractor, which constitutes corruption, or if the Principal has substantive suspicion in this regard, the Principal will inform the Vigilance Office.

Section: 8 - External Independent Monitor/Monitors

1. The Principal appoints competent and credible external independent Monitor for this Pact. The task of the Monitor is to review independently and objectively, whether and to what extent the parties comply with the obligations under this agreement.

2. The Monitor is not subject to instructions by the representatives of the parties and performs his functions neutrally and independently. He reports to the Chairperson of the Board of the Principal.

3. The Contractor accepts that the Monitor has the right to access without restriction to all Project documentation of the Principal including that provided by the Contractor. The Contractor will also grant the Monitor, upon his request and demonstration of a valid interest, unrestricted and unconditional access to his project documentation. The same is applicable to Subcontractors. The Monitor is under contractual obligation to treat the information and documents of the Bidder/Contractor/Subcontractor with confidentiality.

4. The Principal will provide to the Monitor sufficient information about all meetings among the parties related to the Project provided such meetings could have an impact on the contractual relations between the Principal and the Contractor. The parties offer to the Monitor the option to participate in such meetings.

5. As soon as the Monitor notices, or believes to notice, a violation of this agreement, he will so inform the Management of the Principal and request the Management to discontinue or heal the violation, or to take other relevant action. The monitor can in this regard submit non-binding recommendations. Beyond this, the Monitor has no right to demand from the parties that they act in a specific manner, refrain from action or tolerate action. However, the Independent External Monitor shall give an opportunity to the bidder/contractor to present its case before making its recommendations to the Principal.

6. The Monitor will submit a written report to the Chairperson of the Board of the Principal within 8 to 10 weeks from the date of reference or intimation to him by the

'Principal' and, should the occasion arise, submit proposals for correcting problematic situations.

7. If the Monitor has reported to the Chairperson of the Board a Substantiated suspicion of an offence under relevant Anti-Corruption Laws of India, and the Chairperson has not, within reasonable time, taken visible action to proceed against such offence or reported it to the Vigilance Office, the Monitor may also transmit this information directly to the Central Vigilance Commissioner, Government of India.

8. The word 'Monitor' would include both singular and plural.

Section: 9 - Pact Duration

This Pact begins when both parties have legally signed it. It expires for the Contractor 12 months after the last payment under the respective contract, and for all other Bidders 6 months after the contract has been awarded.

If any claim is made/lodged during this time, the same shall be binding and continue to be valid despite the lapse of this pact as specified above, unless it is discharged/determined by Chairperson of the Principal.

Section: 10 - Other provisions

1. This agreement is subject to Indian Law. Place of performance and jurisdiction is the Registered Office of the Principal, i.e. New Delhi. The Arbitration clause provided in the main tender document/contract shall not be applicable for any issue/dispute arising under Integrity Pact.

2. Changes and supplements as well as termination notices need to be made in writing. Side agreements have not been made.

3. If the Contractor is a partnership or a consortium, this agreement must be, signed by all partners or consortium members.

4. Should one or several provisions of this agreement turn out to be invalid, the remainder of this agreement remains valid. In this case, the parties will strive to come to an agreement to their original intentions.

.....
For the Principal

.....
For the Bidder/Contractor

Witness 1:

Witness 2:

Place.

Date .

CERTIFICATE OF ANNUAL TURNOVER & NET WORTH

TO BE ISSUED BY PRACTISING **CHARTERED ACCOUNTANTS' FIRM** ON THEIR LETTER HEAD

TO WHOM IT MAY CONCERN

This is to certify that the following financial positions extracted from the audited financial statements of M/s
(Name of the Bidder) for the last 03(Three) completed accounting years upto **(as the case may be)** are correct.

YEAR	TURN OVER In INR	NET WORTH In INR

Place:

Date:

Seal:

Membership Number:

Signature:

Registration No.:

UDIN:

Annexure-I: Mandatory Spare list (Electrical Equipment/System)

Sl. No	Location	Component	Model	Make	Rating	Specifications	UOM	Qty.
1	Switch Room	Current Transformer			30/1A, 15VA	CI 1.0	NOS.	1
2	Switch Room	Fuse			25A	415Vac	NOS.	2
3	Spares for HVLRM panel	MCB	S202M C2	ABB Ltd	2A		NOS.	5
4	Spares for HVLRM panel	OLR	SIRIUS	SIEMENS	240V, 50/60 HZ		NOS.	5
5	Spares for HVLRM panel	Switch Amplifier	KFD2 SR2-Ex.2w	Pepperl + Fuchs	24Vdc		NOS.	3
6	UPS Spares List	Inverter IGBT		SEMIKRON/EU PEC	400A/1200V		NOS.	4
7	UPS Spares List	Thyristor Module		SEMIKRON/EU PEC	Compatible		NOS.	3
8	UPS Spares List	Fuse		BUSSMANN	200A		NOS.	2
9	UPS Spares List	DC Filter Capacitor		EPCOS/ ELECTROCON	Compatible		NOS.	4
10	UPS Spares List	AC Filter Capacitor		EPCOS/ ALCON /BHC-RIPA	Compatible		NOS.	4
11	UPS Spares List	Metal Oxide Varistor					NOS.	3
12	Control Room/ FWPH/ Switch	CFL4 (2X11W)		Crompton TLD211, Philips	CFL		NOS.	1

	Room			FBS-518/211, Bajaj BJMR 212				
13	Day to Day Electrical Maintenance Spares		Fluorescent Lamp	Philips	20W		NOS.	40
14	Air Conditioner	HPLP Switch (8Nos HP + 8 Nos LP Switch)					NOS.	8
15	Air Conditioner	Condenser Fan Motor					NOS.	3
16	Air Conditioner	R22 refrigerant, 61Kg per cylinder					NOS.	1
17	Air Conditioner	Leak test (detector) N2 Cylinder					NOS.	4
18	Diesel Engine	Contactora	SW80-1		24V		NOS.	10
19	Diesel Engine	Starter	R2, Type 400				NOS.	2
20	Diesel Engine	Alternator	R2, Type 400					2
21	Diesel Engine	Battery terminal Connector						20
22	Foam Pump	Starter					NOS.	2
23	Foam Pump	Alternator						2

24	Foam Pump	Battery terminal Connector					NOS.	5
25	Flood Light	HPSV Ballast		Bajaj	250W		NOS.	20
26	Flood Light	Ignitor		Bajaj	250W		NOS.	20
27	Flood Light	HPSV bulb		Bajaj (Threaded)	250W		NOS.	20
28	Flood Light	Bulb Holder		Bajaj (Threaded)	250W		NOS.	20
29	Air Conditioner	V Belt (Wet Grinder belt)	A28	ECODRIVE			NOS.	10
30	Air Conditioner	Controlling PCB					NOS.	2

Annexure-II: Mandatory Spare list (Mechanical Equipment/System)

Sl. No.	Material Description	Model/Part No.	Equipment Model	Location	UOM	Qty.
1	Oil Filter Element	P.N. 271.01.432.50	Kes 18-10	Air Compressor	NOS	2
2	Air Filter Element	P.N. 271.01.488.50		Air Compressor	NOS	2
3	Air-Oil Separator Element With Gasket	P.N. 271.00.157.50		Air Compressor	NOS	2
4	Service Kit For Mpv1	P.N. 271.00.282.50		Air Compressor	NOS	2
5	Service Kit For Bdv 3/8" Bsp	P.N. 271.00.283.50		Air Compressor	NOS	2
6	Auto Drain Valve	P.N. 271.01.548.50		Air Compressor	NOS	2
7	Gasket	P.N. 271.01.145.50		Air Compressor	NOS	4
8	Thermostat Valve	P.N. 271.02.037.50		Air Compressor	NOS	2
9	Lube Oil Filter V6/V8	P.N. 605411880009	Greaves Cotton Tbd3 V8 Engine	Fire Water Pump House	NOS	12
10	Filter Element (Micro + Prime)	P.N. 1200240911/12		Fire Water Pump House	SET	6
11	Air Filter (Inner + Outer)	P.N. 106900000014/15		Fire Water Pump House	SET	6
12	Gasket Set Kit	To Match With Fire Water Engine		Fire Water Pump House	SET	6
13	"V" Belt Set Kit	To Match With Fire Water Engine		Fire Water Pump House	SET	6
14	Exhaust Flexible Spool	To Match With Fire Water Engine		Fire Water Pump House	NOS	6
15	Lube Oil Pressure Gauge	To Match With Fire Water Engine		Fire Water Pump House	NOS	6
16	Rpm Meter	To Match With Fire Water Engine		Fire Water Pump House	NOS	6
17	Hand Pump	P.N.123200150306		Fire Water Pump House	NOS	6
18	Exhaust Valve Kit	To Match Air-Dryer		Compressor	NOS	1
19	Solenoid Valve	To Match Air-Dryer		Compressor	NOS	3

20	Pre-Filter Element	To Match Air-Dryer		Compressor	NOS	1
21	After-Filter Element	To Match Air-Dryer		Compressor	NOS	1
22	Activated Alumina	To Match Air-Dryer		Compressor	Pack	1

Annexure-III: Mandatory Spare list (Instrumentation Equipment/System)

Sl. No.	Material Description	Model/Part No.	Equipment Model	Location	UOM	Qty.
1	Oil Filter Element	P.N. 271.01.432.50	Kes 18-10	Air Compressor	NOS	2
2	Air Filter Element	P.N. 271.01.488.50		Air Compressor	NOS	2
3	Air-Oil Separator Element With Gasket	P.N. 271.00.157.50		Air Compressor	NOS	2
4	Service Kit For Mpv1	P.N. 271.00.282.50		Air Compressor	NOS	2
5	Service Kit For Bdv 3/8" Bsp	P.N. 271.00.283.50		Air Compressor	NOS	2
6	Auto Drain Valve	P.N. 271.01.548.50		Air Compressor	NOS	2
7	Gasket	P.N. 271.01.145.50		Air Compressor	NOS	4
8	Thermostat Valve	P.N. 271.02.037.50		Air Compressor	NOS	2
9	Lube Oil Filter V6/V8	P.N. 605411880009	Greaves Cotton Tbd3 V8 Engine	Fire Water Pump House	NOS	12
10	Filter Element (Micro + Prime)	P.N. 1200240911/12		Fire Water Pump House	SET	6
11	Air Filter (Inner + Outer)	P.N. 106900000014/15		Fire Water Pump House	SET	6
12	Gasket Set Kit	To Match With Fire Water Engine		Fire Water Pump House	SET	6
13	"V" Belt Set Kit	To Match With Fire Water Engine		Fire Water Pump House	SET	6
14	Exhaust Flexible Spool	To Match With Fire Water Engine		Fire Water Pump House	NOS	6
15	Lube Oil Pressure Gauge	To Match With Fire Water Engine		Fire Water Pump House	NOS	6
16	Rpm Meter	To Match With Fire Water Engine		Fire Water Pump House	NOS	6
17	Hand Pump	P.N.123200150306		Fire Water Pump House	NOS	6
18	Exhaust Valve Kit	To Match Air-Dryer		Compressor	NOS	1
19	Solenoid Valve	To Match Air-Dryer		Compressor	NOS	3

20	Pre-Filter Element	To Match Air-Dryer		Compressor	NOS	1
21	After-Filter Element	To Match Air-Dryer		Compressor	NOS	1
22	Activated Alumina	To Match Air-Dryer		Compressor	Pack	1

1. List of Electrical Mandatory equipment/spares:

Sl. No.	Item No.	Item Description	Rating/ Size/ Model	Brand/ Make	Qty.	Unit Price (Rs.) to be quoted Excluding GST	Net Price (Rs.)
1	MCB-1	230V AC, 6Amp, 2 Pole, Legrand model no:408628		Legrand	20		0.00
2	MCB-2	24V DC, 4 Amp, 2 Pole, Legrand model no:408823		Legrand	20		0.00
3	MCB-3	24V DC, 4 Amp, 2 Pole, Legrand model no:408820		Legrand	20		0.00
4	MCB-4	230V AC 2 Amps, 2 Pole, Legrand model no:408624		Legrand	20		0.00
5	MCB-5	230 V AC 4 Amp, 2 Pole, Legrand model no:408626		Legrand	20		0.00

2. List of Instrumentation Mandatory equipment/spares:

Sl. No.	Item No.	Item Description	Rating/ Size/ Model	Brand/ Make	UOM	Qty.
1	Metallic Tube Liner Heat Detection Unit	ADW 511A		M/s Securiton	NO	3
2	SS Sensor Tube	5MM OD x 4MM		M/S Vimal Fire Controls Pvt. Ltd	BUNDLES	2

		OD,SS316 L, 70 MTRS				
3	RS203/RS 482 to USB (2 Wire) Interfacing Unit	ACON E-02		M/s Abacus Electronics Pvt Ltd.	NO	1
4	FLP Pressure Switch	B400/B700		M/s Indfoss	NO	3
5	Level Gauge	REFLEX FLAT GLASS LEVEL GAUGE		M/s Pune Techtrol	NO	1
6	FLP Level Switch			M/s Chemtrol Samil	NO	3
7	FLP Solenoid Valve	3/2 DIRECT ACTING SOLENOID VALVE		M/s Rotex	NO	3
8	Auto Actuation Foam Discharge Valve	1"NB Full Bore		M/s Elo Matic	NO	3
9	Pressure Gauge			M/s Baumer	NO	1
10	Safety Barriers	KCD2-SR2- EX1W		M/s Pepperel Fuchs	NO	2
11	Programmable logic Controller	Micrologix 1400 1766- L2BWA		M/s Rockwell Automation	NO	1
12	Fiber to Ethernet switch	1783-ETAP2F		M/s Rockwell Automation	NO	1
14	PLC Memory Module	1766-MM1		M/s Rockwell Automation	NO	1
15	PLC External Output Module	1762-OB8		M/s Rockwell Automation	NO	1
16	Relay Module	8 CH,4C/0,24 VDC		M/s Connectwell	NO	2
17	Relay	3 CH, With base 24 VDC		M/s Omron Relay	NO	2
19	Timer	24V DC, 1NO,I NC		M/s Teknic	NO	1
20	Hooter			M/s FCG	NO	1

Annexure-IV: Maintenance of Rim Seal Fire Protection System

Sl. No.	Service Description	UOM	Qty.	Remarks
1	Periodic Maintenance (quarterly) of Rim Seal Fire Protection System for 4 nos. of 24.4 meter diameter floating roof tanks	QTR	8	Periodic Maintenance (Quarterly) of all 04 (four) nos. of 24.4 meters at CTF, Moran
2	Breakdown/Emergency Maintenance of Rim Seal Fire Protection System for 24.4 meters floating roof tanks	NO	4	Breakdown maintenance on per tank basis.
3	Cost of critical/mandatory/non-mandatory spares * [Refer to Annexure IV (A)]	LSM	1	

**FORMAT FOR UNDERTAKING (IN TERMS OF BEC CLAUSE NOS. 1.2.2 OF
TENDER NO. -----)**

TO BE NOTORISED

To
CHIEF GENERAL MANAGER (CONTRACTS)
OIL INDIA LIMITED
DULIAJAN

Dear Sirs,

**UNDERTAKING/DECLARATION BY THE BIDDER AND THE OEM(S)/AUTHORIZED DEALER(S) OF
EQUIPMENT(S) SPECIFIED IN CLAUSE NO. 3.0 and 4.0 (PART-I OF SCC) IN RESPECT OF
TENDER NO**

This is in connection with the Bid submitted by _____ against Tender No. _____ for COMPREHENSIVE ANNUAL MAINTENANCE CONTRACT (CAMC) FOR MORAN TANK FARM (MTF), OIL OINDIA LTD., DULIAJAN for a period of 2 (two) years or its extension if any.

I/We, OEM _____ against the subject tender, hereby declare that I/We would facilitate the required services to the bidder _____ on regular basis with Maintenance Crew/technology/Spares/Product updates etc. And also extend all necessary support during the maintenance period for our equipments details of which is Specified in Clause no. 3.0 and 4.0 (Part-I of SCC).

I/We declare that the information given above is true and any misstatement, misrepresentation, or suppression of facts in connection with the above undertaking may entail rejection of the bid and cancellation of contract, if awarded.

Yours faithfully,

Authorized Signatory with Seal _____
(OEM/Authorized Dealer)

Place:-

Date:-

OIL INDIA LIMITED (A Government of India Enterprise) Duliajan, Assam								
Description of Service: Hiring of services for Comprehensive Annual Maintenance Contract (CAMC) for the new facilities installed post M B Lal Committee recommendations in Moran Tank Farm for a period of 2 (two) years extendable by 1(one) year.								
PRICE BID FORMAT CDO4173P21								
<u>NAME OF BIDDER</u>								
<u>Bidder's GST No.</u>								
<u>SAC/HSN Code</u>								
<u>Select the benefit sought under the Policy</u> <u>(Use Drop Down List)</u>								
Item No.	Description of Services (For detailed description of Services Refer SOQ)	UOM	Estimated Quantity	Rate (Rs.) to be quoted Excluding GST	Applicable GST Rate in %	Applicable GST (Select from Drop down List)	Total Amount (Rs.) Excluding GST	Total Amount (Rs.) Including GST
			A	B	C		D = A * B	E = D+(D * C)
10	Comprehensive Annual maintenance charge for 1st year	QTR	4				0.00	0.00
20	Comprehensive Annual maintenance charge for 2nd year	QTR	4				0.00	0.00
30	OperatiCost of mandatory spares - Annexure-I (Electrical)	LSM	1	0.00			0.00	0.00
40	Cost of mandatory spares - Annexure-II (Mechanical)	LSM	1	0.00			0.00	0.00
50	Cost of mandatory spares - Annexure-III (Instrumentation)	LSM	1	0.00			0.00	0.00
60	Periodic Maintenance (quarterly) of Rim Seal Fire Protection System for 4 nos. of 24.4 meter diameter floating roof tanks -Annexure-IV	QTR	8	0.00			0.00	0.00
70	Breakdown/Emergency Maintenance of Rim Seal Fire Protection System for for 4 nos. of 24.4 meters floating roof tanks - Annexure-IV	NO	4	0.00			0.00	0.00

80	Cost of critical/mandatory/non-mandatory spares – Annexure-IV & Annexure IV(A)	LSM	1	0.00			0.00	0.00
Total (Rs)							0.00	0.00
								The above cost should be maintained under "Total Bid Value" in the E-Tender Portal
1. The rates against Line Item Nos. 30 through 80 shall be auto imputed from the total cost of respective enclosed Annexures.								
2. The price/rate(s) quoted by the Bidders will be inclusive of all taxes except GST (i.e. IGST or CGST and SGST/UTGST as applicable in case of interstate supply or intra state supply respectively and Cess on GST , if applicable) on the final services. However, GST rate (including cess) to be provided in the respective places in the Price Bid.								
3. Price Bids shall be evaluated on overall lowest cost to OIL (L-1 offer) basis i.e. considering total quoted price for all services including applicable GST(CGST & SGST/UTGST or IGST)								
4. OIL will prefer to deal with registered bidder under GST. Therefore, bidders are requested to get themselves registered under GST, if not registered yet. However, in case any unregistered bidder is submitting their bid, their prices will be loaded with applicable GST while evaluation of bid. Where OIL is entitled for input credit of GST, the same will be considered for evaluation of bid as per evaluation methodology of tender document.								
5. Price Bid uploaded without giving any of the details of the taxes (Including rates and amounts) will be considered as inclusive of all taxes including GST. When a bidder mentions taxes as extra without specifying the rates & amount, the offer will be loaded with maximum value towards taxes received against the tender for comparison purposes. If the bidder emerges as lowest bidder after such loading, in the event of order on that bidder, taxes mentioned by OIL on the Purchase Order/ Contracts will be binding on the bidder.								
6. Input Tax Credit on GST (Goods & Service Tax) for this service is NOT available to OIL & The bids will be evaluated based on total price including GST.								
7. Bidder may seek benefits under Public Procurement Policy for MSEs – Order 2012.								
8. Refer to GCC for detail of GST								
9. Refer to SOQ & SCC for Item detail Description								
10. Mobilisation Period: Personnel's & Consumables: 30 (Thirty) days from the date of issue of LOA. Mandatory Spares: 60 (Sixty) days from the date of issue of LOA.								

Annexure-I: Mandatory Spare list (Electrical Equipment/System)										
Sl. No.	Location	Component	Model	Make	Rating	Specificaiton	UOM	Qty.	Unit Price (Rs.) to be quoted Excluding GST	Net Price (Rs.)
1	Switch Room	Current Transformer			30/1A, 15VA	CI 1.0	NOS.	1		0.00
2	Switch Room	Fuse			25A	415Vac	NOS.	2		0.00
3	Spares for HVLRM panel	MCB	S202M C2	ABB Ltd	2A		NOS.	5		0.00
4	Spares for HVLRM panel	OLR	SIRIUS	SIEMENS	240V, 50/60 HZ		NOS.	5		0.00
5	Spares for HVLRM panel	Switch Amplifier	KFD2 SR2- Ex.2w	Pepperl + Fuchs	24Vdc		NOS.	3		0.00
6	UPS Spares List	Inverter IGBT		SEMIKRON/EU PEC	400A/1200V		NOS.	4		0.00
7	UPS Spares List	Thyristor Module		SEMIKRON/EU PEC	Compatible		NOS.	3		0.00
8	UPS Spares List	Fuse		BUSSMANN	200A		NOS.	2		0.00
9	UPS Spares List	DC Filter Capacitor		EPCOS/ ELECT ROCION	Compatible		NOS.	4		0.00
10	UPS Spares List	AC Filter Capacitor		EPCOS/ ALCON /BHC-RIPA	Compatible		NOS.	4		0.00
11	UPS Spares List	Metal Oxide Varistor					NOS.	3		0.00
12	Control Room/ FWPH/ Switch Room	CFL4 (2X11W)		Crompton TLD211, Philips FBS- 518/211, Bajaj BJMR 212	CFL		NOS.	1		0.00
13	Day to Day Electrical Maintenance Spares		Fluorescent Lamp	Philips	20W		NOS.	40		0.00
14	Air Conditioner	HPLP Switch (8Nos HP + 8 Nos LP Switch)					NOS.	8		0.00
15	Air Conditioner	Condenser Fan Motor					NOS.	3		0.00
16	Air Conditioner	R22 refrigerant, 61Kg per cylinder					NOS.	1		0.00
17	Air Conditioner	Leak test (detector) N2 Cylinder					NOS.	4		0.00
18	Diesel Engine	Contactor	SW80-1		24V		NOS.	10		0.00

19	Diesel Engine	Starter	R2, Type 400				NOS.	2		0.00
20	Diesel Engine	Alternator	R2, Type 400					2		0.00
21	Diesel Engine	Battery terminal Connector						20		0.00
22	Foam Pump	Starter					NOS.	2		0.00
23	Foam Pump	Alternator						2		0.00
24	Foam Pump	Battery terminal Connector					NOS.	5		0.00
25	Flood Light	HPSV Ballast		Bajaj	250W		NOS.	20		0.00
26	Flood Light	Ignitor		Bajaj	250W		NOS.	20		0.00
27	Flood Light	HPSV bulb		Bajaj (Threaded)	250W		NOS.	20		0.00
28	Flood Light	Bulb Holder		Bajaj (Threaded)	250W		NOS.	20		0.00
29	Air Conditioner	V Belt (Wet Grinder belt)	A28	ECODRIVE			NOS.	10		0.00
30	Air Conditioner	Controlling PCB					NOS.	2		0.00
									Total (Rs)	0.00

Annexure-II: Mandatory Spare list (Mechanical Equipment/System)

Sl. No.	Material Description	Model/Part No.	Equipment Model	Location	UOM	Qty.	Unit Price (Rs.) to be quoted Excluding GST	Net Price (Rs.)
1	Oil Filter Element	P.N. 271.01.432.50	Kes 18-10	Air Compressor	NOS	2		0.00
2	Air Filter Element	P.N. 271.01.488.50		Air Compressor	NOS	2		0.00
3	Air-Oil Separator Element With Gasket	P.N. 271.00.157.50		Air Compressor	NOS	2		0.00
4	Service Kit For MpvI	P.N. 271.00.282.50		Air Compressor	NOS	2		0.00
5	Service Kit For Bdv 3/8" Bsp	P.N. 271.00.283.50		Air Compressor	NOS	2		0.00
6	Auto Drain Valve	P.N. 271.01.548.50		Air Compressor	NOS	2		0.00
7	Gasket	P.N. 271.01.145.50		Air Compressor	NOS	4		0.00
8	Thermostat Valve	P.N. 271.02.037.50		Air Compressor	NOS	2		0.00
9	Lube Oil Filter V6/V8	P.N. 605411880009	Greaves Cotton Tbd3 V8 Engine	Fire Water Pump House	NOS	12		0.00
10	Filter Element (Micro + Prime)	P.N. 1200240911/12		Fire Water Pump House	SET	6		0.00
11	Air Filter (Inner + Outer)	P.N. 106900000014/15		Fire Water Pump House	SET	6		0.00
12	Gasket Set Kit	To Match With Fire Water Engine		Fire Water Pump House	SET	6		0.00
13	"V" Belt Set Kit	To Match With Fire Water Engine		Fire Water Pump House	SET	6		0.00
14	Exhaust Flexible Spool	To Match With Fire Water Engine		Fire Water Pump House	NOS	6		0.00
15	Lube Oil Pressure Gauge	To Match With Fire Water Engine		Fire Water Pump House	NOS	6		0.00

16	Rpm Meter	To Match With Fire Water Engine		Fire Water Pump House	NOS	6		0.00
17	Hand Pump	P.N.123200150306		Fire Water Pump House	NOS	6		0.00
18	Exhaust Valve Kit	To Match Air-Dryer		Compressor	NOS	1		0.00
19	Solenoid Valve	To Match Air-Dryer		Compressor	NOS	3		0.00
20	Pre-Filter Element	To Match Air-Dryer		Compressor	NOS	1		0.00
21	After-Filter Element	To Match Air-Dryer		Compressor	NOS	1		0.00
22	Activated Alumina	To Match Air-Dryer		Compressor	Pack	1		0.00
							Total (Rs)	0.00

Annexure-III: Mandatory Spare list (Instrumentation Equipment/System)

Sl. No.	Material Description	Specification/Serial No.	Model	Make	Description	Rating	UOM	Qty.	Unit Price (Rs.) to be quoted Excluding GST	Net Price (Rs.)
1	GAS DETECTOR	S/N: 546330/01-002	Irmax	Crowcon	N/A	N/A	NOS	5		0.00
2	PRESSURE TRANSMITTER-FWPH	S/N: C4000005718109	STG170E1G0 000HC SMZSA6LPC CTGMBF 1CA	Honeywell	N/A	N/A	NOS	1		0.00
3	FLOW TRANSMITTER	S/N: C4000005714751	STD720E1HS 4AS1C AHC11CB11 AOF100 00	Honeywell	N/A	N/A	NOS	2		0.00
4	PRESSURE TRANSMITTER DENSITY MEASUREMENT		3051L3AGOMD21 AADFK5D4T1Q4 M5	EMERSON			NOS	1		0.00
5	ELECTRONIC CARDS FOR LEVEL INSTRUMENTS			Honeywell (enraf)	1 no's of all types of radar, servo, TSI etc.to be kept as spares		NOS	1		0.00
6	GLYCERINE FILLED SS PRESSURE GAUGE			DYNAMIC			NOS	2		0.00
7	TEMPERATURE GAUGE	Model- 68QSW3		H.GURU			NOS	2		0.00
8	Pressure guage (Glycerine filled)	0-25kgs		H. Guru	COMPATIBLE		NOS	7		0.00
9	Pressure Switch for foam pump	PS47795 (1.6-16 bar/Kg)		Switzer			NOS	2		0.00
10	Smoke detector			honeywell			NOS	10		0.00
11	Wilo panel PCB card	Mathar+Platt PCB-314A					NOS	2		0.00
12	Bridge rectifiers						NOS	4		0.00

13	Relay card	UL5302N0-C-DP-T					NOS	2		0.00
14	Magnetic Pickup	HSN-8409					NOS	4		0.00
15	Relay	3A, 24 volts		Schneider			NOS	20		0.00
16	ROSOV Solenoid valve	13004-6-2R-B2-62		Rotex			NOS	5		0.00
17	Relay card (Foam Pump D/E)	UL5302N01C0-2C-DP-72					NOS	1		0.00
18	Temperature sensor (Vito card)						NOS	1		0.00
19	MCP notifier card, switch (outdoor)			SAI INDUSTRIES			NOS	15		0.00
20	MCP (indoor red)			SAI INDUSTRIES			NOS	5		0.00
									Total (Rs)	0.00

Annexure-IV: Maintenance of Rim Seal Fire Protection System

Sl. No.	Service Description	UOM	Qty.	Remarks	Unit Price (Rs.) to be quoted Excluding GST	Net Price (Rs.)
1	Periodic Maintenance (quarterly) of Rim Seal Fire Protection System for 4 nos. of 24.4 meter diameter floating roof tanks	QTR	8	Periodic Maintenance (Quarterly) of all 04 (four) nos. of 24.4 meters at CTF, Moran		0.00
2	Breakdown/Emergency Maintenance of Rim Seal Fire Protection System for 24.4 meters floating roof tanks	NO	4	Breakdown maintenance on per tank basis.		0.00
3	Cost of critical/mandatory/non-mandatory spares * [Refer to Annexure IV (A)]	LSM	1		0.00	0.00
					Total (Rs)	0.00

***Note to SI no. 3 of Annexure-IV:**

Annexure-IV (A):

1. List of Electrical Mandatory equipment/spares:

Sl. No.	Item No.	Item Description	Rating/Size/Model	Brand/Make	Qty.	Unit Price (Rs.) to be quoted Excluding GST	Net Price (Rs.)
1	MCB-1	230V AC, 6Amp, 2 Pole, Legrand model no:408628		Legrand	20		0.00
2	MCB-2	24V DC, 4 Amp, 2 Pole, Legrand model no:408823		Legrand	20		0.00
3	MCB-3	24V DC, 4 Amp, 2 Pole, Legrand model no:408820		Legrand	20		0.00
4	MCB-4	230V AC 2 Amps, 2 Pole, Legrand model no:408624		Legrand	20		0.00
5	MCB-5	230 V AC 4 Amp, 2 Pole, Legrand model no:408626		Legrand	20		0.00
						Total (Rs)	0.00

2. List of Instrumentation Mandatory equipment/spares:

Sl. No.	Item No.	Item Description	Rating/Size/Model	Brand/Make	UOM	Qty.	Unit Price (Rs.) to be quoted Excluding GST	Net Price (Rs.)
---------	----------	------------------	-------------------	------------	-----	------	---	-----------------

1	Metallic Tube Liner Heat Detection Unit	ADW 511A		M/s Securiton	NO	3		0.00
2	SS Sensor Tube	5MM OD x 4MM OD,SS316 L, 70 MTRS		M/S Vimal Fire Controls Pvt. Ltd	BUNDLES	2		0.00
3	RS203/RS 482 to USB (2 Wire) Interfacing Unit	ACON E-02		M/s Abacus Electronics Pvt Ltd.	NO	1		0.00
4	FLP Pressure Switch	B400/B700		M/s Indfoss	NO	3		0.00
5	Level Gauge	REFLEX FLAT GLASS LEVEL GAUGE		M/s Pune Techtrol	NO	1		0.00
6	FLP Level Switch			M/s Chemtrol Samil	NO	3		0.00
7	FLP Solenoid Valve	3/2 DIRECT ACTING SOLENOID VALVE		M/s Rotex	NO	3		0.00
8	Auto Actuation Foam Discharge Valve	1"NB Full Bore		M/s Elo Matic	NO	3		0.00
9	Pressure Gauge			M/s Baumer	NO	1		0.00
10	Safety Barriers	KCD2-SR2-EX1W		M/s Pepperel Fuchs	NO	2		0.00
11	Programmable logic Controller	Micrologix 1400 1766- L2BWA		M/s Rockwell Automation	NO	1		0.00

[illegible]

BID FORM

To
M/s Oil India Limited,
P.O. Duliajan, Assam, India

Sub: IFB No. CDO4173P21

Gentlemen,

Having examined the General and Special Conditions of Contract and the Terms of Reference including all attachments thereto, the receipt of which is hereby duly acknowledged, we the undersigned offer to perform the work/services in conformity with the said conditions of Contract and Terms of Reference for the sum quoted in the Price Bid Format or such other sums as may be ascertained in accordance with the Schedule of Prices attached herewith and made part of this Bid.

We undertake, if our Bid is accepted, to commence the work as per the terms & conditions set out in the subject tender.

If our Bid is accepted, we will submit the Performance Security Deposit as specified in the tender document for the due performance of the Contract.

We agree to abide by this Bid for a period of 120 days from the original date of Bid closing and it shall remain binding upon us and may be accepted at any time before the expiration of that period.

Until a formal Contract is prepared and executed, this Bid, together with your written acceptance thereof in your notification of award shall constitute a binding Contract between us.

We understand that you are not bound to accept the lowest or any Bid you may receive.

Dated this _____ day of _____ 2020.

Authorised Person's Signature: _____

Name: _____

Designation: _____

Seal of the Bidder:

STATEMENT OF NON-COMPLIANCE (IF ANY)**(Only exceptions/deviations to be rendered)**

1.0 The Bidder shall furnish detailed statement of **exceptions/deviations**, if any, to the IFB stipulations, terms and conditions in respect of each Section of Bid Document in the following format:

Section No.	Clause No. (Page No.)	Non-Compliance	Remarks

Signature of Bidder: _____

Name: _____

NOTE: OIL INDIA LIMITED expects the bidders to fully accept the terms and conditions of the bid document. However, should the bidders still envisage some exceptions/deviations to the terms and conditions of the bid document, the same should be indicated as per above format and submit along with their bids. If the **“Statement of Non-Compliance”** in the above Proforma is left blank (or not submitted along with the Bid), then it would be constructed that the bidder has not taken any exception/deviation to the IFB requirements.

PROFORMA LETTER OF AUTHORISATION FOR ATTENDING BID OPENING

**TO
CGM (CONTRACTS)
OIL INDIA LIMITED
P.O. DULIAJAN-786602
Assam, India**

Sir,

SUB: OIL's IFB No. CDO4173P21

I/We _____ confirm that Mr. _____ (Name and address) as authorised to represent us during bid opening on our behalf with you against IFB No. **CDO4173P21** for **Hiring of services for Comprehensive Annual Maintenance Contract (CAMC) for the new facilities installed post M B Lal Committee recommendations in Moran Tank Farm for a period of 2 (two) years extendable by 1 (one) year.**

Yours Faithfully,

Authorised Person's Signature: _____

Name: _____

Signature of Bidder: _____

Name: _____

Date: _____

PROFORMA LETTER OF AUTHORITY

**TO
CGM (CONTRACTS)
Contracts Department
P.O. DULIAJAN PIN-786602
Dist. Dibrugarh, Assam
India**

Dear Sir,

SUB: OIL's IFB No. CDO4173P21

We _____ of _____
Confirm that Mr. _____
_____ (Name and Address) is authorised to represent us to Bid,
negotiate and conclude the agreement on our behalf with you against IFB No.
CDO4173P21 for **Hiring of services for Comprehensive Annual Maintenance
Contract (CAMC) for the new facilities installed post M B Lal Committee
recommendations in Moran Tank Farm for a period of 2 (two) years extendable
by 1 (one) year** for any commercial/Legal purpose etc.

We confirm that we shall be bound by all and whatsoever our said
representative shall commit.

Authorised Person's Signature: _____

Name: _____

Yours faithfully,

Signature: _____

Name & Designation _____

For & on behalf of _____

NOTE: This letter of authority shall be on printed letter head of the bidder, and shall be signed by a person competent and having the power of attorney (Power of attorney shall be annexed) to bind such Bidder.

FORM OF BID SECURITY (BANK GUARANTEE FORMAT)

To
M/s OIL INDIA LIMITED,
CONTRACTS DEPARTMENT,
DULIAJAN, ASSAM, INDIA, PIN-786602

WHEREAS, (Name of Bidder) _____ (hereinafter called "the Bidder") has submitted their offer Dated _____ for the provision of certain services (hereinafter called "the Bid") against OIL INDIA LIMITED, Duliajan, Assam, India (hereinafter called the Company's) Tender No. _____ KNOW ALL MEN BY these presents that we (Name of Bank) _____ of (Name of Country) _____ having our registered office at _____ (hereinafter called "Bank") are bound unto the Company in the sum of (*_____) for which payment well and truly to be made to Company, the Bank binds itself, its successors and assignees by these presents.

SEALED with the said Bank this ____ day of _____ 20_____

THE CONDITIONS of these obligations are:

1. If the Bidder withdraws their Bid within its original/extended validity; or
2. The Bidder modifies/revises their bid suomoto; or
3. The Bidder does not accept the contract; or
4. The Bidder does not furnish Performance Security Deposit within the stipulated time as per tender/contract; or
5. If it is established that the Bidder has submitted fraudulent documents or has indulged into corrupt and fraudulent practice.

We undertake to pay to Company up to the above amount upon receipt of its first written demand (by way of letter/fax/cable), without Company having to substantiate its demand provided that in its demand Company will note that the amount claimed by it is due to it owing to the occurrence of any of the conditions, specifying the occurred condition or conditions.

This guarantee will remain in force up to and including the date (**--/--/--) and any demand in respect thereof should reach the Bank not later than the above date.

The details of the Issuing Bank and Controlling Bank are as under:

A. Issuing Bank:

BANK FAX NO:

BANK EMAIL ID:

BANK TELEPHONE NO.:

IFSC CODE OF THE BANK:

B. Controlling Office:

Address of the Controlling Office of the BG issuing Bank:

Name of the Contact Person at the Controlling Office with Mobile No. and e-mail address:

SIGNATURE AND SEAL OF THE GUARANTORS _____

Name of Bank & Address _____

Witness _____

Address _____

(Signature, Name and Address)

Date: _____

Place: _____

- * The Bidder should insert the amount of the guarantee in words and figures.
- ** Date of expiry of Bank Guarantee should be minimum 30 days after the end of the validity period of the Bid/as specified in the Tender.

Note:

The Bank Guarantee issuing bank branch shall ensure the following:

- a. The Bank Guarantee issued by the Bank must be routed through SFMS platform as per following details:

- (i) MT 760 / MT 760 COV for issuance of Bank Guarantee
- (ii) MT 760 / MT 767 COV for amendment of Bank Guarantee

The above message / intimation shall be sent through SFMS (indicating the Tender Number) by the BG issuing Bank branch to HDFC Bank, Duliajan Branch, IFS Code – HDFC0002118; SWIFT Code - HDFCINBBCAL. Branch Address: HDFC Bank Limited, Duliajan Branch, Utopia Complex, BOC Gate, Jayanagar, Duliajan, Dibrugarh, PIN – 786602.

- b. Bank Guarantee issued by a Scheduled Bank in India at the request of some other Non-Scheduled Bank of India shall not be acceptable.

**[TO BE FILLED-UP/SUBMITTED BY THE VENDOR ON ITS LETTER HEAD FOR
E-REMITTANCE]**

Name:

FULL Address:

Phone Number:

Mobile Number:

E-mail address:

Fax Number:

Bank Account Number (in which the Bidder wants remittance against invoices):

Bank Name:

Branch:

Address of the Bank:

Bank Code:

IFSC/RTGS Code of the Bank:

NEFT Code of the Bank:

PAN Number:

GST Registration Number:

Signature of Bidder with Official Seal

FORM OF PERFORMANCE BANK GUARANTEE

(TO BE FURNISHED BY THE CONTRACTOR IN CASE OF SUBMITTING PERFORMANCE SECURITY IN THE FORM OF BANK GUARANTEE AFTER ISSUE OF LOA)

**To
M/s OIL INDIA LIMITED,
CONTRACTS DEPARTMENT
DULIAJAN, ASSAM, INDIA, PIN-786602**

WHEREAS _____ (Name and address of Contractor) (hereinafter called "Contractor") had undertaken, in pursuance of Contract No. _____ to execute _____ (Brief Description of the Work) (hereinafter called "the Contract").

AND WHEREAS it has been stipulated by you in the said Contract that the Contractor shall furnish you with a Bank Guarantee as security for compliance with Contractor's obligations in accordance with the Contract.

AND WHEREAS we have agreed to give the Contractor such a Bank Guarantee; NOW THEREFORE we hereby affirm that we are Guarantors on behalf of the Contractor, up to a total of (Amount of Guarantee in figures) _____ (in words _____), such amount being payable in the types and proportions of currencies in which the Contract price is payable, and we undertake to pay you, upon your first written demand and without cavil or argument, any sum or sums within the limits of guarantee sum as aforesaid without your needing to prove or to show grounds or reasons for your demand for the sum specified therein. We hereby waive the necessity of your demanding the said debt from the Contractor before presenting us with the demand.

We further agree that no change or addition to or other modification of the terms of the Contract or the work to be performed there under or of any of the Contract documents which may be made between you and the Contractor shall in any way cease us from any liability under this guarantee, and we hereby waive notice of such change, addition or modification.

This guarantee is valid until the _____ day of _____.

The details of the Issuing Bank and Controlling Bank are as under:

A. Issuing Bank:

BANK FAX NO:

BANK EMAIL ID:

BANK TELEPHONE NO:

IFSC CODE OF THE BANK:

B. Controlling Office:

Address of the Controlling Office of the BG issuing Bank:

Name of the Contact Person at the Controlling Office with Mobile No. and e-mail address:

SIGNATURE AND SEAL OF THE GUARANTORS _____

Designation _____

Name of Bank _____

Address _____

Witness _____

Address _____

Date: _____

Place: _____

Note:

The Bank Guarantee issuing bank branch shall ensure the following:

- a. The Bank Guarantee issued by the Bank must be routed through SFMS platform as per following details:

- (i) MT 760 / MT 760 COV for issuance of Bank Guarantee
- (ii) MT 760 / MT 767 COV for amendment of Bank Guarantee

The above message / intimation shall be sent through SFMS (indicating the Tender Number) by the BG issuing Bank branch to HDFC Bank, Duliajan Branch, IFS Code – HDFC0002118; SWIFT Code - HDFCINBBCAL. Branch Address: HDFC Bank Limited, Duliajan Branch, Utopia Complex, BOC Gate, Jayanagar, Duliajan, Dibrugarh, PIN – 786602.

- b. Bank Guarantee issued by a Scheduled Bank in India at the request of some other Non-Scheduled Bank of India shall not be acceptable.

AGREEMENT FORM

This Agreement is made on ____ day of _____ between Oil India Limited, a Government of India Enterprise, incorporated under the Companies Act 1956, having its registered office at Duliajan in the State of Assam, hereinafter called the "Company" which expression unless repugnant to the context shall include executors, administrators and assignees on the one part, and M/s. _____ (Name and address of Contractor) hereinafter called the "Contractor" which expression unless repugnant to the context shall include executors, administrators and assignees on the other part,

WHEREAS the Company desires that Services _____ (brief description of services) should be provided by the Contractor as detailed hereinafter or as Company may requires;

WHEREAS, Contractor engaged themselves in the business of offering such services represents that they have adequate resources and equipment, material etc. in good working order and fully trained personnel capable of efficiently undertaking the operations and is ready, willing and able to carry out the said services for the Company as per Section-II attached herewith for this purpose and

WHEREAS, Company had issued a firm Letter of Award No. _____ dated _____ based on Offer No. _____ dated _____ submitted by the Contractor against Company's IFB No. _____ and the Contractor accepted the same vide Letter No. _____ dated _____.

WHEREAS, the Contractor has furnished to Company the performance security in the form of DD/BC/BG for Rs. _____ (being 10% of annualized contract value) with validity of 03 (three) months beyond the contract period.

All these aforesaid documents shall be deemed to form and be read and construed as part of this agreement/contract. However, should there be any dispute arising out of interpretation of this contract in regard to the terms and conditions with those mentioned in Company's tender document and subsequent letters including the Letter of Intent and Contractor's offer and their subsequent letters, the terms and conditions attached hereto shall prevail. Changes, additions or deletions to the terms of the contract shall be authorized solely by an amendment to the contract executed in the same manner as this contract.

NOW WHEREAS, in consideration of the mutual covenants and agreements hereinafter contained, it is hereby agreed as follows –

1. In this Agreement words and expressions shall have the same meanings as are respectively assigned to them in the Conditions of Contract referred to.
2. In addition to documents herein above, the following Sections and Annexures attached herewith shall be deemed to form and be read and construed as part of this agreement viz.:

E-TENDER NO. CDO4173P21

- (a) PART-I indicating the General Conditions of this Contract;
- (b) PART-II indicating the Schedule of work, unit, quantities & rates;
- (c) PART-III indicating the Special Conditions of Contract;
- (d) PART-V indicating the Safety Measures.

3. In consideration of the payments to be made by the Company to the Contractor as hereinafter mentioned, the Contractor hereby covenants with the Company to provide the Services and to remedy defects therein in conformity in all respect with the provisions of this Contract.

4. The Company hereby covenants to pay the Contractor in consideration of the provision of the Services and the remedying of defects therein, the Contract Price or such other sum as may become payable under the provisions of this Contract at the times and in the manner prescribed by this Contract.

IN WITNESS thereof, each party has executed this contract at Duliajan, Assam as of the date shown above.

Signed, Sealed and Delivered,

For and on behalf of
Company (Oil India Limited)

for and on behalf of Contractor
(M/s. _____)

Name:

Name:

Status:

Status:

In presence of

In presence of

1.

1.

2.

2.

Format of undertaking by Bidders towards submission of authentic information/documents (To be typed on the letter head of the bidder)

Ref. No _____

Date _____

Sub: Undertaking of authenticity of information/documents submitted

Ref: Your Tender No. CDO4173P21

**To,
The CGM (Contracts)
Contracts Department,
OIL, Duliajan**

Sir,

With reference to our quotation against your above-referred tender, we hereby undertake that no fraudulent information/documents have been submitted by us.

We take full responsibility for the submission of authentic information/documents against the above cited bid.

We also agree that, during any stage of the tender/contract agreement, in case any of the information/documents submitted by us are found to be false/forged/fraudulent, OIL has right to reject our bid at any stage including forfeiture of our EMD and/or PBG and/or cancel the award of contract and/or carry out any other penal action on us, as deemed fit.

Yours faithfully,

For (type name of the firm here)

Signature of Authorized Signatory

Name :

Designation :

Phone No.

Place :

Date :

(Affix Seal of the Organization here, if applicable)

**(TO BE EXECUTED BY THE AUTHORIZED SIGNATORY OF THE BIDDER ON THE
OFFICIAL LETTER HEAD OF THE BIDDER)**

CERTIFICATE OF COMPLIANCE TO FINANCIAL CRITERIA

**Ref : Note 'b.' under Clause 1.1 Financial Criteria of BEC/BRC of
Tender No. CDO4173P21**

I _____ the authorized signatory(s) of _____
(Company or firm name with address) do hereby solemnly affirm and declare /
undertake as under:

**The balance sheet/Financial Statements for the financial year _____
have actually not been audited as on the Original Bid Closing Date.**

Yours faithfully,

For (type name of the firm here)

Signature of Authorized Signatory

Name:

Designation:

Phone No.

Place:

Date:

(Affix Seal of the Organization here, if applicable)

Note: Please note that any declaration bearing date after the Original Bid Closing Date will not be considered and will be rejected. This certificate is to be issued only considering the time required for preparation of Financial Statements i.e. if the last date of preceding financial/accounting year falls within the preceding six months reckoned from the Original Bid Closing Date.

TECHNICAL EVALUATION SHEET FOR BEC
E-TENDER NO. CDO4173P21

Bidder's Name: _____

Sl. No.	Clause No. of BEC/BRC	Description	Compliance		Bidder to indicate Relevant Page No. of their Bid to support the remarks/ compliance
			Yes	No	
1	1.0	<p><u>BID EVALUATION CRITERIA (BEC)</u></p> <p>The bid shall conform generally to the specifications and terms and conditions given in the Tender Documents. Bids will be rejected in case services offered do not conform to the required parameters stipulated in the technical specifications. Notwithstanding the general conformity of the bid to the stipulated specifications, the following mandatory requirements will have to be particularly met by the Bidders without which the same will be considered as non-responsive and rejected. All the documents related to BEC must be submitted along with the Technical Bid.</p>			
<u>1.1 FINANCIAL CRITERIA</u>					
2	1.1.1	Annual Financial Turnover of the bidder during any of preceding 03 (Three) financial/accounting years from the original bid closing date should be at least Rs. 42,34,700.00 (Rupees Forty Two Lakh Thirty Four Thousand and Seven Hundred only).			
3	1.1.2	<p>Net worth of the bidder must be Positive for the preceding financial/accounting year.</p> <p>Note: The Net worth to be considered against Clause 1.1.2 above, should be read in conjunction with the definition of Net worth as mentioned in Section 2 (57) of The Companies Act, 2013.</p>			

TECHNICAL EVALUATION SHEET FOR BEC
E-TENDER NO. CDO4173P21

4	<p style="text-align: center;">Note to BEC Clause 1.1 above</p>	<p>a. For proof of Annual Turnover & Net worth (refer clauses 1.1.1 & 1.1.2 above), any one of the following documents/photocopies must be submitted along with the bid:</p> <p style="padding-left: 40px;">(i) Audited Balance Sheet along with Profit & Loss account.</p> <p style="text-align: center;">OR</p> <p style="padding-left: 40px;">(ii) A certificate issued by a practicing Chartered or Cost Accountant (with Membership Number and Firm Registration Number), certifying the Annual turnover & Net worth as per format prescribed in Annexure-X.</p> <p style="padding-left: 40px;">Note: Mention of UDIN (Unique Document Identification Number) is mandatory for all Certificates w.e.f. February 1, 2019, issued by Chartered Accountant in Practice.</p> <p>b. Considering the time required for preparation of Financial Statements, if the last date of preceding financial/accounting year falls within the preceding six months reckoned from the original bid closing date and the Financial Statements of the preceding financial/accounting year are not available with the bidder, then the financial turnover of the previous three financial/accounting years excluding the preceding financial/accounting year will be considered. In such cases, the Net worth of the previous financial/accounting year excluding the preceding financial/accounting year will be considered. However, the bidder has to submit an undertaking in support of the same along with their technical bid as per Proforma-X.</p> <p>c. In case the bidder is a Central Govt. Organization/PSU/State Govt. Organization/Semi-State Govt. Organization or any other Central/State Govt. Undertaking, where the auditor is appointed only after the approval of Comptroller and Auditor General of India and the Central Government, their certificates may be accepted even though FRN is not available. However, bidder to provide</p>			
---	--	---	--	--	--

TECHNICAL EVALUATION SHEET FOR BEC
E-TENDER NO. CDO4173P21

		<p>documentary evidence for the same.</p> <p>d. In case the bidder is a Government Department, they are exempted from submission of documents mentioned under para a. and b. above.</p> <p>e. Bid will be rejected if not accompanied with adequate documentary proof in support of Annual turnover & Net worth as mentioned in Para 1.1.1 & 1.1.2.</p>			
1.2 TECHNICAL CRITERIA					
5	1.2	<p>The bidder must have experience of successful completion/execution of “Maintenance Services” or “Operation & Maintenance (O&M)” in Central Govt./State Govt./Public Sector Undertaking/State Govt. Enterprise/Any Upstream or Downstream Oil/Gas Company of any one of the following:.</p> <p>a. Experience of handling Petroleum Production Facility/ Petroleum Process Facility/Petroleum Tank Farm with a minimum work experience Rs. 70,57,800.00 (Rupees Seventy Lakh Fifty Seven Thousand and Eight Hundred only) for a minimum period of 1 (one) year during the last 7(seven) years to be reckoned from the original bid closing date.</p> <p>b. Experience of handling Natural Gas - Production / Gathering /Processing / Compression facility with a minimum work experience of 1 (one) MMSCUMD or more during the last 7(seven) years to be reckoned from the original bid closing date.</p> <p>c. Experience of handling Petroleum Production facility for a minimum production of 300 Barrels of Oil per Day during the last 7(seven) years to be reckoned from the original bid closing date</p> <p>d. Experience of handling “Crude Oil”/”Petroleum Products” of Tank</p>			

TECHNICAL EVALUATION SHEET FOR BEC
E-TENDER NO. CDO4173P21

		Farm with minimum storage capacity of 10,000 Barrels during the last 7(seven) years to be reckoned from the original bid closing date.			
6	Note to BEC clause 1.2 above	<p>a. Maintenance Services/O&M Services as referred in 1.2 must have to meet the minimum working experience for the following under single contract:</p> <ul style="list-style-type: none"> a. Maintenance of Process Instrumentation and related control system. b. Maintenance of Fire Fighting Equipments and related control system. c. Maintenance of Electrical Systems including Air Conditioners. d. Maintenance of Mechanical Pumps, Engines, Air Compressors etc. <p>b. For proof of requisite Experience (refer Clause No. 1.2), the following documents/ photocopy (self-attested/attested) must be submitted along with the bid:</p> <p>I. <u>In case work experience is against OIL's Contract:</u> Bidder must submit Job Completion Certificate issued by the company indicating the following:</p> <ul style="list-style-type: none"> A. Work order no./Contract no. B. Gross value of job done C. Period of Service D. Nature of Service <p>II. <u>In case work experience is not against OIL's Contract:</u> Bidder must submit the following:</p> <ul style="list-style-type: none"> A. Contract document showing details of work, AND B. Job Completion Certificate showing: <ul style="list-style-type: none"> (i) Gross value of job done (ii) Nature of job done and Work order no./Contract no. 			

TECHNICAL EVALUATION SHEET FOR BEC
E-TENDER NO. CDO4173P21

		<p>(iii) Contract period and date of completion OR C. SES (Service Entry Sheet)/Certificate of Payment (COP) issued by the company indicating the following:</p> <ul style="list-style-type: none"> (i) Work order no./Contract no. (ii) Gross value of jobs done (iii) Period of Service (iv) Nature of Service <p>c. Only Letter of Intent (LOI)/Letter of Award (LOA), or Work Order(s) are not acceptable as evidence.</p> <p>d. Mere award of contract(s) will not be counted towards experience. Successful completion of the awarded contract(s) to the extent of volume & value, as stipulated respectively under Clause Nos. 1.2 will only be treated as acceptable experience.</p> <p>e. Following work experience will also be taken into consideration:</p> <ul style="list-style-type: none"> (i) If the prospective bidder has executed contract in which similar work is also a component of the contract. (ii) In case the start date of the requisite experience is beyond the prescribed 07 (seven) years reckoned from the original bid closing date but completion is within the prescribed 07 (seven) years reckoned from the original bid closing date. (iii) If the prospective bidder is executing similar work which is still running and the contract value/quantity executed prior to original bid closing date is equal to or more than the minimum prescribed value in the BEC. <p>Proof of work experience against Para e. (i) and (ii) above, to satisfy a) similar work b) minimum prescribed value/qty c) prescribed period of 07 years, to be submitted as below:</p> <p>I. <u>In case requisite experience is against OIL's Contract:</u></p>			
--	--	--	--	--	--

TECHNICAL EVALUATION SHEET FOR BEC
E-TENDER NO. CDO4173P21

		<p>Bidder must submit the breakup of similar work and its value/quantity mentioning SES No. and copies of all relevant SES.</p> <p>II. <u>In case requisite experience is NOT against OIL's Contract:</u> Bidder must submit the breakup of similar work and its value/quantity executed within the prescribed period of 07 (Seven) years reckoned from the original bid closing date. The breakup must be certified by the end user or a certificate issued by a practicing Chartered/Cost Accountant Firm (with Membership Number & Firm Registration Number).</p> <p>Proof of work experience against Para e. (iii) above, to satisfy a) similar work b) minimum prescribed value/qty c) prescribed period of 07 years, to be submitted as below:</p> <p>I. <u>In case requisite experience is against OIL's Contract:</u> Bidder must submit the following:</p> <ul style="list-style-type: none"> A. Breakup of similar work B. SES (Service Entry Sheet)/Certificate of Payment (COP) issued by the company indicating the following: <ul style="list-style-type: none"> (i) Work order no./Contract no. (ii) Gross value of job done (iii) Period of Service (iv) Nature of Service <p>II. <u>In case requisite experience is not against OIL's Contract:</u> Bidder must submit the following:</p> <ul style="list-style-type: none"> A. Breakup of similar work B. Contract document showing details of work. <p style="text-align: center;">AND</p> <ul style="list-style-type: none"> C. LOA/LOI/Work order showing: <ul style="list-style-type: none"> (i) Gross value of job awarded (ii) Nature of job awarded (iii) Contract no./Work order no. 			
--	--	--	--	--	--

TECHNICAL EVALUATION SHEET FOR BEC
E-TENDER NO. CDO4173P21

		<p>(iv) Contract period and date of completion AND</p> <p>D. Certificate of Payment (COP)/SES (Service Entry Sheet) up to the previous month of the original bid closing date of this tender issued by the company indicating the following:</p> <p>(i) Work order no./Contract no.</p> <p>(ii) Gross value of job done</p> <p>(iii) Period of Work Done</p> <p>f. In case of similar work executed through 'sub-contracting', the bidder shall submit relevant documents as mentioned under para 'b' and/or 'e' above, issued directly by the client organization/end user, along with confirmation towards consent of the client organization/end user for allowing 'sub-contracting'.</p> <p>g. SIMILAR work executed by a bidder for its own organization/subsidiary cannot be considered as experience for the purpose of meeting BEC.</p> <p>h. Bids submitted for part of the work will be rejected. Bid will be rejected if not accompanied with adequate documentary proof in support of Work experience as mentioned in Para 1.2 above.</p>			
7	1.3	<p>Bidder must submit an undertaking, in original, from the OEM/Authorized Dealer of Honeywell, Emerson Rosemount, SIEMENS, PHOENIX, ABB Ltd., Bajaj, Philips, HITACHI HiREL, Greaves Cotton Ltd, Kirlosker Oil Engines Ltd., Kirloskar Pneumatic Pvt., Mather & Platt Pumps Ltd., M/s NK Fire Safety, FIRETECH Equipment & Services Pvt. Ltd., Bluestar and Brady & Morris Engg. Co. Ltd in a letter clearly stating that they (OEM/Authorized Dealer) would facilitate the required services to the bidder on regular basis with Maintenance Crew/Technology /Spares/ Product updates etc. & also extend all necessary support during the maintenance period of the contract. In the absence of such undertaking, the bid is liable to be rejected. This undertaking shall be valid for the entire duration of the contract. A format of Undertaking is attached as</p>			

TECHNICAL EVALUATION SHEET FOR BEC
E-TENDER NO. CDO4173P21

		Annexure XP.			
8	1.4	Price bid shall be opened in respect of only the techno-commercially acceptable bidders whose bids have been found to be substantially responsive. A substantially responsive bid is one that meets the terms and conditions of the Tender and/or the acceptance of which bid will not result in indeterminate liability on OIL.			
9	1.5	Bidders are required to quote for all the items as per Price Bid Format; otherwise the offer of the bidder will be straightway rejected.			
10	1.6	If there is any discrepancy between the unit price and the total price, the unit price will prevail and the total price shall be corrected. Similarly, if there is any discrepancy between words and figure, the amounts in words shall prevail and will be adopted for evaluation.			
11	1.7	The quantities shown against each item in the "Price Bid Format" shall be considered for the purpose of Bid Evaluation. It is, however, to be clearly understood that the assumptions made in respect of the quantities for various operations are only for the purpose of evaluation of the bid and the Contractor will be paid on the basis of the actual number of days/parameter, as the case may be.			
12	1.8	The bidders are advised not to offer any discount/rebate separately and to offer their prices in the Price Bid Format after considering discount/rebate, if any.			
13	1.9	Conditional and unsolicited discount will not be considered in evaluation. However, if such bidder happens to be the lowest recommended bidder, unsolicited discount without any condition will be considered for computing the contract price.			
14	1.10	In case of identical overall lowest offered rate by more than 1 (one) bidder, the selection will be made by draw of lot between the parties offering the same overall lowest price.			

TECHNICAL EVALUATION SHEET FOR BEC
E-TENDER NO. CDO4173P21

15	1.11	<p><u>PURCHASE PREFERENCE CLAUSE:</u> Purchase Preference to Micro and Small Enterprises registered with District Industry Centers or Khadi and Village Industries Commission or Khadi and Village Industries Board or Coir Board or National Small Industries Corporation or Directorate of Handicrafts and Handloom or any other body specified by Ministry of MSME:</p> <p>1.11.1 In case participating MSEs Quote price within price band of L1+15%, such MSE shall be considered for award of contract by bringing down their price to L1 price in a situation where L1 price is from someone other than a MSE.</p> <p>1.11.2 In case of more than one such MSE qualifying for 15% purchase preference, the contract shall be awarded to lowest eligible MSE amongst the MSEs qualifying for 15% purchase preference.</p> <p>1.11.3 <u>Documentation required to be submitted by MSEs:</u> Copy of valid Registration Certificate, if bidder is a Micro or Small Enterprises (MSE) registered with District Industry Centers or Khadi and Village Industries Commission or Khadi and Village Industries Board or Coir Board or National Small Industries Corporation or Directorate of Handicrafts and Handloom or Udyog Aadhaar Memorandum or any other body specified by Ministry of MSME. The Registration Certificate should clearly indicate the monetary limit, if any and the items for which bidder are registered with any of the aforesaid agencies. In case bidding MSE is owned by Schedule Caste or Schedule Tribe entrepreneur, valid documentary evidence issued by the agency who has registered the bidder as MSE owned by SC/ST entrepreneur should also be enclosed.</p>			
16	1.12	Price Bids shall be evaluated on overall lowest cost to OIL (L-1 offer) basis i.e. considering total quoted price for all services including applicable GST (CGST & SGST/UTGST or IGST).			
17	1.13	OIL will prefer to deal with registered bidder under GST. Therefore,			

TECHNICAL EVALUATION SHEET FOR BEC
E-TENDER NO. CDO4173P21

		<p>bidders are requested to get themselves registered under GST, if not registered yet.</p> <p>However, in case any unregistered bidder is submitting their bid, their prices will be loaded with applicable GST while evaluation of bid. Where OIL is entitled for input credit of GST, the same will be considered for evaluation of bid as per evaluation methodology of tender document.</p>			
18	1.14	<p>Price Bid uploaded without giving any of the details of the taxes (Including rates and amounts) will be considered as inclusive of all taxes including GST.</p> <p>When a bidder mentions taxes as extra without specifying the rates & amount, the offer will be loaded with maximum value towards taxes received against the tender for comparison purposes. If the bidder emerges as lowest bidder after such loading, in the event of order on that bidder, taxes mentioned by OIL on the Purchase Order/Contracts will be binding on the bidder.</p>			
19	1.15	Input Tax Credit on GST (Goods & Service Tax) for this service is NOT available to OIL & the bids will be evaluated based on total price including GST.			
20	1.16	Based on the evaluation of techno-commercially qualified bidders, the job will be awarded to L-1 bidder.			
2.0 <u>BID REJECTION CRITERIA (BRC):</u>					
21	2.1	The bids are to be submitted in single stage under Two Bid System i.e. Un-priced Techno-Commercial Bid and Price Bid together. Only the Price Bid should contain the quoted price.			
22	2.2	The price quoted by the successful bidder must be firm during the performance of the contract and not subject to variation on any account except as mentioned in the bid document. Any bid submitted with adjustable price quotation other than the above will be treated as non-			

TECHNICAL EVALUATION SHEET FOR BEC
E-TENDER NO. CDO4173P21

		responsive and rejected.			
23	2.3	Bid security shall be furnished as a part of the Techno Commercial Un-priced Bid. The amount of bid security should be as specified in the forwarding letter. Any bid not accompanied by a proper bid security will be rejected.			
24	2.4	Bid Documents/User Id & Password for OIL's E-Tender portal are not transferable.			
25	2.5	Any bid received in the form of Physical document/Telex/Cable/Fax/E-mail will not be accepted.			
26	2.6	Bids shall be typed or written in indelible ink. The bidder or his authorized representative shall sign the bid digitally, failing which the bid will be rejected.			
27	2.7	Bids shall contain no interlineations, erasures or overwriting except as necessary to correct errors made by bidder, in which case such corrections shall be initiated by the persons(s) signing (digitally) the bid. However, white fluid should not be used for making corrections. Any bid not meeting this requirement shall be rejected.			
28	2.8	Any bid containing false statement will be rejected and action will be taken by Company as per Bid Document.			
29	2.9	Bidders must quote clearly and strictly in accordance with the price schedule outlined in Price Bidding Format attached under "Notes and Attachments" tab in the main bidding engine of OIL's E-Tender portal; otherwise the bid will be rejected. All other techno-commercial documents other than price details to be submitted with Un-priced Techno-Commercial Bid as per tender requirement under "Technical Attachment" Tab Page only.			

TECHNICAL EVALUATION SHEET FOR BEC
E-TENDER NO. CDO4173P21

30	2.10	<p>Bidder must accept and comply with the following provisions as given in the Tender Document in toto, failing which offer will be rejected:</p> <ul style="list-style-type: none"> (i) Firm price (ii) EMD/Bid Bond (iii) Period of validity of Bid (iv) Price Schedule (v) Performance Bank Guarantee/Security deposit (vi) Delivery/Completion Schedule (vii) Scope of work (viii) Guarantee of material/work (ix) Liquidated Damages clause (x) Tax liabilities (xi) Arbitration/Resolution of Dispute Clause (xii) Force Majeure (xiii) Applicable Laws (xiv) Specifications (xv) Integrity Pact 			
31	2.11	There should not be any indication of price in the Un-priced Techno-Commercial Bid. A bid will be straightway rejected if this is given in the Un-priced Techno-Commercial Bid.			
32	2.12	Bid received with validity of offer less than 120 (one hundred twenty) days from the date of Technical Bid opening will be rejected.			
33	2.13	The Integrity Pact is applicable against this tender. OIL shall be entering into an Integrity Pact with the bidders as per format enclosed vide " Part-VI/Integrity Pact " of the tender document. This Integrity Pact proforma has been duly signed digitally by OIL's competent signatory. The			

TECHNICAL EVALUATION SHEET FOR BEC
E-TENDER NO. CDO4173P21

		proforma has to be returned by the bidder (along with the Un-priced Techno-Commercial Bid) duly signed (digitally) by the same signatory who signed the bid, i.e., who is duly authorized to sign the bid. Uploading the Integrity Pact with digital signature will be construed that all pages of the Integrity Pact has been signed by the bidder's authorized signatory who sign the Bid.			
34	3.0	<p><u>GENERAL:</u></p> <p>3.1 In case bidder takes exception to any clause of bidding document not covered under BEC/BRC, then the Company has the discretion to load or reject the offer on account of such exception if the bidder does not withdraw/modify the deviation when/as advised by company. The loading so done by the company will be final and binding on the bidders. No deviation will however be accepted in the clauses covered under BEC/BRC.</p> <p>3.2 To ascertain the substantial responsiveness of the bid the Company reserves the right to ask the bidder for clarification in respect of clauses covered under BEC/BRC also and such clarifications fulfilling the BEC/BRC clauses in toto must be received or before the deadline given by the company, failing which the offer will be will be evaluated based on the submission. However, mere submission of such clarification shall not make the offer responsive, unless company is satisfied with the substantial responsiveness of the offer.</p> <p>3.3 If any of the clauses in the BEC/BRC contradict with other clauses of bidding document elsewhere, the clauses in the BEC/BRC shall prevail.</p> <p>3.4 Bidder(s) must note that requisite information(s)/financial values etc. as required in the BEC/BRC & Tender are clearly understandable from the supporting documents submitted by the Bidder(s); otherwise Bids shall be rejected.</p> <p>3.5 OIL will not be responsible for delay, loss or non-receipt of applications for participating in the bid sent by mail and will not</p>			

TECHNICAL EVALUATION SHEET FOR BEC
E-TENDER NO. CDO4173P21

		entertain any correspondence in this regard.			
		3.6 The originals of documents [furnished by bidder(s)] shall have to be produced by bidder(s) to OIL as and when asked for.			